



8-2001

## **Arsenic Removal for Small Drinking Water Treatment Systems: A Multimedia CD-ROM for Drinking Water Professionals**

Greg A. Harrison  
*University of Tennessee - Knoxville*

Follow this and additional works at: [https://trace.tennessee.edu/utk\\_gradthes](https://trace.tennessee.edu/utk_gradthes)

 Part of the [Environmental Engineering Commons](#)

---

### **Recommended Citation**

Harrison, Greg A., "Arsenic Removal for Small Drinking Water Treatment Systems: A Multimedia CD-ROM for Drinking Water Professionals. " Master's Thesis, University of Tennessee, 2001.  
[https://trace.tennessee.edu/utk\\_gradthes/1967](https://trace.tennessee.edu/utk_gradthes/1967)

This Thesis is brought to you for free and open access by the Graduate School at TRACE: Tennessee Research and Creative Exchange. It has been accepted for inclusion in Masters Theses by an authorized administrator of TRACE: Tennessee Research and Creative Exchange. For more information, please contact [trace@utk.edu](mailto:trace@utk.edu).

To the Graduate Council:

I am submitting herewith a thesis written by Greg A. Harrison entitled "Arsenic Removal for Small Drinking Water Treatment Systems: A Multimedia CD-ROM for Drinking Water Professionals." I have examined the final electronic copy of this thesis for form and content and recommend that it be accepted in partial fulfillment of the requirements for the degree of Master of Science, with a major in Environmental Engineering.

Dr. R. Bruce Robinson, Major Professor

We have read this thesis and recommend its acceptance:

Dr. Wayne T. Davis, Dr. Bruce A. Tschantz

Accepted for the Council:

Carolyn R. Hodges

Vice Provost and Dean of the Graduate School

(Original signatures are on file with official student records.)

To the Graduate Council:

I am submitting herewith a thesis written by Greg A. Harrison entitled “Arsenic Removal for Small Drinking Water Treatment Systems: A Multimedia CD-ROM for Drinking Water Professionals.” I have examined the final copy of this thesis for form and content and recommend that it be accepted in partial fulfillment of the requirements for the degree of Master of Science, with a major in Environmental Engineering.

Dr. R. Bruce Robinson, Major Professor

We have read this thesis  
and recommend its acceptance:

Dr. Wayne T. Davis

Dr. Bruce A. Tschantz

Accepted for the Council:

Dr. Anne Mayhew  
Interim Vice Provost and  
Dean of The Graduate School

(Original signatures are on file in the Graduate Admissions and Records Office)

ARSENIC REMOVAL FOR  
SMALL DRINKING WATER TREATMENT SYSTEMS:  
A Multimedia CD-ROM  
for Drinking Water  
Professionals

A Thesis  
Presented for the  
Master of Science  
Degree  
The University of Tennessee, Knoxville

Greg A. Harrison  
August 2001



## **DEDICATION**

This thesis is dedicated to my parents Mr. Sherman Harrison and Mrs. Linda Harrison who gave me encouragement to pursue my dreams and invaluable support to further my education at The University of Tennessee.

## **ACKNOWLEDGMENTS**

I would like to thank Dr. R. Bruce Robinson for his guidance and aid in the completion of this thesis. I would also like to thank Dr. Wayne T. Davis and Dr. Bruce A. Tschantz for taking the time to serve on my committee.

Special thanks go to Ramesh Narasimhan of NCS and Sunil Kommineni of Malcolm Pirnie for providing information and data in support of this project.

I also wish to acknowledge the University of New Hampshire's Small Public Water Supply Technology Assistance Center and Dr. Robin Collins for providing funding and assistance in the completion of this work.

## **ABSTRACT**

This thesis, in conjunction with the accompanying CD-ROM, are intended to be used by small public water system operators, owners, regulators, and engineers as an educational tool for future compliance with a lowered Arsenic Maximum Contaminant Level (MCL). The CD-ROM is the third in a series of water treatment technology CDs that were created by a collaboration of Dr. R. Bruce Robinson, the University of Tennessee, and Dr. M. Robin Collins, the Water Treatment Technology Center, the University of New Hampshire. The CD-ROM includes multimedia tools such as video and photos, which will aid in the understanding of the included descriptive text of processes and operations involved in the removal of arsenic. The thesis includes a literature review on arsenic removal from drinking water systems and a discussion on the process and methodology that was undertaken to create the CD-ROM.

## TABLE OF CONTENTS

CHAPTER	Page
1 INTRODUCTION .....	1
1.1 Background.....	1
1.2 Statement of the Problem .....	2
1.3 Objectives of the Project .....	3
2 REVIEW OF THE LITERATURE .....	4
2.1 Arsenic Regulation Development .....	4
2.2 Health Effects .....	6
2.3 Arsenic Chemistry .....	10
2.4 Arsenic Occurrence.....	13
2.5 Treatment Technologies .....	16
2.5.1 Enhanced Coagulation/Filtration and Coagulation/Microfiltration ....	18
2.5.2 Enhanced Lime Softening.....	24
2.5.3 Iron Removal.....	27
2.5.4 Ion Exchange.....	31
2.5.5 Activated Alumina .....	38
2.5.6 Membrane Separation Processes .....	43
2.5.7 Alternative and Innovative Adsorption Technologies.....	50
2.6 Disposal of Residuals.....	53
2.6.1 Conventional Treatment Processes .....	54
2.6.2 Ion Exchange Processes.....	54
2.6.3 Activated Alumina Processes.....	55

2.6.4	Membrane Processes .....	55
2.7	Cost Data for Treatment Technologies .....	56
3	METHODS AND MATERIALS OF MULTIMEDIA CD-ROM PRODUCTION	57
3.1	CD-ROM Development Approach .....	57
3.2	Pilot-Plant Site Visits .....	57
3.3	Data File Preparation .....	59
3.3.1	Photo & Slide Preparation Procedure.....	59
3.3.2	Movie File Preparation Procedure.....	60
3.4	Authorware Screen Production.....	62
	REFERENCES .....	64
	APPENDICES.....	70
Appendix A	Tables Discussed in Body of Report.....	71
Appendix B	Figures Discussed in Body of Report .....	83
Appendix C	Correspondence With Pilot-Plant Owners .....	104
Appendix D	Permission to Use Photos & Video Form .....	107
Appendix E	Storyboard .....	110
Appendix F	Sample Authorware Program Screens .....	125
Appendix G	Arsenic Module Screen Captures .....	131
VITA	.....	151

## LIST OF TABLES

TABLE	Page
1 Cancer Risks for U.S. Populations Exposed at or Above MCL Options, After Treatment .....	72
2 Principle Reactions Affecting Inorganic Arsenic Concentrations in Groundwater .....	73
3 Comparison of National Arsenic Occurrence Estimates .....	74
4 Best Available Technologies and Removal Rates .....	75
5 Small System Compliance Technologies for Arsenic (V) .....	76
6 Summary of Reported Performance of Arsenic Removal Technologies in the Literature .....	77
7 Arsenic Treatment Technology Advantages and Disadvantages .....	78
8 Membrane Terminology .....	80
9 Summary of Residuals/Management Methods .....	81
10 Capital and O&M Costs for Arsenic Removal Technologies At Average Flows of 0.01, 0.1, and 1-mgd .....	82

## LIST OF FIGURES

FIGURE	Page
1 Arsenic (III) Solubility Diagram .....	84
2 Arsenic (V) Solubility Diagram .....	85
3 Arsenic Concentrations in Groundwater of the United States .....	86
4 Counties With Arsenic Concentrations Exceeding Possible New MCLs in 10 Percent or More of Groundwater Samples .....	87
5 Typical Coagulation/Filtration Treatment Process Diagram .....	88
6 Typical Lime Softening Treatment Process Diagram.....	89
7 Typical Fe/Mn Removal Treatment Process Diagram.....	90
8 Typical Anion Exchange Treatment Process Diagram.....	91
9 Bed Volumes to Arsenic Breakthrough as a Function of Sulfate Concentration for Ion Exchange.....	92
10 Typical Activated Alumina Treatment Process Diagram .....	93
11 Size Ranges of Membrane Processes and Contaminants.....	94
12 Typical NF/RO/EDR Membrane Filtration Treatment Process Diagram.....	95
13 Typical Media Adsorption Treatment Process Diagram.....	96
14 Enhanced Coagulation/Filtration and Enhanced Lime Softening Capital Costs.....	97
15 Enhanced Coagulation/Filtration and Enhanced Lime Softening O&M Costs.....	98

(list of figures continued)

<b>FIGURE</b>	<b>Page</b>
16 C/MF, AA, IX, and Greensand Filtration Capital Costs.....	99
17 C/MF, AA, IX, and Greensand Filtration O&M Costs.....	100
18 AA With and Without pH Adjustment Capital Costs.....	101
19 AA With and Without pH Adjustment O&M Costs.....	102
20 Flow Chart of Arsenic Removal Module .....	103



# **CHAPTER 1**

## **INTRODUCTION**

### **1.1 Background**

Arsenic removal from drinking water systems in the United States has become a very important topic recently with concerns about the current maximum contaminant level (MCL) in the U.S. not being adequate for the protection of human health. In June of 2000, the U.S. EPA proposed dropping the MCL for arsenic from 50 µg/L to 5 µg/L, thus raising the concern of how utilities would meet the new standard. In January of 2001, EPA issued a final rule setting the new MCL at 10 µg/L, a five-fold decrease from the current MCL. As of this writing, the final rule has been rescinded by EPA pending further study. Arsenic was regulated in the past because it was a Class I carcinogen and was thought to cause skin cancer in humans. Recent epidemiological studies in Taiwan have indicated that arsenic in drinking water may also increase risks of bladder and lung cancers in humans as well (U.S. EPA, 1998). The EPA estimates that 5.3% of ground water community water systems (CWSs) and 0.80% of surface water CWSs have average finished water arsenic levels above 10 µg/L (U.S. EPA, 2001b). The EPA also estimates that under a final MCL of 10 µg/L, total national costs to community water systems will be \$172.3 million (1999 dollars) annually at a 3% discount rate or \$196.6 million annually at a 7% discount rate (U.S. EPA, 2001b). The annual average household cost increase for those systems requiring treatment is estimated to be \$31.85 (1999 dollars) (U.S. EPA, 2001b).

## **1.2 Statement of the Problem**

The current MCL for arsenic was primarily a concern for specific regions of the United States, and most utilities reported levels far below the existing standard of 50 µg/L, thus requiring no treatment. Compliance with an MCL of 10 µg/L will be a greater problem for utilities throughout the U.S., especially for smaller systems with limited financial resources. Many small groundwater systems which previously have required no treatment, will now require installation, operation, and maintenance of a treatment facility.

Most practicing engineers that are involved in the design process or regulatory approval process for small drinking water systems are not able to attend national conferences or workshops on emerging treatment technologies or regulations due to time or budget constraints. Therefore, the technologies for removal of arsenic may not be familiar to these engineers. Additionally, there has not been a demand for engineers to design arsenic removal systems due to the lack of systems exceeding the current MCL. Therefore, there is likely a general lack of knowledge among practicing engineers as to what treatment technologies may be appropriate for arsenic removal. This document intends to give guidance to small drinking water utilities, practicing engineers, and state and federal regulators on the treatment technologies that are available for arsenic removal and the wealth of information that is currently available on these technologies within the drinking water community.

### **1.3 Objectives of the Project**

The objectives of this project are to produce an educational CD-ROM on arsenic removal water treatment technologies, which will target an audience consisting of state and federal regulators, practicing engineers, and small water system managers and operators. The CD-ROM includes multimedia features such as interactive process diagrams, video clips, photos, and sample plans of typical processes to aid in the understanding of the technologies by the user. The CD-ROM contains much of the narrative text of this thesis, including the literature review on arsenic removal, but does not include the discussion of the approach and process that was undertaken to create the CD-ROM. The CD-ROM will benefit engineers working on small arsenic removal systems by providing a comprehensive document on treatment technologies, and references to studies that were conducted on the subject, that will be easily obtainable and accessible.

## **CHAPTER 2**

### **REVIEW OF THE LITERATURE**

There is a current need for the compilation of information available on arsenic removal from drinking water. The following literature review will serve as a review of the available literature and provide references for readers wishing to research the topic further. The literature review will cover several topics involving arsenic removal including: regulatory history, occurrence data, chemistry review, health effects, treatment technologies, costs, and waste disposal alternatives. The focus in the treatment technology portion will be towards technologies available for use by small community water systems (serving approximately 10,000 people or less). Articles referenced in the literature review were identified by a computerized library database search using key words. Many of the articles were found from references cited in previously discovered articles.

#### **2.1 Arsenic Regulation Development**

Development of a National Interim Primary Drinking Water Regulation for arsenic has been delayed several times over the past 15 years because of uncertainties regarding health issues and the costs associated with compliance with a new rule (Pontius, 1995). Arsenic was first regulated in 1942 by the U.S. Public Health Service, which set a maximum limit at 50 µg/L for interstate water carriers (U.S. EPA, 2000d). The Safe Drinking Water Act (SDWA) of 1974 required that U.S. EPA set primary and secondary drinking water standards and, as a result, EPA issued a National Interim

Primary Drinking Water Regulation for arsenic of 50 µg/L in 1975. The 1986 amendments to the SDWA converted the 1975 interim arsenic standard to a National Primary Drinking Water Regulation (NPDWR) that was to be revised by the EPA by 1989. EPA has since deferred the revised regulation in order to better characterize the health risks and to determine the cost-effective technologies for small utilities (U.S. EPA, 2000d). Currently, and until a more stringent MCL is effective, the arsenic MCL in the United States is 50 µg/L and there is no maximum contaminant level goal (MCLG).

The World Health Organization (WHO) established a provisional guideline value for arsenic of 10 µg/L in their 1993 edition of *WHO Guidelines for Drinking-water Quality*. The Guidelines were developed for use as a “basis for the development of national standards in the context of local or national environmental, social, economic, and cultural conditions.” The WHO (1999) states that the 10 µg/L arsenic guideline “would be even lower if not for lack of suitable testing methods.” The Practical Quantitation Limit (PQL), which defines the lowest concentration of an analyte that can be reliably measured within specified limits of precision and accuracy, is 3 µg/L for arsenic. The WHO standard is solely based on health effects and primarily on assessment of arsenic-induced skin cancer. Cancer risk estimates are the primary driving force behind the lowering of existing arsenic guidelines and the MCL in the United States (Pontius *et al.*, 1994).

In the 1996 amendments of the Safe Drinking Water Act (SDWA), Congress directed the U.S. EPA to propose a revised NPDWR for arsenic by January 1, 2000 and to issue the final regulation by January 1, 2001. In June 2000, the U.S. EPA issued a proposed arsenic rule in the *Federal Register* (U.S. EPA, 2000d). They proposed an

MCL for arsenic of 5 µg/L and requested comments on 3 µg/L, 10 µg/L, and 20 µg/L. Also, they proposed to set the MCLG, or non-enforceable goal, at zero. The final rule statutory deadline was then amended to June 22, 2001 by Congress (Water Tech Online, 2000). In January of 2001 EPA issued the final arsenic rule with an MCL of 10 µg/L and an MCLG of zero. This is only the second drinking water regulation which will set a standard less stringent than technically feasible level (3 µg/L based on treatment technologies and analytical methods) because EPA determined that the benefits of an MCL set at the feasible level would not justify the costs (the first time was in the final rule on uranium published on December 7, 2000) (U.S. EPA, 2001b). The regulation applies to non-transient non-community water systems, which are not presently subject to standards on arsenic, and to community water systems. The compliance date for requirements related to the final rule on arsenic is January 23, 2006.

At the time of writing this document, the EPA, under a new administration, decided to withdraw the new arsenic rule pending further study on the science and costs involved in its implementation. In April 2001 press releases, EPA Administrator Christie Whitman stated that the review of the final rule will be complete within a nine-month period and the agency does not intend to delay the compliance date of January 23, 2006 for a new MCL.

## **2.2 Health Effects**

Arsenic ingestion has been linked to a multitude of health effects, both cancerous and non-cancerous. These health effects include cancer of the bladder, lungs, kidney, skin, nasal passages, liver, and prostate. Arsenic ingestion has also been attributed to

cardiovascular, pulmonary, immunological, and neurological, endocrine effects (U.S. EPA, 2001b).

The health effects of arsenic can be grouped into two categories; acute (short-term) and chronic (long-term) exposure. The acute toxicity effects of arsenic are well documented, however, drinking water engineers, are most interested in the chronic effects of arsenic in drinking water at low levels. This long-term effect is what the U.S. EPA's (2000d) revised MCL is based upon.

The actual toxicity of arsenic to the human body varies depending on several factors such as the general health of the individual and their diet. It is a cumulative substance, which slowly passes out of the body through urine, hair, fingernails/toenails and skin (Karim, 2000). Humans are exposed to arsenic primarily from air, food, and water. After ingestion, inorganic arsenic that is not immediately excreted or absorbed by tissues is progressively detoxified through the methylation process. The metabolism of arsenic in the human body involves two processes: (1) As(V) enters a cell and is reduced to As(III), and (2) As(III) is then methylated (i.e., chemically bonded to a methyl group, which is a carbon atom linked to three hydrogen atoms) to form the metabolites monomethylarsonic acid (MMA) and dimethylarsinic acid (DMA) which occurs primarily in the liver. In contrast to inorganic arsenic, neither MMA nor DMA binds strongly to biological molecules in humans, therefore their relative acute toxicity is less than that of inorganic arsenic forms. Given that arsenic can be detoxified in the body suggests that there is a level of exposure below which no adverse health effect would be observed. Any arsenic exposure above this level would only be partially detoxified, and adverse effects, commensurate with exposure, would be expected (Pontius *et al.*, 1994). However, recent

work has shown that the assumption that organic forms that arise during the metabolism of inorganic arsenic are less toxic than inorganic forms may not be correct. This may indicate that the metabolism of inorganic arsenic is not necessarily a detoxification process. As yet, it is not known which form of arsenic participates in the key events within human cells that disrupt cell growth control and initiate or influence tumor formation (U.S. EPA, 2001b).

Health effects from consuming arsenic contaminated drinking water at the low-levels normally encountered are delayed. The most common signs of long-term, low-level arsenic exposure are dermal, or skin changes. These may include variations in skin pigmentation, hyperkeratoses, and ulcerations (Pontius *et al.*, 1994). Skin lesions are generally first, and appear after a minimum exposure of approximately 5 years (WHO, 1999). Development of peripheral vascular disease (hardening of the arteries to the arms and legs, that can cause pain, numbness, tingling, infection, gangrene, and clots) following exposure to inorganic arsenic in drinking water has also been reported (U.S. EPA, 2000d).

Inorganic arsenic is classified as a human carcinogen by the EPA based on sufficient evidence from human data (U.S. EPA, 1998). Increased lung cancer mortality was observed in multiple human populations exposed primarily through inhalation. Also, increased mortality from multiple internal organ cancers (liver, kidney, lung, and bladder) and an increased incidence of skin cancer were observed in populations consuming drinking water high in inorganic arsenic. Until the late 1980's, skin cancer was thought to be the only cancer associated with arsenic in drinking water. However, Asian, Mexican and South American populations with exposures to arsenic in drinking water at



or above several hundred micrograms per liter are reported to have increased risks of bladder and lung cancer along with skin cancer (U.S. EPA, 2000d).

EPA's Integrated Risk Information System (IRIS) database (U.S. EPA, 1998) provides an oral Reference Dose (RfD) for inorganic arsenic of  $3 \times 10^{-4}$  mg/kg-day. The RfD is defined as "an estimate (with uncertainty spanning perhaps an order of magnitude) of a daily exposure to the human population (including sensitive subgroups) that is likely to be without an appreciable risk of deleterious effects during a lifetime." Data from a study in 1977 by W.P. Tseng in an area of Taiwan with high concentrations of arsenic in drinking water was used to develop the RfD.

EPA based its toxicity analysis and risk level assessment in the final rule (U.S. EPA, 2001b) for arsenic on epidemiological studies and not on animal studies. Normally, the characteristics of human carcinogens can be explored and experimentally defined in animals. However, arsenic presented unique problems in EPA's risk assessment because there is no test animal species in which to study its carcinogenicity. Test animals do not appear to respond to inorganic arsenic exposure in a way that would make them useful as a model for human cancer assessment. Test animals metabolism of inorganic arsenic is quantitatively different than humans (U.S. EPA, 2001b).

The EPA has historically considered a risk range of  $10^{-4}$  to  $10^{-6}$  (1 in 10,000 to 1 in 1,000,000) as a target risk range protective of public health in its drinking water program (U.S. EPA, 2001b). In doing this, the EPA has sought to ensure that drinking water standards were established at levels such that less than 10% of the exposed population faced a risk that exceeded the chosen risk level. Current research on arsenic exposure has only been able to provide enough information to conduct a quantitative assessment of

bladder and lung cancers. Skin cancer was considered only qualitatively because of the difficulty in determining its endpoint, due to the fact that in the U.S. it is considered curable. In the final rule (U.S. EPA, 2001b) EPA based its evaluation of the risk posed by arsenic at each of the MCL options listed in the proposed rule on assessment of lung and bladder cancers. Table 1 (all tables referred to in the text are located in Appendix A) shows the cancer risks for exposed populations at several MCLs which EPA considered in developing a final rule. At 10 µg/L, the cancer risk for U.S. populations exposed at or above the MCL, after treatment, was found to be 0.63 to 2.99 X 10<sup>-4</sup> (1 in 15,873 people to 1 in 3,344 people). The range of estimates accounts for the before and after adjustments for exposure uncertainty in documented studies (Taiwan study by Tseng) for arsenic in cooking water and food. At a final MCL of 10 µg/L, EPA estimates 21 to 30 fatal bladder and lung cancers and 12 to 26 non-fatal bladder and lung cancers per year are prevented (U.S. EPA, 2001b).

## **2.3 Arsenic Chemistry**

A review of the chemistry of arsenic is necessary to understand the treatment technologies that are efficient in its removal from drinking water. Arsenic is a metalloid, which means it exhibits both metallic and nonmetallic chemical and physical properties. The oxidation state, or valence state, which is the capacity of the atom to combine with other atoms, is used to denote the form of arsenic present. Arsenic and its compounds are mobile in the environment. The “mobility” of arsenic in the environment means that it has the ability to enter a cycle of transport between land, air, and water under favorable conditions. In the case of groundwater, arsenic is able to migrate from the soil/rock

matrix to groundwater where geochemical conditions favor arsenic dissolution.

Weathering of rock converts arsenic sulfides to arsenic trioxide, which enters the arsenic cycle as dust or by dissolution in rain, rivers, or groundwater. Water is the primary means of arsenic transport in the environment (Pontius *et al.*, 1994).

Arsenic can occur in four oxidation states in water (-III, 0, +III, +V), but generally is found in only the trivalent (arsenite) and pentavalent (arsenate) states. The weak acids – arsenious acid,  $\text{HAsO}_2$  (+III oxidation state or arsenite form), and arsenic acid,  $\text{H}_3\text{AsO}_4$  (+V oxidation state or arsenate form) – will occur in the aqueous phase. Arsenious acid can speciate in five forms as  $\text{H}_4\text{AsO}_3^+$ ,  $\text{H}_3\text{AsO}_3$ ,  $\text{H}_2\text{AsO}_3^-$ ,  $\text{HAsO}_3^{2-}$ , and  $\text{AsO}_3^{3-}$ . Arsenic acid species are  $\text{H}_3\text{AsO}_4$ ,  $\text{H}_2\text{AsO}_4^-$ ,  $\text{HAsO}_4^{2-}$ , and  $\text{AsO}_4^{3-}$ . In natural waters, the valence and the species of arsenic present are dependent on oxidation-reduction conditions and the pH of the water. Arsenite forms are more likely to be found in oxygen-free (anaerobic) groundwater, while arsenate form are more common in aerobic surface waters (Harper and Kingham, 1992). Figures 1 and 2 (all figures mentioned in the text are located in Appendix B) show the solubility diagrams of As(III) and As(V), respectively. The figures indicate that for As(III), neutral forms exist at  $\text{pH} < 9.0$  and the anionic forms exist at  $\text{pH} > 9.0$ . For As(V), anionic forms dominate at  $\text{pH} > 3.0$  (U.S. EPA, 2000b,e,f). At the range of pH between 6 and 9, the primary arsenite species found in natural waters is  $\text{H}_3\text{AsO}_3$ . At this range of pH, the primary arsenate species found in groundwater are monovalent  $\text{H}_2\text{AsO}_4^-$  and divalent  $\text{HAsO}_4^{2-}$ .

The observed coexistence of both As(III) (reduced form relative to As(V)) and As(V) (oxidized form) forms in surface waters is probably caused by the slow oxidation kinetics of arsenite to arsenate or bacterial reduction of arsenate to arsenite at neutral pH in

localized areas where a reducing environment can exist (Gupta and Chen, 1978; Waypa *et al.*, 1997).

As(III) is more toxic to biological systems than is As(V) and it is also the more difficult form to remove using conventional treatment processes and adsorption techniques. This is because most removal mechanisms involve sorption of the negatively charged arsenate species to a positively charged surface, and arsenite exists primarily as a neutral species in natural waters (McNeill and Edwards, 1997b). Oxygen alone has been shown to have very slow reaction kinetics in oxidizing As(III) to As(V). Conventional oxidants used in drinking water treatment, such as chlorine, ozone, and permanganate, are capable of rapidly oxidizing As(III) to As(V) (Hering *et al.*, 1996).

Iron and manganese are a strong influence on arsenic concentrations in the environment. Manganese oxide, which is common in freshwater sediments, is a very effective oxidant with respect to As(III) (Oscarson *et al.*, 1981). In natural waters, As(V) fate and transport are intimately associated with iron oxides (McNeill and Edwards, 1997a). Arsenic can be immobilized through adsorption-coprecipitation with iron and manganese hydroxides, or mobilized when such solids are dissolved under reducing conditions, or released from the oxide surfaces in the event of competition (for sorptive surface sites) in the presence of orthophosphate and natural organic matter (NOM) (Edwards, 1994).

It is important to know the valence state and species of arsenic in the source water prior to design of any arsenic treatment system. Treatment processes such as coagulation/filtration and lime softening rely on adsorption and coprecipitation of arsenic to metal hydroxides, thus the valence state must be known for effective removal. Also,

processes such as anion exchange and activated alumina function by exchanging arsenate with counter ions of an anionic resin and by adsorbing arsenate onto alumina, respectively, thus the valence state must be known to design an effective treatment system.

## **2.4 Arsenic Occurrence**

The contamination of a drinking water source by arsenic can result from either natural or human activities. Arsenic is an element that occurs naturally in rocks and soil, water, air, plants, and animals. Natural sources that can release arsenic into the environment include volcanic activity, the erosion of rocks and minerals, and forest fires. Arsenic is used for a variety of industrial purposes: electrophotography, catalysts, pyrotechnics, antifouling paints, pharmaceutical substances, dyes and soaps, ceramics, alloys, battery plates, and semiconductors. Inorganic arsenic and its compounds are used as a wood preservative to pressure treat lumber and was used, until voluntarily canceled in 1993, as an agricultural pesticide. The production of chromated copper arsenate, an inorganic arsenic compound and wood preservative that has been used for more than 60 years, accounts for approximately 90% of the arsenic used annually by industry in the United States (Welch *et al.*, 2000; U.S. EPA, 2000d).

As discussed in the chemistry review section, the presence of iron oxides in groundwater has a dramatic affect on the mobility and concentration of arsenic. Reduction and dissolution of iron oxide through reaction with organic matter appear to produce high arsenic groundwater in some parts of the country. This appears to be the most common cause of regionally high arsenic concentrations (Welch *et al.*, 2000). Most

of the high concentrations of arsenic in the western U.S. can be attributed to weathered volcanic rocks, geothermal areas, irrigation practices, or mineral deposits (Korte, 1991). Table 2 shows a summary of some of the most important reactions affecting arsenic concentrations in groundwaters listed by Welch et al. (2000).

Korte (1991) describes a common set of hydrogeologic conditions that yield elevated levels of naturally occurring arsenic in groundwaters of the midwestern United States. When investigating the groundwater at an industrial facility in Missouri he found arsenic levels exceeding 50 µg/L with no historical usage of arsenic at the facility. He found that the high concentration of arsenic in some of the wells was due to the desorption from iron oxides under reducing conditions and subsequent mobilization into the groundwater. The mechanism probably begins with the deposition of iron oxides during streamflow while the alluvium is being deposited. The oxides, which have a strong affinity for dissolved arsenic, adsorb it from the streamflow. As the alluvium is being buried, it eventually becomes subject to slow groundwater movement. As redox conditions become increasingly reducing, the ferric iron is reduced to ferrous iron, resulting in mobilization of some of the adsorbed arsenic. Korte's conclusion was that the high occurrences of arsenic are sporadic because the arsenic is mobilized only under a narrow range of redox conditions. Localized variations in potential (Eh) and arsenic content lead to varying arsenic levels.

A key component of recent literature on arsenic removal is the assessment of the number of water systems that will be expected to exceed the new MCL and thus require some type of treatment. Frey and Edwards (1997) synthesized three surveys of arsenic occurrence in the U.S. – the National Arsenic Occurrence Survey (NAOS), the National

Inorganics and Radionuclides Survey (NIRS), and a survey by the Metropolitan Water District of Southern California (MWDSC). They drew several conclusions from the study, including: (1) overall, higher concentrations of arsenic are present in groundwater sources compared with surface water sources, (2) the majority of water sources, 53-71% of groundwater sources and 61-88% of surface water sources, were found to have arsenic present below 2 µg/L, (3) regional trends in arsenic occurrence were found for both surface water and groundwater sources, with higher concentrations of arsenic in the south central and more western states, and (4) between 6 and 17% of systems (2,775 - 7,870) were projected to have arsenic levels >5 µg/L.

The U.S. Geological Survey (USGS) published a study of arsenic occurrence in the U.S. using data collected over the last two decades of potable water from 18,850 wells in 595 counties across the United States (USGS, 2000). Their data are depicted in Figures 3 and 4. Analysis of the USGS data indicates that arsenic concentrations are generally highest in the Western U.S. High concentrations were also found in parts of the Midwest and Northeast at levels exceeding 10 µg/L. The USGS estimated that just over 7.6% of small systems (serving between 1,000 and 10,000 persons) used water with arsenic concentrations greater than 10 µg/L, compared to fewer than 1% exceeding the current 50 µg/L MCL.

The EPA used compliance monitoring data from the “25-States database” to establish occurrence and exposure distributions of arsenic in public groundwater and surface water supplies (U.S. EPA, 2000d). The database provided finished water data for arsenic from over 77,000 observations from more than 26,600 public water systems in 25 states. States for which EPA had no data were accounted for by assigning regional occurrence

distributions to them (U.S. EPA, 2001b). Table 3 shows a comparison of estimates from NAOS, NIRS, USGS, and the proposed and final EPA rules, of systems that are exceeding arsenic concentrations at levels of 2, 3, 5, 10, and 20 µg/L (U.S. EPA, 2001b). EPA estimates that 5.3% and 0.8% of groundwater CWSs and surface water CWSs, respectively, have average arsenic levels above 10 µg/L. This corresponds to approximately 2,300 CWSs (out of a total of 43,749 systems) using groundwater and 85 CWSs (out of a total of 10,683 systems) using surface water that will exceed the new 10 µg/L MCL. An estimated 1,100 NTNCWS (out of 20,000 systems nationwide) will also exceed the 10 µg/L MCL and will require treatment.

## **2.5 Treatment Technologies**

Compliance with a revised arsenic MCL will be required for community water systems once the pending final rule is published and following a likely five-year compliance schedule. Thus, large and small utilities alike must begin to formulate a strategy for coming into compliance with a more stringent MCL. It is assumed that most utilities with existing treatment processes in place will attempt to enhance those processes to attain compliance if feasible. However most systems using groundwater currently have no treatment scheme in place. Therefore, these systems, if in non-compliance with the new MCL, will be required to install a new treatment system for arsenic removal. The best arsenic treatment technique for a given utility will depend on the arsenic concentration and species in the feedwater, co-occurring constituents in the water, existing treatment processes, treatment costs, and the handling of any residuals (Chen *et al.*, 1999).



In the final rule on arsenic, the EPA (2001b) identified Best Available Technologies (BATs) for arsenic removal based on the following criteria:

- (1) the capability of a high removal efficiency;
- (2) a history of full-scale operation;
- (3) general geographic applicability;
- (4) reasonable cost based on large and metro water systems;
- (5) reasonable service life;
- (6) compatibility with other treatment processes; and
- (7) the ability to bring all of the water in a system into compliance.

The BATs identified, which are shown in Table 4, are ion exchange, activated alumina, reverse osmosis, modified coagulation/filtration, modified lime softening, electrodialysis reversal, and oxidation/filtration. EPA also listed several technologies that are considered affordable and applicable to typical small drinking water systems (serving less than 10,000 people) which are listed in Table 5. These technologies are: activated alumina (centralized and point-of-use(POU)), coagulation/filtration, coagulation-assisted microfiltration, electrodialysis reversal, enhanced coagulation/filtration, enhanced lime softening, ion exchange, lime softening, oxidation/filtration, and reverse osmosis (centralized and POU). A summary of reported performance of the various technologies from the literature is shown in Table 6. Table 7 summarizes many of the advantages and disadvantages of each of the technologies.

### **2.5.1 Enhanced Coagulation/Filtration and Coagulation/Microfiltration**

Coagulation/filtration is a commonly-used treatment process for removing turbidity in the form of suspended and dissolved solids from surface waters. Many of the systems using this process tend to be larger surface water systems; however, there are some small groundwater coagulation/filtration plants (~8% of small groundwater systems). When the lower arsenic MCL takes effect, it is anticipated that most of these systems with treatment in place will attempt to meet the new standard through modification of existing treatment, resulting in the least cost alternative for these facilities. Enhanced coagulation involves modification to the conventional coagulation/filtration process either by increasing the coagulant dosage, reducing the pH, or both to increase arsenic removal. A typical process diagram using coagulation/filtration can be seen in Figure 5. Coagulation/microfiltration involves replacing the conventional gravity filter with a microfiltration membrane separation process to increase sorbed arsenic removal.

In most water treatment literature coagulation is an all-encompassing term referring to the chemical and physical processes bringing about aggregation of particles in water treatment. The aggregation forms flocs which can then be removed by sedimentation and filtration. A typical coagulation/filtration treatment train has four steps: (1)chemical coagulant addition – rapid mixing unit where chemical dispersal and particle destabilization take place, (2)flocculation – slow mixing units where interparticle collisions take place and the particles agglomerate, (3)sedimentation, and (4)filtration. The most common coagulants used in the drinking water industry are alum and iron (III) salts. In addition to its typical use for removing turbidity causing particles from water,

the process can also remove dissolved inorganics such as arsenic by mechanisms discussed below (U.S. EPA, 2000b).

The primary removal mechanisms for arsenic during coagulation/filtration are adsorption, precipitation, and coprecipitation or occlusion in the precipitated solids (Edwards, 1994; Ferguson and Anderson, 1974; U.S. EPA, 2000b). Adsorption refers to the formation of surface complexes between soluble arsenic and the amorphous metal hydroxide solid. Precipitation refers to the insolubilization of the arsenic by exceeding a solubility product, which is either  $\text{Fe}(\text{AsO}_4)$  or  $\text{Al}(\text{AsO}_4)$  solids. Coprecipitation incorporates the soluble arsenic into a growing hydroxide phase (Edwards, 1994). At high coagulant dosages, adsorption of inorganic contaminants (arsenic) to precipitated metal hydroxide solids is likely to be the predominant mechanism for contaminant removal (Hering *et al.*, 1996).

Removal efficiency of arsenic is a function of the oxidation state of arsenic, the type of coagulant and its dosage, the pH of the water, and the initial arsenic concentration (Sorg and Logsdon, 1978). However, other researchers have concluded that the initial concentration is not a factor in arsenic removal efficiency at levels typically encountered in drinking water treatment (Hering *et al.*, 1997). This lack of dependence on initial concentration is explained by the adsorption behavior of arsenic to the surface of the freshly precipitated and unsaturated metal hydroxide. Temperature and competing anions such as sulfate and natural organic matter (NOM) also affect arsenic removal (McNeill and Edwards, 1997a). As with several of the treatment technologies used for arsenic removal, arsenic in the +V oxidation state is much more efficiently removed by coagulation. Cheng *et al.* (1994) described three important points in comparing alum and

ferric chloride ( $\text{FeCl}_3$ ) arsenic removal from bench and pilot-scale data: (1)  $\text{FeCl}_3$  is more effective than alum; (2) alum is pH-dependent, and the highest As(V) removals are achieved at  $\text{pH} < 7.0$ ; and (3)  $\text{FeCl}_3$  coagulation is not pH-dependent between 5.5 and 7.0, but increasing coagulant dosage will increase As(V) removal. The better removal by the ferric chloride as compared to the alum is thought to be because of better removal of  $\text{Fe}(\text{OH})_3$  flocs versus  $\text{Al}(\text{OH})_3$  flocs during filtration (McNeill and Edwards, 1997a) and incomplete precipitation of added aluminum as the amorphous hydroxide solid. Removal percentages are better for ferric chloride compared to alum only on a weight basis (mg/L) and are said to be equal to alum on a molar basis at  $\text{pH} < 7.5$  (Edwards, 1994).

McNeill and Edwards (1997a) developed a hierarchy to improve arsenic removal at coagulation/filtration facilities not meeting the MCL. The hierarchy is as follows: (1) oxidize any As(III) in the raw water to As(V) (potassium permanganate addition and chlorination have been shown to be successful and ozonation and hydrogen peroxide may be effective pending further study); (2) for alum plants, minimize residual soluble Al by increasing the precipitation of  $\text{Al}(\text{OH})_3$  which sorbs the arsenic; and (3) increase the coagulant dosage or consider changing coagulant type.

McNeill and Edwards (1997a) also developed a model to predict the As(V) removal efficiency of coagulation/filtration plants. The model is similar to a Langmuir isotherm and is independent of As(V) concentration. For plants using ferric chloride as a coagulant the following equation applies:

$$\text{As(V) removed (\%)} = 100 \cdot \frac{78 \cdot \left( \text{FeCl}_3 \text{ dosage in } \frac{\text{mg}}{\text{L}} \right) \cdot \left( \frac{\text{mmoles Fe}}{162.5 \text{ mg FeCl}_3} \right)}{1 + 78 \cdot \left( \text{FeCl}_3 \text{ dosage in } \frac{\text{mg}}{\text{L}} \right) \cdot \left( \frac{\text{mmoles Fe}}{162.5 \text{ mg FeCl}_3} \right)} \quad \text{Equation 1}$$

The following example calculation illustrates the use of the above equation:

*Given:* Ferric chloride coagulation plant

FeCl<sub>3</sub> dose = 10 mg/L

Influent As = 30 µg/L

*Required:* Effluent arsenic concentration

$$\text{Solution:} \quad \text{As(V) removed (\%)} = 100 \cdot \frac{78 \cdot \left( 10 \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{162.5 \text{ mg FeCl}_3} \right)}{1 + 78 \cdot \left( 10 \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{162.5 \text{ mg FeCl}_3} \right)}$$

As removed (%) = 82.8%

Effluent As = Influent As × (1 - 0.828)

Effluent As = 30 µg/L × (1 - 0.828)

Effluent As = 5.16 µg/L

At plants using alum as the coagulant, the following equation applies which also takes into account arsenic sorbed onto particulate iron in the source water:

$$\text{As(V) removed (\%)} = 100 \cdot \frac{\left[ 78 \cdot \left( \text{particulate Fe } \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{56 \text{ mg Fe}} + \text{alum dose } \frac{\text{mg}}{\text{L}} \cdot \frac{2 \text{ mmoles Al}}{660 \text{ mg alum}} \right) \right]}{\left[ 1 + 78 \cdot \left( \text{particulate Fe } \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{56 \text{ mg Fe}} + \text{alum dose } \frac{\text{mg}}{\text{L}} \cdot \frac{2 \text{ mmoles Al}}{660 \text{ mg alum}} \right) \right]} \quad \text{Equation 2}$$

The following example calculation illustrates the use of the above equation:

*Given:* Alum coagulation plant

Influent particulate Fe = 0.6 mg/L

Alum dose = 30 mg/L

Influent As = 30 µg/L

*Required:* Effluent As

*Solution:*

$$\text{As(V) removed (\%)} = 100 \cdot \frac{\left[ 78 \cdot \left( 0.6 \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{56 \text{ mg Fe}} + 30 \frac{\text{mg}}{\text{L}} \cdot \frac{2 \text{ mmoles Al}}{660 \text{ mg alum}} \right) \right]}{\left[ 1 + 78 \cdot \left( 0.6 \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{56 \text{ mg Fe}} + 30 \frac{\text{mg}}{\text{L}} \cdot \frac{2 \text{ mmoles Al}}{660 \text{ mg alum}} \right) \right]}$$

As removed (%) = 88.8%

Effluent As = Influent As × (1 - 0.888)

Effluent As = 30 µg/L × (1 - 0.888)

Effluent As = 3.36 µg/L

The models defined in Equations 1 and 2 predict arsenic removal to within ±13% (90% confidence) for iron coagulation at pH 6.5-8.0 and alum coagulation at pH < 7.6 if all possible sources of particulate iron and aluminum hydroxide present in the system are accounted for. The adsorption rate constant or, “K” value, given above as 78 mM<sup>-1</sup>, is an average value derived from best fit of the data for a number of utilities and is meant to be used only to calculate an estimate of arsenic removal (McNeill and Edwards 1997a). A

better prediction of arsenic removal could be achieved if a utility were to derive an individual “K” value from their raw water quality and plant conditions.

Coagulation assisted microfiltration is a process that is presently being researched as an arsenic removal technology. The process is essentially the same as the conventional coagulation/filtration scheme except that the standard gravity filter is replaced by a microfiltration membrane process. The microfiltration process gives the added advantage of being able to remove much smaller flocs and particles than the conventional gravity filter, thus increasing the removal of arsenic sorbed flocs. It also can give the secondary advantage of acting as a barrier to microorganisms and increasing total plant capacity (U.S. EPA, 1999). Utilities that have existing coagulation/filtration treatment and are unable to use higher coagulant dosages may be able to use microfiltration to increase the removal of total arsenic by increasing the removal of particulate arsenic. Systems that have removed between 53 and 92% arsenic using conventional coagulation/filtration, have been able to remove more than 97% using microfiltration (Frey *et al.*, 1998). Plans are currently underway to construct a 2.3 MGD facility using coagulation/microfiltration processes for arsenic removal from groundwater at Albuquerque, N.M. Albuquerque’s raw water arsenic ranges from  $< 2 \mu\text{g/L}$  to  $> 50 \mu\text{g/L}$ , and based on data from pilot testing of the water, will be able to reduce the arsenic concentrations to  $< 2 \mu\text{g/L}$  (Chwirka *et al.*, 2000).

There are a number of studies in the literature on the removal of arsenic by coagulation/filtration of source waters. Bench-scale tests by Hering *et al.* (1997) achieved close to or better than 80% removal over the pH ranges of 4.0 to 8.0 with ferric chloride (4.9 mg/L  $\text{FeCl}_3$ ) and pH ranges of 6.0 to 8.0 with alum [40 mg/L

$\text{Al}_2(\text{SO}_4)_3 \cdot 18\text{H}_2\text{O}$ ]. Scott *et al.* (1995) studied a full-scale conventional coagulation plant and found that a dose of 3-10 mg/L of ferric chloride achieved removals of 81-96% and doses of 6-20 mg/L of alum achieved removals of 23-71%. Ferric coagulation reduced the levels from 1.6  $\mu\text{g/L}$  in the influent to 0.07-0.32  $\mu\text{g/L}$  in the filtered effluent. Alum coagulation reduced the levels from 2.15  $\mu\text{g/L}$  to 0.66-1.65  $\mu\text{g/L}$ . McNeill and Edwards (1995) study of full-scale alum coagulation plants showed very low removal percentages (<50%) with dosages of 10 mg/L alum. This study of alum coagulation provided a possible explanation for the poor removal efficiencies in that either there was an inadequate amount of particulate aluminum present for arsenic sorption or, the aluminum flocs with sorbed arsenic were too small to be removed by filtration. The EPA (2000b) studied two existing full-scale conventional coagulation/filtration plants and found that they could consistently achieve low levels (< 5  $\mu\text{g/L}$ ) of arsenic in finished water. Average removal percentages found were 52% (reduction in As concentration from 7.5  $\mu\text{g/L}$  to 3.5  $\mu\text{g/L}$ ) and 79% (reduction in As concentration from 19.1  $\mu\text{g/L}$  to 4.0  $\mu\text{g/L}$ ). A prevailing theme throughout much of the coagulation/filtration literature is that efficient filter performance is necessary for high arsenic removal. Increased arsenic concentrations can occur in the finished water due to breakthrough of colloidal particles, with which arsenic may be associated, if filtration is not operating efficiently (Hering *et al.*, 1996).

### **2.5.2 Enhanced Lime Softening**

Lime softening is a process commonly used in the drinking water industry for reducing hardness in source waters. Hardness in water can primarily be attributed to



calcium ( $\text{Ca}^{2+}$ ) and magnesium ( $\text{Mg}^{2+}$ ) ions. Addition of lime to the source water provides a hydroxide ion which increases the pH and results in the precipitation of calcium carbonate,  $\text{CaCO}_3$ , and magnesium hydroxide,  $\text{Mg}(\text{OH})_2$ . The process can also remove arsenic from the source water if operated under ideal or “enhanced” conditions. Enhanced lime softening is defined as softening to  $\text{pH} > 10.5$  and causing  $\text{Mg}(\text{OH})_2$  precipitation (McNeill and Edwards, 1995). Typical lime softening plants consist of rapid mix, flocculation, sedimentation, and filtration units. A typical lime softening process diagram can be seen in Figure 6.

The primary mechanism for removal of As(V) during lime softening is coprecipitation with the  $\text{Mg}(\text{OH})_2$  (U.S. EPA, 2000b). Arsenic removal efficiencies with a pH high enough to precipitate magnesium hydroxide can be as high as 90%, while efficiencies with only calcium carbonate precipitation can be as low as 0-10% (McNeill and Edwards, 1995). Removal efficiencies are highly dependent upon pH and the valence state of the arsenic. Efficiencies increase with increasing pH, with an optimum pH at 10.5 and above (Sorg and Logsdon, 1978). As is the case with other treatment technologies, As(V) is more efficiently removed with lime softening than As(III), therefore if As(III) is present at high levels, preoxidation will be required.

McNeill and Edwards (1997b) developed a hierarchy for existing lime softening plants which are unable to meet the arsenic MCL. Three options were presented: (1) if arsenite is present, then oxidize to arsenate (this can be accomplished with permanganate or chlorination as discussed previously); (2) utilities which are currently precipitating only calcium carbonate can add a small amount of iron and dramatically increase arsenic

removal; and (3) raise the pH to precipitate magnesium hydroxide which will increase arsenate removal.

McNeill and Edwards (1997b) also developed a predictive model which accounts for the role of multiple solids [ $\text{CaCO}_3$ ,  $\text{Mg}(\text{OH})_2$ , and  $\text{Fe}(\text{OH})_3$ ] in arsenate removal during softening. The following equation, which includes dissolved arsenate as the only unknown, can be used to find the soluble arsenate concentration at a utility:

$$\text{As}_{\text{sol}} = \left[ \frac{\text{As}_{\text{tot}}}{1 + (\text{K}_{\text{CaCO}_3} \cdot \text{Ca}_{\text{ppt}}) + (\text{K}_{\text{Mg}(\text{OH})_2} \cdot \text{Mg}_{\text{ppt}}) + (\text{K}_{\text{Fe}(\text{OH})_3} \cdot \text{Fe}_{\text{ppt}})} \right] \quad \text{Equation 3}$$

where:

$$\begin{aligned} \text{As}_{\text{sol}} &= \text{Soluble arsenate concentration } (\mu\text{g/L}) \\ \text{As}_{\text{tot}} &= \text{Influent arsenate concentration, equal to } \text{As}_{\text{sol}} + \text{As}_{\text{adsorbed}} \text{ } (\mu\text{g/L}) \\ \text{K}_{\text{CaCO}_3}, \text{K}_{\text{Mg}(\text{OH})_2}, \text{K}_{\text{Fe}(\text{OH})_3} &= \text{Sorption equilibrium constants determined in lab experiments } [(\text{mg/L})^{-1}] \\ \text{Ca}_{\text{ppt}}, \text{Mg}_{\text{ppt}}, \text{Fe}_{\text{ppt}} &= \text{Measured amounts of precipitates as calcium carbonate, magnesium hydroxide, and ferric hydroxide (mg/L as } \text{Ca}^{+2}, \text{Mg}^{+2}, \text{ or } \text{Fe}^{+3}) \end{aligned}$$

Percent removal can then be easily calculated given the total influent arsenate concentration. Individual adsorption constants were not given in the McNeill and Edwards paper, and thus must be determined in the lab for each source water that is to be studied.

A number of pilot-plant and full-scale studies have been conducted on lime softening plants to determine their feasibility for arsenic removal. The EPA (2000b) conducted a long-term study of a full-scale lime softening plant and found that it was only able to achieve 45% removal of total arsenic (reduction from 32.0  $\mu\text{g/L}$  to 16.6  $\mu\text{g/L}$ ). However, the suspected cause of the inefficient removal was that the plant was

operating at a pH of 9.6, which wasn't high enough to precipitate magnesium hydroxide. Sorg and Logsdon's 1978 study of a lime softening pilot-plant showed nearly 100% removal of As(V) at levels of 400 µg/L and at a pH of 10.5 and above. McNeill and Edwards (1995) study of full-scale plants found that removal efficiencies of up to 90% could be obtained with magnesium hydroxide precipitation.

### **2.5.3 Iron Removal**

Iron and manganese removal is a longstanding and generally reliable treatment process. The process consists of oxidation of iron and manganese in order to form a precipitate which can be removed by filtration. Iron and manganese can cause aesthetic problems with drinking waters at levels approximately at or above 0.3 mg/L for iron and 0.05 mg/L for manganese. The aesthetic problems may include colored water, turbidity, staining of laundry and bathroom fixtures, and astringent tastes. The conventional removal scheme consists of aeration, oxidant addition, sedimentation or detention, filtration and possibly other chemical additions (Robinson, 2000). A typical iron and manganese removal process diagram can be seen in Figure 7.

Arsenic removal can be accomplished along with iron and manganese removal. Two primary removal mechanisms are thought to control the removal of arsenic using iron removal: adsorption and coprecipitation. Several steps have been documented in the removal of arsenic using iron removal processes (U.S. EPA, 2000d) as follows: (1) the reduced iron, Fe(II) is oxidized to the relatively insoluble Fe(III) and any As(III) present is oxidized to As(V); (2) the As(V) attaches to the iron hydroxides through adsorption and/or coprecipitation; and (3) the precipitate is filtered from the water by rapid sand

filters or pressure filters. When the raw water contains As(III), sufficient contact time needs to be provided to convert the As(III) to As(V) for removal by the oxidation/filtration process. An additional preoxidation step is not required for this process as long as there is sufficient contact time (U.S. EPA, 2001b). However, it must be recognized that the oxidation kinetics of aeration for As(III) oxidation are very slow and it is recommended that an oxidant be added when As(III) is the primary species in the water.

Edwards (1994) described the removal of arsenic using iron removal process as being analogous to the coagulation process. The production of Fe-Mn species and subsequent precipitation of hydroxides in Fe-Mn removal processes are analogous to an in situ coagulant addition, with the quantity of Fe or Mn removed being the “coagulant dosage.” McNeill and Edwards (1997a) developed a model predicting arsenic removal during metal hydroxide precipitation based on the feedwater iron and aluminum concentrations which is applicable to iron removal processes as well as the coagulation process described earlier. The model is essentially the same as presented earlier for enhanced coagulation/filtration, assuming there is very little aluminum in the raw water, and is described as follows:

$$\text{As(V) removed (\%)} = 100 \cdot \frac{\left[ 78 \cdot \left( \text{particulate Fe formed in } \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{56 \text{ mg Fe}} \right) \right]}{\left[ 1 + 78 \cdot \left( \text{particulate Fe formed in } \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{56 \text{ mg Fe}} \right) \right]} \quad \text{Equation 4}$$

The following example calculation illustrates the use of the above equation:

*Given:* Iron removal plant

Particulate Fe formed after oxidation = 0.6 mg/L

Influent As = 30 µg/L

*Required:* Effluent As

*Solution:*

$$\text{As(V) removed (\%)} = 100 \cdot \frac{\left[ 78 \cdot \left( 0.6 \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{56 \text{ mg Fe}} \right) \right]}{\left[ 1 + 78 \cdot \left( 0.6 \frac{\text{mg}}{\text{L}} \cdot \frac{\text{mmoles Fe}}{56 \text{ mg Fe}} \right) \right]}$$

As removed (%) = 45.5%

Effluent As = Influent As × (1 - 0.455)

Effluent As = 30 µg/L × (1 - 0.455)

Effluent As = 16.4 µg/L

The model can predict arsenic removal to within ±13% (90% confidence) if all possible sources of particulate iron and aluminum hydroxide present in the system are accounted for. The adsorption rate constant or, “K” value, given above as 78 mM<sup>-1</sup>, is an average value derived from best fit of the data for a number of utilities and is meant to be used only to calculate an estimate of arsenic removal (McNeill and Edwards, 1997a). A better prediction of arsenic removal could be achieved if a utility were to derive an individual “K” value from their raw water quality and plant conditions.

EPA (2001b) listed oxidation/filtration as a BAT with a footnote that the iron-to-arsenic ratio must be at least 20:1. For the process to be efficient, the source water must have high iron content (in developing national cost estimates, EPA assumed that only systems with  $> 300 \mu\text{g/L}$  of iron would opt for this technology). If iron is not present at high levels, the oxidation and subsequent filtration of the feedwater is unlikely to remove sufficient arsenic (U.S. EPA, 2000d). For these reasons, it is assumed that systems using this technology for removal of arsenic will be those that have an existing treatment facility in place for iron removal, typically groundwater systems, and which don't require a high removal efficiency for arsenic.

Studies conducted by the EPA (2000e) of two existing full-scale iron removal plants showed varied results in the ability of the iron removal process to consistently achieve arsenic concentrations  $< 5 \mu\text{g/L}$ . Average arsenic removal efficiencies at the two plants were 87% (reduction from  $20.3 \mu\text{g/L}$  to  $3.0 \mu\text{g/L}$ ) and 74% (reduction from  $48.5 \mu\text{g/L}$  to  $11.9 \mu\text{g/L}$ ) respectively. The lower arsenic removal efficiency was thought to be the result of lower iron levels ( $1,137 \mu\text{g/L}$  versus  $2,284 \mu\text{g/L}$ ) in the source water.

McNeill and Edwards (1995), using data obtained from full-scale iron and manganese removal plants, found that oxidation of Fe(II) resulted in 80-95% arsenic removal, when the Fe(II) in the feedwater was greater than  $1.5 \text{ mg/L}$ . They also found that plants which oxidize only Mn(II) did not remove significant concentrations of arsenic. Therefore they concluded that As(V) removal efficiency was controlled by Fe(II) oxidation and  $\text{Fe}(\text{OH})_3$  precipitation and not Mn(II) oxidation and manganese hydroxide precipitation.


#### **2.5.4 Ion Exchange**

The process of ion exchange is most often defined as the reversible exchange of ions between a solid and a liquid in which there is no substantial change in the structure of the solid. In ion exchangers used for treating drinking water, the liquid is the feedwater and the solid is typically a synthetic ion exchange resin which is used to preferentially remove certain contaminants of concern. The process is most widely used in drinking water treatment to soften water by exchanging calcium and magnesium ions for sodium ions. Ion exchange is also widely used to remove metals from industrial wastewater effluents (Wachinski and Etzel, 1997). A typical process diagram for ion exchange treatment can be seen in Figure 8.

Anion exchange resins come in two classes, strong base anion (SBA) and weak base anion (WBA). The most common SBA resins have quarternary ammonium functional groups ( $-\text{CH}_2\text{N}(\text{CH}_3)_3\text{Cl}$ ) which are strongly basic and ionized to act as ion exchangers over the pH range of 0 to 13. WBA resins are useful only in the acidic pH range. SBA and WBA resins may be present in the hydroxide or the chloride form. SBA resins in the chloride form are typically used for arsenic removal because they tend to be more effective over a wider pH range. Synthetic resins are available in bead form and range in size from 20 mesh (0.84 mm in diameter) to 325 mesh (0.044 mm in diameter). Most ion exchange applications in water and wastewater are accomplished with resins in the 20 to 50-mesh size range (Wachinski and Etzel, 1997).

Ion exchange doesn't remove As(III) because As(III) occurs predominantly as an uncharged ion ( $\text{H}_3\text{AsO}_3$ ) in water with a pH value of less than 9.0. However, the predominant species of As(V) at  $\text{pH} > 3.0$  are negatively charged ( $\text{H}_2\text{AsO}_4^-$ ,  $\text{HAsO}_4^{2-}$ , and

AsO<sub>4</sub><sup>3-</sup>), and thus can be removed by ion exchange. Arsenate and several other anions are preferentially removed according to the order of preference for exchange by the resin (U.S. EPA, 2000f). The general selectivity sequence for the preferential removal of major ions by ion exchange is given by Chwirka *et al.* (2000) and is reported as:




From the selectivity sequence for ion exchange resins, it can be seen that the process prefers sulfate to arsenic. This reveals the major problem with using ion exchange for removing arsenic from solution. The efficiency of the process is strongly affected by competing ions like total dissolved solids and sulfate. When the sulfate level is high in the feedwater, sulfate may displace previously sorbed ions (such as arsenate) from a resin bed, thereby causing higher arsenic concentrations in the finished water than in the feedwater. This is referred to as chromatographic peaking (dumping) and can be a risky situation where toxic ions like arsenic are involved (U.S. EPA, 2000f). To avoid this, the resin must be monitored and regenerated prior to the onset of peaking. Generally, the ion exchange process is not considered economically attractive if the feedwater contains high TDS (>500 mg/L) and sulfate (>150 mg/L) due to the frequency of resin regeneration required (Clifford, 1999). Clifford, as reported by EPA (2001a), estimated the bed volumes to 10% and 50% breakthrough of influent arsenic as a function of influent sulfate concentration. Figure 9 shows the relationship between sulfate



concentrations and bed volumes to breakthrough. EPA (2000d) recommends ion exchange as a BAT primarily for small, groundwater systems with low sulfate and TDS, and as a polishing step after filtration.

Wachinski and Etzel (1997) summarized the ion exchange process in four general steps: backwash, regeneration or brining, rinse, and service. The service step of the column is the operational mode of the system. The feedwater is passed downflow through a chloride-form SBA resin, and the chloride and arsenate exchange takes place according to the following reaction:




The end of the run is when a predetermined concentration of arsenic is reached in the effluent from the column. This is referred to as breakthrough. The column can then be taken off line to regenerate the resin before putting it back into service.

The backwash step involves the introduction of water in a countercurrent flow to the column at a rate sufficient to expand the bed by 50 – 75%. Its purpose is to remove accumulated silt, dirt, iron, etc., from the resin and to reorient and redistribute the resin beads.

Following backwash, the ion exchange resin can be regenerated by returning it to the chloride form and removing the contaminant anion. This step is usually accomplished by using a 3 – 12% sodium chloride solution for chloride form resins, with the result being essentially complete elution of arsenic from the spent resin at steady state operation (Clifford, 1999). The equation for regeneration of the SBA resin, in principle

the reverse of the previous equation except that a high chloride concentration is required to reverse the reaction, and is given by Clifford (1999) as the following:



Following the above equation, Clifford indicates that regeneration isn't difficult because the divalent ion arsenate is being replaced by the monovalent ion chloride in high ionic strength solution where electronegativity favors monovalent ion uptake by the resin. Countercurrent, upflow regeneration is usually practiced to minimize the contaminant leakage from the column. Leakage is the appearance of a low concentration of the contaminant ion in the column effluent initially after returning the bed to service. Such leakage isn't due to influent ions coming through the column without being exchanged, rather, it is due to residual ions in the resin at the bottom of the column as a result of incomplete regeneration (Anderson, 1975). However, Clifford (1999), found in an Albuquerque, N.M. field study that cocurrent regeneration performed better (it gave a lower arsenic leakage during subsequent exhaustions), thus making it unnecessary to use countercurrent (or upflow) regeneration to minimize arsenic leakage. Clifford explains that the reason for this was because, at exhaustion, most of the arsenic on the resin is concentrated in a thin zone near the column outlet. Thus results show that it is preferable to elute the arsenic by the shortest path as opposed to flushing it back through the entire resin bed, where some could possibly remain during upflow regeneration. Although Clifford doesn't explicitly say so, it is assumed that the more preferred anions such as sulfate are displacing the previously adsorbed arsenate higher in the column, thus

creating the thin zone near the column outlet. The brine used for regeneration can be recycled several times (at least 20 times and possibly more) prior to disposal with no loss of effectiveness, which gives the advantage of reducing volume of wastewater produced and reducing the volume of salt used for regeneration (Chwirka *et al.*, 2000; Clifford, 1999).

After regeneration and prior to putting the column back into service, rinsing should be performed. The rinse step will remove any excess regenerant from the system (Wachinski and Etzel, 1997).

Pretreatment of the feedwater prior to the ion exchange unit should be considered under certain conditions. If high particulate iron concentrations are found in the feedwater, prefiltration should be used to prevent serious leakage of arsenic. Particulate iron will strongly adsorb As(V) and prevent ion exchange by the resin (Clifford, 1999). Also, high suspended solids in the feedwater can cause clogging of the ion exchange bed and would need to be removed by prefiltration. If analysis of the feedwater indicates that arsenic is present in the +III state, preoxidation by chlorination or other means will be required to convert to the +V state. Organic substances in the feedwater can foul the resin and decrease its capacity for arsenic removal. Such organic material must be removed by pretreatment with activated carbon or other techniques (Wachinski and Etzel, 1997).

An important parameter to determine the feasibility of using the ion exchange process for arsenic removal is to determine the number of bed volumes (BV) which can be treated prior to arsenic breakthrough (a sharp rise in the arsenic concentration of the effluent). Bed volume is defined by the equation below:

$$BV = \frac{V_B}{V} \quad \text{Equation 8}$$

where:

$$\begin{aligned} BV &= \text{number of bed volumes treated} \\ V_B &= \text{the volume of water treated, ft}^3 \\ V &= \text{the bulk volume of resin or media in the contactor, ft}^3 \end{aligned}$$

Chen *et al.* (1999) reported an estimation of the bed volumes treated before 10% arsenic breakthrough with anion exchange based on the influent sulfate levels as given in the equations below:

$$BV_{AX} = -606 \cdot \ln(C_{SO_4}) + 3,150 \quad \text{for } SO_4^{2-} < 120 \text{ mg/L} \quad \text{Equation 9}$$

$$BV_{AX} = -200 \cdot \ln(C_{SO_4}) + 1,250 \quad \text{for } SO_4^{2-} > 120 \text{ mg/L} \quad \text{Equation 10}$$

where:

$$\begin{aligned} BV_{AX} &= \text{number of bed volumes treated using anion exchange} \\ &\quad \text{before 10\% As breakthrough} \\ (C_{SO_4}) &= \text{initial sulfate concentration, mg/L} \end{aligned}$$

These equations were developed using best-fit trendlines to model predictions.

The following example calculation illustrates the use of the above equations:

*Given:* Anion exchange plant

Influent  $SO_4^{2-} = 30 \text{ mg/L}$

Influent As = 30  $\mu\text{g/L}$

*Required:* The number of bed volumes treated before 10% breakthrough of arsenic

*Solution:*  $BV_{AX} = -606 \cdot \ln(C_{SO_4}) + 3,150$

$$BV_{AX} = -606 \cdot \ln(30 \text{ mg/L}) + 3,150$$

$$BV_{AX} = 1,090 \text{ Bed Volumes}$$

Clifford (1999) identified nine important factors to consider when designing an ion exchange system for drinking water treatment:

- (1) choice of SBA resin,
- (2) effect of multiple contaminants such as arsenic and nitrate,
- (3) arsenic leakage,
- (4) effect of sulfate concentration,
- (5) optimum empty bed contact time (EBCT),
- (6) regenerant strength (% NaCl),
- (7) regenerant level (lbs NaCl/ft<sup>3</sup> resin),
- (8) spent-brine reuse, and
- (9) spent-brine treatment

Studies conducted by EPA (2000f) of two existing small-scale ion exchange drinking water systems, showed that the process consistently achieved levels of arsenic < 5 µg/L when the resin was properly regenerated. Removal efficiencies in their study were 53% and 97% for arsenic. One plant achieved lower removal efficiencies due to insufficient regeneration and also because of chromatographic peaking due to sulfate competition. Fox and Sorg (1987, 1989) with EPA, studied several POU ion exchange


systems in Alaska and Oregon. The systems were capable of lowering arsenic levels to less than 5 µg/L in a majority of samples, with influent concentrations ranging from 100 to 1,160 µg/L. Pilot-plant tests conducted by Clifford and his coworkers (1999) at McFarland, CA, Hanford, CA, and Albuquerque, NM, showed that ion exchange could treat to a level of 2 µg/L when treating a 10 to 50 µg/L arsenic contaminated groundwater containing up to 220 mg/L sulfate.

### **2.5.5 Activated Alumina**

Activated alumina adsorption is a physical/chemical process by which ions in solution are removed by the available adsorption sites on an oxide surface. Activated alumina is a semicrystalline porous inorganic adsorbent. It has a higher zero-point-of-charge (zpc) ( $\text{pH}_{\text{zpc}}=8.2$ ) than most oxide minerals, thus causing it to have an affinity for many anions in water with near-neutral pH. The adsorption process involves surface complexation and exchange of hydroxide ions ( $\text{OH}^-$ ) for the contaminants (Chwirka *et al.*, 2000). The typical activated alumina used in water treatment processes are 28- X 48-mesh (0.3- to 0.6-mm diameter) mixtures of amorphous and gamma aluminum oxide ( $\gamma\text{-Al}_2\text{O}_3$ ) prepared by low-temperature (300 to 600°C) dehydration of precipitated  $\text{Al}(\text{OH})_3$ . The result is a highly porous material with surface areas of 50 to 300  $\text{m}^2/\text{g}$  (Clifford, 1999). A typical activated alumina process diagram is shown in Figure 10.

This process is considered favorable to ion exchange for arsenic removal primarily because of the selectivity sequence for alumina. Alumina has a very high affinity for arsenic and fluoride ions over other traditional competing ions such as sulfate, carbonate, and chloride in contrast to the selectivity for anion exchange resins. Clifford

(1999) reports the selectivity sequence for activated alumina in the pH range of 5.5 to 8.5 as the following:




Sulfate offers only a very minor competition for sorption sites with activated alumina whereas with ion exchange, it can be a significant problem.

The feedwater pH is more critical to arsenic removal by activated alumina adsorption than any other process. The pH of the feedwater must be sufficiently lower than the  $\text{pH}_{\text{zpc}}$  so that the activated alumina media has a high density of positively charged sites (Chwirka *et al.*, 2000). Below this pH, the activated alumina surface has a net positive charge which can be balanced by adsorbing anions like arsenate. Various studies have shown that the optimum pH is in the range of 5.5 to 6.0, with optimum being closer to 6.0, for arsenic removal (U.S. EPA, 2000f; Clifford, 1999; Fox, 1989).


Clifford (1999) proposed that a model for process design of activated alumina is analogous to a weak base anion exchange resin, which only operates effectively in the acidic pH range. First, the alumina surface must be protonated to begin the removal of  $\text{H}_2\text{AsO}_4^-$  from solution. This is accomplished by preacidification with HCl or  $\text{H}_2\text{SO}_4$  and reducing the feedwater pH into the 5.5-6.0 region. The step of alumina acidification can be written as the following where again the bar indicates a solid or surface phase:



The next step is the service of the column in which the HCl-acidified alumina is contacted with the arsenate ions, displacing the chloride ions in a fashion similar to anion exchange. This step can be written as follows:



Once the sorptive capacity of the alumina has been reached, the media must be regenerated. This can be accomplished by using a solution of NaOH (up to 4% may be required) which displaces the arsenate from the alumina as follows:



To restore the arsenic removal capacity to the alumina, the media must then be acidified again by contacting it with 0.5 N HCl or H<sub>2</sub>SO<sub>4</sub> as discussed above.

With the benefit of the high selectivity for arsenic of the activated alumina, there is a drawback in that the anions are very difficult to remove from the media during regeneration. Due to this, typically only 75% of the adsorbed arsenic is recovered from the alumina during regeneration, which results in deterioration of adsorptive capacity over time (Clifford, 1999).

As with ion exchange, activated alumina is considerably more effective at removing As(V) than As(III). Therefore, if As(III) is found to be present in the feedwater, prechlorination or some other means of oxidation prior to the alumina column



will be necessary. Prefiltration will also be necessary to prevent clogging and fouling of the media by suspended solids and particulate iron in the feedwater if their levels are significantly high.

Factors listed by Clifford (1999), Frey *et al.* (1998), and U.S. EPA (2000f) which significantly affect the design process for activated alumina arsenic removal are:

- (1) arsenic species in feedwater,
- (2) pH of feedwater,
- (3) competing anions,
- (4) empty bed contact time (EBCT),
- (5) regeneration or throw-away of media,
- (6) concentration of arsenic in feedwater (higher concentrations lead to shorter run length), and
- (7) alumina particle size (finer particles of alumina have higher arsenic capacity, lower arsenic leakage, and longer run length than larger particles).

Activated alumina processes have much longer run times (time between regenerations of media) for arsenic removal than do ion exchange processes, thus making the process amenable to use on a media throw-away basis. Operating in this fashion would prevent small plant operators from having to use hazardous chemicals such as sodium hydroxide and sulfuric acid to regenerate the media. An important parameter to determine the feasibility of using activated alumina for arsenic removal is to determine the number of bed volumes which can be treated prior to arsenic breakthrough. Chen *et al.* (1999) reported an estimation of the bed volumes treated before 10% arsenic

breakthrough with activated alumina. Unlike the ion exchange model given previously where run lengths were affected by influent sulfate levels, the activated alumina model is based primarily on influent arsenic concentrations as given in the equation below:

$$BV_{AA} = 2.1 \times 10^5 \cdot (As)^{-0.57} \quad \text{Equation 15}$$

where:

$BV_{AA}$  = number of bed volumes treated using activated alumina before 10% As breakthrough

(As) = initial arsenic concentration in  $\mu\text{g/L}$

This equation was also developed using best-fit trendlines to model predictions.

The following example calculation illustrates the use of the above equations:

*Given:* AA adsorption plant

Influent As =  $30 \mu\text{g/L}$

*Required:* The number of bed volumes treated before 10% breakthrough of arsenic

*Solution:*  $BV_{AA} = 2.1 \times 10^5 \cdot (As)^{-0.57}$

$BV_{AA} = 2.1 \times 10^5 \cdot (30 \mu\text{g/L})^{-0.57}$

$BV_{AA} = 30,200$  bed volumes

Activated alumina has effectively removed arsenic in pilot studies and in POU applications (Frey *et al.*, 1998). Studies by the EPA (2000f) of existing small-scale

alumina facilities in the New England area showed that the process was capable of treating to levels of 5 µg/L or less with influent concentrations from 34 to 87 µg/L arsenic. Average arsenic removal efficiencies for these plants were 87% and 98%. Sorg and Logsdon (1978) cited alumina studies done by Bellack in 1970, which showed a decrease in arsenic from 60 µg/L to 3 µg/L, and by Rubel and Alcoa Laboratories in 1977 which showed a decrease in arsenic from 1,000 µg/L to below 5 µg/L. Pilot-plant studies by Hathaway and Rubel (1987) found extended runs (8542 bed volumes of treated water) were possible with activated alumina and pH adjustment to 5.5. Effluent concentrations of arsenic were reduced from a range of 80-116 µg/L to less than 5 µg/L. Fox and Sorg (1987) and Fox (1989) found using POU devices in Alaska and Oregon, that activated alumina was capable of reducing arsenic concentrations from a range of 50-1,160 µg/L in the feedwater to effluent levels below 5 µg/L.

#### **2.5.6 Membrane Separation Processes**

Membrane processes can be defined as technologies that use a barrier to the flow of suspended, colloidal, or dissolved species in any solvent. Membrane processes with the greatest immediate application to potable water treatment are reverse osmosis (RO), nanofiltration (NF), electrodialysis reversal (EDR), ultrafiltration (UF), and microfiltration (MF) (Taylor and Wiesner, 1999). These processes are grouped according to their pore sizes and particle removal ranges as depicted in Figure 11. From the figure it is evident that RO, EDR, and NF technologies should be able to remove contaminants in the ionic range such as arsenic. The EPA (2000d) lists only reverse osmosis and electrodialysis reversal as BATs in their proposed regulation for the new arsenic MCL.

NF was not included as a BAT because, when operated at realistic recoveries, the removal efficiency of arsenic is low. EDR was also not thought to be as competitive with RO on costs and removal efficiencies (U.S. EPA, 2000d). Therefore the focus of this section will be on RO membranes with some discussion of EDR processes. A typical process diagram using membrane filtration is shown in Figure 12.

Membrane processes are generally classified according to the driving force used to transport the contaminants from solution. The driving forces can include pressure, concentration, electrical potential, and temperature. RO and NF membranes are pressure driven processes requiring a certain amount of pressure to transport the feedwater across the membrane. Of the membranes mentioned earlier, RO have the smallest minimum pore size thus requiring the greatest amount of driving pressure and also resulting in the least recovery. Solute mass transport is said to be diffusion and size exclusion controlled in RO and NF, unlike MF and UF systems which are only controlled by size exclusion (Taylor and Wiesner, 1999). Typical pressure ranges for NF membranes are 50-150 psi. The typical range for RO membranes is 100-150 psi (U.S. EPA, 1999). An RO membrane rejects solutes as small as  $0.0001\text{ }\mu\text{m}$ , which is in the ionic or molecular size range. An NF membrane rejects solutes as small as  $0.001\text{ }\mu\text{m}$ , which is also in the ionic or molecular size range (Taylor and Wiesner, 1999).

EDR systems are not pressure driven and do not rely on the pore size for contaminant removal. Rather they rely on charge for solute separation from the feedwater. They pass the solute through the membrane rather than the solvent or the feedwater like RO systems. EDR membranes can be considered as porous sheets of ion exchange resin with a relatively low permeability for water (Taylor and Wiesner, 1999).

EDR processes can remove contaminant ions down to atomic sizes. Few tests have been conducted on EDR systems to evaluate their arsenic removal potential. One full-scale EDR plant in Buckeye, AZ installed primarily for the removal of high TDS, showed an average arsenic removal of 69.4% (reduction from 66 to 20 µg/L) (Ionics, Inc., 2000).

There are several terms to be familiar with when evaluating membrane technologies because of their seldom use with regard to other common water treatment technologies. Table 8, portions of which are from Taylor and Wiesner (1999), defines several of the terms frequently used. Two terms commonly used to define membrane effectiveness are recovery and rejection. Recovery is defined as the percentage of feedwater that can be converted to product water and is calculated by the equation below:

$$\text{Recovery (\%)} = 100 \cdot \frac{Q_p}{Q_f} \quad \text{Equation 16}$$

where:

$$\begin{aligned} Q_p &= \text{Product or permeate flow, gpd} \\ Q_f &= \text{Feedwater flow, gpd} \end{aligned}$$

Rejection is defined as the percentage of contaminant removed, which in this case would be arsenic, and can be calculated by the following equation:

$$\text{Rejection (\%)} = 100 \cdot \left( 1 - \frac{C_p}{C_f} \right) \quad \text{Equation 17}$$

where:

$$C_p = \text{Concentration of contaminant in product or permeate water, } \mu\text{g/L}$$

$$C_f = \text{Concentration of contaminant in feedwater, } \mu\text{g/L}$$

Rearranging Equations 14 and 15, one can find the concentration of a pollutant in the permeate,  $C_p$ , given the pollutant rejection and the concentration of the pollutant in the concentrate stream,  $C_c$  with the following equations:

$$C_p = (1 - \text{Rejection})(C_f) \quad \text{Equation 18}$$

where:

$$C_p = \text{Concentration of pollutant in the permeate}$$

$$C_f = \text{Concentration of pollutant in the feed water}$$

$$\text{Rejection} = \text{Decimal fraction rejection of pollutant}$$

$$C_c = \frac{Q_f C_f - Q_p C_p}{Q_c} \quad \text{Equation 19}$$

where:

$$C_c = \text{Concentration of pollutant in concentrate water}$$

$$Q_c = \text{Concentrate water flow}$$

The following example calculation illustrates the use of Equations 14 through 17:

*Given:* Membrane plant producing 1-mgd ( $Q_p$ ) with 75% recovery  
 95% rejection of arsenic  
 Influent As = 30  $\mu\text{g/L}$

*Required:* Concentrate flow

### Arsenic concentrations in permeate and concentrate

*Solution:*

$$Q_c = \frac{Q_p(1 - \text{Recovery})}{\text{Recovery}} = \frac{1 \text{ mgd}(1 - 0.75)}{0.75} = 0.333 \text{ mgd}$$

$$C_p = (1 - \text{Rejection})(C_f) = (1 - 0.95)(30 \mu\text{g/L As}) = 1.5 \mu\text{g/L As}$$

$$C_c = \frac{Q_f C_f - Q_p C_p}{Q_c} = \frac{1.333 \text{ mgd}(30 \mu\text{g/L}) - (1 \text{ mgd})(1.5 \mu\text{g/L})}{0.333 \text{ mgd}} = 116 \mu\text{g/L As}$$

Waypa *et al.* (1997) conducted bench-scale experiments on arsenic removal using RO and NF membranes. They concluded:

- High removal efficiencies of As(III) – comparable to those of As(V) – were obtained using RO and tight NF membranes. This is explained by the relatively large molecular weight of arsenic species (126 g/mole for  $\text{H}_3\text{AsO}_3$  and 140 g/mole for  $\text{HAsO}_4^{2-}$ ) which controls their separation by the membrane and not the charge of the species. Therefore these membranes seem most suitable for As removal from groundwater in which most of the arsenic is in the As(III) form. This also eliminates the need for preoxidation, which is detrimental to the performance of thin-film composite membranes.
- Applied pressure had little effect on arsenic removal, but an increase in feedwater temperature (over the range of 15-30°C) decreased arsenic removal by a small percentage.
- Removal of arsenic by the membranes used was independent of pH (in the range of 4 to 8 that was tested), thus eliminating the need for pH optimization.

- Dissolved co-occurring inorganic solutes did not affect arsenic rejection by RO and NF membranes. Therefore, RO and NF membranes should be effective for a variety of source water qualities. However, the possibility of precipitation of sparingly soluble inorganic salts should be considered at high recoveries.
- Long-term membrane performance and possible deterioration in performance over time because of colloidal and NOM fouling should be considered. Pretreatment of surface water may be needed to prevent fouling. Levels of colloids and NOM are usually low in groundwaters, thus no pretreatment may be required.
- Arsenic rejection may be reduced at high recoveries because of concentration polarization and membrane fouling.

Membrane fouling is an important consideration in the design and operation of a membrane system. Fouling is a reduction in the permeate flux due to the accumulation of materials on, in, or near the membrane. Taylor and Wiesner (1999) identified three fouling mechanisms which act to reduce the flux in membrane processes:

- Concentration polarization: Contaminants rejected by the membrane tend to concentrate at the membrane surface and “back-diffuse” away from the membrane surface thus reducing the flux across the membrane.
- Precipitative fouling: The elevated concentrations of contaminant ions at the surface of RO and NF membranes results in the potential for precipitation of various minerals on the membrane surface, resulting in fouling.
- Clogging by cake (or gel) formation: Solids deposition on the membrane surface can result in formation of a cake and compaction of the membrane that represents an additional mass transfer resistance. Flushing or backwashing the membrane



module is capable of reversing much of this fouling. Gel layers of deposited NOM can also form and are generally more difficult to reverse.

Cleaning frequency, pretreatment requirements, operating conditions, cost, and performance are affected by membrane fouling (Taylor and Wiesner, 1999). The smaller pore size of NF and RO membranes makes them more prone to fouling than UF and MF membranes. The rejection of scale-causing ions like calcium can lead to precipitation on the membrane surface. Organic compounds and metal compounds like iron and manganese can promote fouling. Precipitation must be avoided by appropriate pretreatment including addition of anti-scaling chemical and/or acid to the feedwater (U.S. EPA, 1999).

Estimates of water production and water quality for various parameters when using RO membrane systems can be found by using manufacturer computer programs. Dow-Filmtec, Hydranautics, Fluid System, and TriSep are examples of manufacturers which provide computer programs for the design of RO plants. A number of these can be found and downloaded on the World Wide Web (WWW). Typical input parameters for the programs are feedwater rate, TDS concentration, feed temperature, recovery, array type, number of elements in pressure vessel, and element type. The programs do not give complete designs, however they can serve as a tool for developing and testing various membrane system configurations (Taylor and Wiesner, 1999).

Most conventional RO and NF treatment systems also will include pretreatment and post-treatment units. RO performance can be adversely affected by the presence of turbidity, iron, manganese, silica, scale-producing compounds and other constituents (U.S. EPA, 1999). Pretreatment processes might include antiscalant and/or acid addition,

cartridge microfiltration, GAC filtration, or aeration depending upon the quality of the feedwater. Post-treatment processes that might be used are operations common to drinking water treatment such as disinfection, aeration, and corrosion control (Taylor and Wiesner, 1999).

Several pilot-plant and field tests have been conducted to determine the feasibility of using RO and NF membranes for arsenic removal. EPA funded the installation of 73 RO POU treatment systems in San Ysidro, N.M. in the mid 1980's. Raw water arsenic levels ranged from 68 to 230  $\mu\text{g/L}$ . The RO units were able to reduce the arsenic levels to a range from  $< 5 \mu\text{g/L}$  to 20  $\mu\text{g/L}$  with 20-30% recovery (Fox and Sorg, 1987). The bench-scale experiments conducted by Waypa *et al.* (1997) concluded that 94.5-100% arsenic removal could be achieved with thin-filmed composite RO membranes. Tests on NF membranes by the AWWARF showed high As(V) rejection ( $\sim 95\%$ ) while As(III) rejection averaged only 40% presumably due to the influences of diffusion and electrostatic repulsion (U.S. EPA, 1999). AWWARF pilot-scale tests on RO membranes achieved  $> 95\%$  rejection of As(V) while rejection of As(III) averaged only 74% (U.S. EPA, 1999). The AWWARF studies indicate the importance of preoxidation to As(V) if substantial amounts of As(III) are present in the feedwater.

### **2.5.7 Alternative and Innovative Adsorption Technologies**

There are a number of other technologies discussed in the literature which are currently being investigated for arsenic removal. These include oxidation/greensand filtration, granular ferric hydroxide (GFH), sulfur modified iron (SMI), iron filings, and iron-coated activated alumina. These technologies have shown promise, however more

testing will be required before they can be considered for use in full-scale arsenic removal facilities. Some of these technologies will be discussed briefly in this section. Many of these media adsorption technologies can be grouped together and have a similar process scheme as shown in Figure 13.

Oxidation/greensand filtration is a process commonly used for iron and manganese removal in drinking water treatment. Greensand is a zeolite-type glauconite material which is produced by treating glauconite sand with  $\text{KMnO}_4$  until the sand is coated with a layer of manganese oxides, particularly manganese dioxide (U.S. EPA, 1999). Potassium permanganate is fed either continuously or intermittently to the raw unaerated groundwater. Iron and manganese precipitates coat the greensand. The media has the ability to sorb any soluble iron and manganese and oxidize them on the media. When the exchange capacity is exhausted, the media is regenerated with a solution of excess  $\text{KMnO}_4$  after backwash or when needed. Essentially, the greensand acts as a buffer to remove any iron and manganese not oxidized by the continuous permanganate feed (Robinson, 2000). Mechanisms of arsenic removal by this process include oxidation, ion exchange, and adsorption. Both the  $\text{KMnO}_4$  feed and the oxidative nature of the manganese surface converts the  $\text{As(III)}$  to  $\text{As(V)}$ . The  $\text{As(V)}$  can either displace species from the manganese oxide (presumably  $\text{OH}^-$  and  $\text{H}_2\text{O}$ ) and become bound to the greensand surface or it can be adsorbed to the surface (U.S. EPA, 1999). Column tests by Bajpai and Chaudhuri (1999) with  $500\text{ }\mu\text{g/L}$   $\text{As(III)}$  and  $500\text{ }\mu\text{g/L}$   $\text{As(V)}$ , achieved bed volumes of 153-185 per cycle at a breakthrough value of  $10\text{ }\mu\text{g/L}$ . Driehaus *et al.* (1995), in bench-scale studies of  $\text{As(III)}$  oxidation with manganese dioxide coated sand filters, found that  $\text{As(III)}$  oxidation and adsorption was efficient and the release of soluble

manganese was low. The effectiveness of greensand filtration on arsenic removal has been shown to be highly dependent on the influent iron concentration, therefore EPA (2000d) has stated that it may only be appropriate with systems that do not require much arsenic removal and have high iron in their source water.

Granular ferric hydroxide (GFH) is an adsorbent process similar to activated alumina and is contained in fixed bed reactors. Driehaus et al. (1998) reported that the application of GFH in test adsorbers showed a high treatment capacity of 30,000 to 40,000 bed volumes until an arsenic limit of 10 µg/L was exceeded. As(V) adsorption decreased with pH and phosphate in the source water reduced arsenic removal due to competition. The most significant drawback to this process is the cost of the GFH media which is said to be approximately \$4,000 per ton (U.S. EPA, 1999).

Sulfur modified iron (SMI) is a patented process by Hydrometrics, Inc., developed for arsenic removal. The process has three components: 1) finely-divided metallic iron, 2) powdered elemental sulfur, or other sulfur compounds, and 3) an oxidizing agent. The powdered iron, powdered sulfur, and the oxidizing agent are thoroughly mixed and then added to the water to be treated. The solution is then mixed and settled. Packed bed reactors and fluidized bed reactors may be used in SMI treatment systems (U.S. EPA, 1999; 2000d). The mechanism of arsenic removal with this process is adsorption. The process is currently being laboratory tested to develop design parameters for a pilot-scale system in a project sponsored by The Montana Water Center and investigated by University of Nevada – Reno, Hydrometrics, and others.

The process of iron filings and sand, originally developed for removal of arsenic at remediation sites, has also been considered for drinking water arsenic removal. At

present, there is no data available in the literature that indicates the process can remove arsenic at the low levels encountered in drinking water (U.S. EPA, 1999).

## **2.6 Disposal of Residuals**

The disposal of residuals is very important for the design engineer of drinking water treatment systems to consider. Some residuals from arsenic treatment facilities may be considered hazardous waste and would have to be disposed of as such. Arsenic wastes are considered hazardous if their toxicity characteristic (TC) exceeds 5 mg/L of arsenic. The Toxicity Characteristic Leaching Procedure (TCLP) is used to determine if it exceeds the TC. If waste is  $< 0.5\%$  dry-weight solids, then the liquid is defined as the TCLP extract and concentrations in it are compared against the TC level to determine if it is hazardous (U.S. EPA, 2001b). Also, costs of residuals disposal can be a significant portion of the total operating costs for some technologies. It is estimated that when enhancing existing processes such as coagulation/filtration and lime softening for arsenic removal, the residuals handling and disposal costs are as much as 80% and 88% of the total cost, respectively. With other technologies, residuals handling and disposal costs could be on average 12-34% of the total costs (Frey *et al.*, 1998). Disposal alternatives for liquid waste streams include: direct discharge, indirect discharge, underground injection, and land disposal. Alternatives for solids/sludges include: land disposal, reuse, and incineration. Table 9 shows a summary of several treatment processes used for arsenic removal, the various residuals produced, and possible disposal methods for the residuals. The following section gives an overview of the various residuals produced from each technology and their possible treatment and disposal methods.

### **2.6.1 Conventional Treatment Processes**

Conventional treatment processes such as coagulation/filtration, lime softening, and iron and manganese removal will also generate residuals that must be disposed of. The residuals from these processes will primarily be settled sludges and filter backwash water. The quantities of sludge produced will increase with the increased coagulant dosage used to remove arsenic. Filter backwash water will contain levels of arsenic dependent upon the influent concentrations and amount removed. The levels of arsenic present in the backwash will have to be considered when evaluating a disposal option, whether it be discharged directly to rivers, discharged indirectly to wastewater treatment plants, or recycled within the water treatment plant (Chen *et al.*, 1999).

### **2.6.2 Ion Exchange Processes**

Ion exchange processes produce residuals primarily from regeneration of the media. Waste streams will include backwash water, regenerant brine solution, and rinse water. These streams consist of 1.5 to 10% of the treated water volume depending on the feedwater quality and the type of ion exchange unit (U.S. EPA, 2000a). The regenerant solution used is usually sodium chloride. According to Albuquerque field study results (Clifford, 1999), spent brine could possibly be reused at least 20 times, thus reducing the quantity of waste residual. Once wasted, the arsenic can be precipitated out of the spent brine solution using Fe(III) or Al(III) salts with the precipitate expected to be non-hazardous (TCLP for As < 5.0 mg/L) (Clifford, 1999; Chwirka *et al.*, 2000). The problem of disposing of a high TDS regenerant waste must be considered when using ion

exchange processes. Few POTWs will be able to accept high TDS discharges, thus ion exchange will have limited use for arsenic removal except where sulfate levels are low ( $\leq 50$  mg/L) and the brine volume is very small compared to the total volume at the POTW (U.S. EPA, 2001b).

### **2.6.3 Activated Alumina Processes**

Activated alumina systems produce regenerant waste streams and when operated on a throwaway media basis, spent alumina. Regenerant streams consist of backwash water, regenerant (caustic), neutralization stream (acidic), and rinse waters. Accumulated arsenic and dissolved aluminum in the waste caustic solution can be treated in a batch process by neutralizing with  $\text{H}_2\text{SO}_4$  (or  $\text{HCl}$ ) and precipitating  $\text{Al}(\text{OH})_3$  (Clifford, 1999; Chwirka *et al.*, 2000). The dewatered sludge is expected to be non-hazardous. Spent alumina would probably pass the TCLP and EP toxicity tests due to the arsenic loading being very low and the tests are performed at pH 5, which is near the optimum pH for arsenic adsorption on alumina (Clifford, 1999). In the final rule, EPA (2001b) did not recommend regeneration of activated alumina media due to a number of reasons, including the difficulty in disposing of the brines.

### **2.6.4 Membrane Processes**

Membrane processes produce a concentrate stream (reject water stream) which will contain the rejected arsenic and other substances which are rejected by the membrane. The concentrate stream is generally high in TDS and the quality of the concentrate will vary depending upon the level of arsenic and other contaminants in the

feedwater. Disposal of the high TDS brines from membrane processes will also be difficult to dispose of unless local POTWs and their treatment processes are compatible with this waste. Taylor and Wiesner (1999) listed surface discharge as the most common concentrate disposal practiced and sewer discharge the second most common for small plants.

## **2.7 Cost Data for Treatment Technologies**

The new MCL for arsenic is expected to have a total annualized cost of approximately \$181 million (U.S. EPA, 2001b). Much of this cost will be for the installation of new treatment trains to meet the MCL. Under contract with EPA, International Consultants, Inc., Malcolm Pirnie, Inc., and The Cadmus Group, Inc., developed the *Technologies and Costs for Removal of Arsenic From Drinking Water* document (U.S. EPA, 2001a) which presents capital and O&M cost curves for numerous arsenic removal technologies. Table 10 gives a comparison of the costs for 0.01-, 0.1-, and 1-MGD average flow facilities using the technologies indicated. Costs given for enhanced coagulation and enhanced lime softening are only for enhancements to an existing facility. Figures 14, 16, and 18 show graphical comparisons of the capital costs of the various treatment technologies. Figures 15, 17, and 19 show graphical comparisons of the O&M costs of the technologies.



## **CHAPTER 3**

### **METHODS AND MATERIALS OF MULTIMEDIA CD-ROM PRODUCTION**

#### **3.1 CD-ROM Development Approach**

The intent of this project was to develop a program which can be distributed by CD-ROM as an executable file. Macromedia Authorware<sup>®</sup> version 5 was used as the authoring tool to develop the CD-ROM piece. The software is capable of producing CD-ROM and Web-based presentations with rich multimedia components such as digital videos, digital photos, sounds, and interactive text. The program is packaged with only a runtime version of Authorware therefore, the end-user of the presentation will not have the ability to edit any of the final product. The final distributed copy of the program is an executable (.exe) file on the CD-ROM and does not require any special programs to run from an end-user's personal computer.

#### **3.2 Pilot-Plant Site Visits**

A major portion of this project was the need to acquire photos and video of existing arsenic removal plants to incorporate into the presentation. Contacts were made by telephone and e-mail to EPA and various state and local environmental agencies to locate existing arsenic removal facilities in the United States. There are relatively few arsenic treatment facilities in the U.S. and these facilities are generally small and were designed for an MCL of 50 µg/L. The majority of existing facilities that were located were non-transient, non-community type systems in place at locations such as schools

and industries. The result of this search was the discovery of several pilot-plant facilities for large municipalities located in Phoenix and Tucson, Arizona.

The Phoenix pilot-plant site was visited on January 29, 2001. The pilot-plant facility was set up at the Phoenix Water Services Well #280. Existing treatment at the well consisted only of chlorination prior to distribution. Arsenic levels at this well are typically around 17 µg/L. The pilot-scale facilities included the testing of two skids with four adsorbents in 1-ft diameter columns. The processes were set up in 4 parallel treatment trains. Flow rates for the processes were 3-5 gpm to each column. The four adsorbents included in the testing were granular ferric hydroxide, Alcan FS-50 (iron-coated activated alumina), activated alumina, and Apyron Aquabind. Previous bench-scale testing of 20 adsorbents in Phoenix narrowed down adsorbent media to the best four that were in use at the site. The contact for the Phoenix test facility was Ramesh Narasimhan, P.E. of NCS Consulting Services, Phoenix, Arizona.

The Tucson pilot-plant site was visited on January 30, 2001. The pilot-plant facility was set up at Tucson Water's Well #SC16 and all of the pilot-plants withdrew water from the well water prior to distribution. The only existing treatment at the well is chlorination. Raw water arsenic concentrations typically range from 15 – 20 µg/L and sulfate concentrations range from 110 – 120 mg/L. Pilot-scale facilities in place were adsorbent columns (4 adsorbents), anion exchange, Kinetico's coagulation-assisted Macrolite™ ceramic media filtration, and Kruger's Metclean™ fluidized-bed reactor process. A fifth pilot-plant consisting of coagulation and microfiltration units was under construction at the time of the visit. Flow rates for the processes ranged from 5 to 20

gpm. The contact for the Tucson test facility was Sunil Kommineni, Ph.D., P.E. of Malcolm Pirnie, Inc. in Tucson, Arizona.

### **3.3 Data File Preparation**

Pictures were taken with a digital camera and a 35mm camera (primarily as a back-up) and video was taken with a standard Hi8 camcorder while at each of the project sites. Upon return, it was necessary to get all of this data into a format that was compatible for use in Authorware. For the pictures, for educational purposes, it was necessary to add informative text and titles to each picture (approximately 80 pictures were used in the presentations). The analog movie files were digitized and informative text and titles were added as well. The approximately 25 movie files, once edited, ranged in length from 7 seconds to 3 minutes and 53 seconds, and file sizes ranged from 1.4 to 42 megabytes. The following sections provide more detail on the procedures that were used to ready the photos and video for use in the presentation.

#### **3.3.1 Photo & Slide Preparation Procedure**

The equipment used for taking photos and slides at the various facilities and preparing them for use in the CD-ROM is as follows:

- Canon AE-1 35mm camera
- Olympus Camedia digital camera (1.3 megapixel)
- Kodak 35mm ISO 200 film for color slides
- HP slide scanner
- Microsoft® Photodraw™ 2000

For consistency amongst all of the photos and slides used in the CD-ROM, the following procedure was followed:

- Download the digital photos from the Olympus camera
- Scan the developed 35mm slides using HP slide scanner (add brightness/darkness and color as needed before saving file)
- Add title and text to photos using MS Photodraw (title font size = 18, descriptive text font size = 12, background color = R-254, G-255, B-166)

Once completed, all of the photos and slides must be the proper size to fit into the 640 X 480 pixels presentation screen in Authorware. The type of photo (digital vs. slide) dictated different procedures for resizing the final photos with text. The procedures are outlined below:

- Original pictures were 1280 X 960 pixels (digital) and 900 X 600 pixels (slides)
- Using PhotoDraw, pictures were resized to 1110 X 835 pixels (digital) and 617 X 412 pixels (slides)
- Vertical shots that were taken with the cameras must be set to a smaller size to allow for the whole picture to be viewed in Authorware; these settings were 650 X 870 pixels (digital) and 285 X 482 pixels (slides)
- If text was incorporated into the photo using PhotoDraw prior to the resizing, the picture and text must first be grouped and then the picture can be dragged to the appropriate size
- All pictures were saved as .jpg files for use in Authorware each having a file size of about 45 kilobytes; approximately 80 pictures were incorporated into the presentations

### **3.3.2 Movie File Preparation Procedure**

The equipment used for filming video clips at the various facilities and preparing the clips for use in the CD-ROM is as follows:

- Sony video Hi8 Handycam CCD-TR600
- Sony Hi8 video cassettes
- Standard tripod
- Gateway™ 433c computer
- Dazzle\* Digital Video Creator
- Adobe® Premiere® 5.0
- Ulead® Video Studio™ Version 3.0

MPEG (Motion Pictures Expert Group) format was chosen as the standard movie file format throughout the CD-ROM due to its ability to be played back without any special hardware on virtually all of the PCs available today and its relatively small file size. MPEG is a video compression-decompression (CODEC) software. A CODEC is necessary to produce reasonably sized video files. Without a CODEC, the file size required for 1 minute of video on a 640 x 480 viewing area is approximately:

$$\text{File size} = \left( \frac{640 \times 480 \text{ screen bits}}{\text{frame}} \right) \cdot \left( \frac{24 \text{ bits color}}{1 \text{ screen bit}} \right) \cdot \left( \frac{24 \text{ frames}}{\text{sec}} \right) \cdot \left( \frac{60 \text{ sec}}{\text{min}} \right) \cdot \left( \frac{1 \text{ byte}}{8 \text{ bits}} \right)$$

$$= 1,327,000,000 \text{ bytes (or 1.327 GB)}.$$

The data transfer rate would be about 22,000,000 bytes/sec. Both the file size and data transfer rate are beyond the capabilities of PC's. CODECs reduce the file size by several techniques such as averaging several pixels together, reducing the number of colors, only coding differences from one frame to the next, etc. Once compressed, typical one minute video file sizes for this presentation were around 11,500,000 bytes and data rates were approximately 150-200 kilobytes/sec. For consistency amongst all of the video files in the CD-ROM, the following procedure was followed in preparing the video clips:

- Digitize the video clips using Dazzle\* DVC resulting in a .mpg file
- Using Adobe Premiere edit video clips to desired length
- Using Adobe Premiere add titles and text to video clips (text settings: font size titles = 18, font size descriptive text = 14, color R-221, G-255, B-22)
- Export project from Adobe Premiere resulting in a .mov file (export settings: size 320 x 240, 29.97 fps, Intel Indeo Video 4.4 codec)
- Using Ulead software, convert .mov file to final .mpg file for use in Authorware

### **3.4 Authorware Screen Production**

The “multimedia piece” that was developed for this project contained media objects such as digital video, photos, example plans, graphics, and text, among other items. The common trait in a multimedia piece is the ability to orchestrate these objects in response to changing conditions such as a user’s choices. The assembling of multimedia into a functioning piece is known as authoring (Macromedia, Inc., 1998). The authoring technique used in Authorware is referred to as “icon-based” authoring. Media types are assembled within specific icons and placed on a flowline. The flowline determines the sequence in which the program runs.

To be consistent with previous pieces which were completed by Dr. Bruce Robinson, the Slow Sand Filtration and Iron and Manganese Control pieces, the format of the Arsenic Removal piece generally follows the same format. The general appearance such as the text styles and colors and the navigational buttons which appear at the bottom of the screen do not change from Dr. Robinson’s work to the Arsenic Removal work.

The major content headings used in the piece were suggested by Dr. Robin Collins of the University of New Hampshire at a Conference on Small Water Treatment Technologies. They are intended to provide a standard reporting format for research involving small water treatment technologies and to insure that needed topics were covered for engineers involved in the design of these systems. Some of the general contents headings were not used, such as automation, due to the inapplicability with the arsenic removal presentation. Other headings were added to the piece, such as residuals, which were deemed important to the topic.

Once all of the data was collected and literature was reviewed for this project, it was necessary to develop a rough outline of how the final piece was going to be organized to encompass all of the data. This was done in PowerPoint by developing a storyboard, or rough graphical outline of the presentation with design notes on the screens to aid in the development process. The final presentation differed considerably from the original storyboard, however it was a useful tool to help organize the mass of information that went into the presentation. The original storyboard is included as Appendix E.

Figure 20 shows a flow chart of the navigational structure of the final arsenic module. Sample Authorware program screens from the arsenic module are provided as Appendix F. Most of the structure is set up in a linear fashion and can be simply navigated by clicking the “next” button on the screen. However, many of the pages on the main structure have link buttons which will take the user off the main path to charts, figures, curves, etc. Also, a hypertext table of contents is provided on the left side of the page so that the user can navigate directly to any section that may be of interest. Screen captures of the first page of each main section in the module are provided in Appendix G. The final arsenic module is provided on the accompanying CD-ROM and can be viewed by opening the file entitled “arsenic\_watertech\_cd.exe”.

## **REFERENCES**



## REFERENCES

- Anderson, Robert E. Estimation of Ion Exchange Process Limits by Selectivity Calculations. *AIChE Symposium Series: Adsorption and Ion Exchange*, 152:71:236 (1975).
- AWWA Membrane Technology Research Committee. Committee Report: Membrane Processes. *J. AWWA*, 90:6:91 (June 1998).
- Bajpai, S. & Chaudhuri, M. Removal of Arsenic from Ground Water by Manganese Dioxide – Coated Sand. *J. Envir. Engrg.*, 125:8:782 (August 1999).
- Carpenter, F. & Geishecker, E. . “A Quarter Century of Electrodialysis Desalting: The Buckeye, Arizona Experience”, Ionics, Inc., Watertown, MA  
<http://www.ionics.com/products/WaterFoodChemical/municipal/buckeye/default.htm> (2000).
- Chen, H-W.; Frey, M.M.; Clifford, D.; McNeill, L.S.; & Edwards, M. Arsenic Treatment Considerations. *Jour. AWWA*, 91:3:74 (March 1999).
- Cheng, R.C.; Liang, S.; Wang, H-C.; & Beuhler, M.D. Enhanced Coagulation for Arsenic Removal. *Jour. AWWA*, 86:9:79 (September 1994).
- Chwirka, J.D.; Thomson, B.M.; & Stomp III, J.M. Removing Arsenic from Groundwater. *Jour. AWWA*, 92:3:79 (March 2000).
- Clifford, D. Computer Prediction of Arsenic Ion Exchange. *Jour. AWWA*, 87:4:10 (April 1995).
- Clifford, D.A. “Ion Exchange and Inorganic Adsorption.” In *Water Quality and Treatment: A Handbook of Community Water Supplies*, AWWA, 5<sup>th</sup> Edition, McGraw-Hill, Inc., pp. 9.1-9.91 (1999).
- Clifford, D.A. & Lin, C.C. Arsenic (III) and Arsenic (V) Removal from Drinking Water in San Ysidro, N.M. NTIS Service, EPA/600/S2-91/011 (1991).
- Davis, J. Stability of Metal-Arsenic Solids in Drinking Water Systems. *Prac. Per. Haz., Tox., Rad. Waste Mgmt.*, 4:1:31 (January 2000).
- Driehaus, W.; Seith, R.; & Jekel, M. Oxidation of Arsenate (III) with Manganese Oxides in Water Treatment. *Water Res.*, 29:1:297 (1995).

- Driehaus, W.; Jekel, M.; & Hildebrandt, U. Granular Ferric Hydroxide – A New Adsorbent for the Removal of Arsenic from Natural Water. *Jour. Water Science Research & Technology*, 47:1:30 (1998).
- Edwards, M. Chemistry of Arsenic Removal During Coagulation and Fe-Mn Oxidation. *Jour. AWWA*, 86:9:64 (September 1994).
- Ferguson, J.F. & Anderson, M.A. “Chemical Forms of Arsenic in Water Supplies and Their Removal”. *Chemistry of Water Supply, Treatment & Distribution*, (1974).
- Fox, K. Field Experience with Point-of-Use Treatment Systems for Arsenic Removal. *Jour. AWWA*, 81:2:94 (February 1989).
- Fox, K.R. & Sorg, T.J. Controlling Arsenic, Fluoride, and Uranium by Point-of-Use Treatment. *Jour. AWWA*, 79:10:81 (October 1987).
- Frey, M.M.; Chwirka, J.; Kommineni, S.; Chowdhury, Z.; & Narasimhan, R. Cost Implications of a Lower Arsenic MCL Final Report. AWWARF, (May 2000).
- Frey, M.M. & Edwards, M.A. Surveying Arsenic Occurrence. *Jour. AWWA*, 89:3:105 (March 1997).
- Frey, M.M.; Owen, D.M.; Chowdhury, Z.K.; Raucher, R.S.; & Edwards, M.A. Cost to Utilities of a Lower MCL for Arsenic. *Jour. AWWA*, 90:3:89 (March 1998).
- Gupta, S.K. & Chen, K.Y. Arsenic Removal by Adsorption. *Journal WPCF*, 50:3:493 (March 1978).
- Harper, T.R. & Kingham, N.W. Removal of Arsenic from Wastewater Using Chemical Precipitation Methods. *Water Envir. Res.*, 64:3:200 (May/June 1992).
- Hathaway, S.W. & Rubel Jr., F. Removing Arsenic from Drinking Water. *Jour. AWWA*, 79:8:61 (August 1987).
- Hering, J.G.; Chen, P-Y.; Wilkie, J.A.; & Elimelech, M. Arsenic Removal from Drinking Water During Coagulation. *J. Envir. Engrg.*, 123:8:800 (August 1997).
- Hering, J.G.; Chen, P-Y.; Wilkie, J.A.; Elimelech, M.; & Liang, S. Arsenic Removal by Ferric Chloride. *Jour. AWWA*, 88:4:155 (April 1996).
- Hering, J.G. & Chiu, V.Q. Arsenic Occurrence and Speciation in Municipal Ground-Water-Based Supply System. *J. Envir. Engrg.*, 126:5:471 (May 2000).
- Karim, M. Arsenic in Groundwater and Health Problems in Bangladesh. *Water Res.*, 34:1:304 (2000).

Kommineni, S.N. Project Engineer with Malcolm Pirnie, Inc., Tucson, AZ. Personal communication (January 2001).

Korte, N. Naturally Occurring Arsenic in Groundwaters of the Midwestern United States. *Envir. Geol. Water Sci.*, 18:2:137 (1991).

Korte, N.E. & Fernando, Q. A Review of Arsenic (III) in Groundwater. *Crit. Reviews Envir. Control*, 21:1:1 (1991).

Macromedia, Inc. *Macromedia Authorware 5 Attain: Using Authorware Attain*, 1<sup>st</sup> Edition, (September 1998).

McNeill, L.S. & Edwards, M. Soluble Arsenic Removal at Water Treatment Plants. *Jour. AWWA*, 87:4:105 (April 1995).

McNeill, L.S. & Edwards, M. Predicting As Removal During Metal Hydroxide Precipitation. *Jour. AWWA*, 89:1:75 (January 1997a).

McNeill, L.S. & Edwards, M. Arsenic Removal During Precipitative Softening. *J. Envir. Engrg.*, 123:5:453 (May 1997b).

Narasimhan, R. Principal Engineer with Narasimhan Consulting Services, Phoenix, AZ. Personal communication (January 2001).

Oscarson, D.W.; Huang, P.M.; Defosse, C.; & Herbillon, A. Oxidative Power of Mn (IV) and Fe (III) Oxides with respect to As (III) in Terrestrial and Aquatic Environments. *Nature*, 291:50 (May 7, 1981).

Pontius, F.W. Crafting a New Arsenic Rule. *Jour. AWWA*, (1994).

Pontius, F.W. Uncertainties Drive Arsenic Rule Delay. *Jour. AWWA*, 87:4:12 (April 1995).

Pontius, F.W.; Brown, K.G.; & Chen, C-J. Health Implications of Arsenic in Drinking Water. *Jour. AWWA*, 86:9:52 (September 1994).

Reed, B.E.; Vaughan, R.; & Jiang, L. As(III), As(V), Hg, and Pb Removal by Fe-Oxide Impregnated Activated Carbon. *J. Envir. Engrg.*, 126:9:869 (September 2000).

Reid, J. Arsenic Occurrence: USEPA Seeks Clearer Picture. *Jour. AWWA*, 86:9:44 (September 1994).

Robinson, R.B. "State-of-the-Art Iron and Manganese Control," *Journal of the New England Water Works Association*, Vol. 114, No. 3, pp. 176-186 (September 2000).

Scott, K.N.; Green, J.F.; Do, H.D.; & McLean, S.J. Arsenic Removal by Coagulation. *Jour. AWWA*, 87:4:114 (April 1995).

Sorg, T.J. & Logsdon, G.S. Treatment Technology to Meet the Interim Primary Drinking Water Regulations for Inorganics: Part 2. *Jour. AWWA*, 70:7:379 (July 1978).

Taylor, J.S. & Wiesner, M. "Membranes." In *Water Quality and Treatment: A Handbook of Community Water Supplies*, AWWA, 5<sup>th</sup> Edition, McGraw-Hill, Inc., pp. 11.1-11.71 (1999).

U.S. Environmental Protection Agency. Manual of Treatment Techniques for Meeting the Interim Primary Drinking Water Regulations. Office Research & Development (1973).

U.S. Environmental Protection Agency. Integrated Risk Information System (IRIS), URL: <http://www.epa.gov/iris/subst/0278.htm> (1998).

U.S. Environmental Protection Agency. Regulations on the Disposal of Arsenic Residuals from Drinking Water Treatment Plants, NRMRL-ORD, EPA/600/R-00/025 (May 2000a).

U.S. Environmental Protection Agency. Arsenic Removal from Drinking Water by Coagulation/Filtration and Lime Softening Plants, NRMRL-ORD, EPA/600/R-00/063 (June 2000b).

U.S. Environmental Protection Agency. Proposed Arsenic in Drinking Water Rule Regulatory Impact Analysis, EPA/815/R-00/013 (June 2000c).

U.S. Environmental Protection Agency. "National Primary Drinking Water Regulations; Arsenic and Clarifications to Compliance and New Source Contaminants Monitoring; Proposed Rule." Federal Register (40 CFR, Part 141 and 142) 65 (No. 121): 38888-38983, (June 22, 2000d).

U.S. Environmental Protection Agency. Arsenic Removal from Drinking Water by Iron Removal Plants, NRMRL-ORD, EPA/600/R-00/086 (August 2000e).

U.S. Environmental Protection Agency. Arsenic Removal from Drinking Water by Ion Exchange and Activated Alumina Plants, NRMRL-ORD, EPA/600/R-00/088 (October 2000f).

U.S. Environmental Protection Agency. Technologies and Costs for Removal of Arsenic from Drinking Water. Office of Groundwater and Drinking Water, EPA/815/R-01/001 (January 2001a).

U.S. Environmental Protection Agency. "National Primary Drinking Water Regulations; Arsenic and Clarifications to Compliance and New Source Contaminants Monitoring; Final Rule." Federal Register (40 CFR, Parts 9, 141, and 142) 66 (No. 14): 6976-7066, (January 22, 2001b).

U.S. Geological Survey. Arsenic in Ground-Water Resources of the United States. Fact Sheet FS-063-00 (May 2000).

Wachinski, A.M. & Etzel, J.E. Environmental Ion Exchange: Principles and Design, Lewis Publishers, N.Y. (1997).

Water Tech Online. "Election May Speed Final Arsenic Rule."  
<http://www.waternet.com>, (November 15, 2000).

Waypa, J.J.; Elimelech, M.; & Hering, J.G. Arsenic Removal by RO and NF Membranes. *Jour. AWWA*, 89:10:102 (October 1997).

Welch, A.H.; Lico, M.S.; & Hughes, J.L. Arsenic in Ground Water of the Western United States. *Ground Water*, 26:3:333 (1988).

Welch, A.H.; Westjohn, D.B.; Helsel, D.R.; & Wanty, R.B. Arsenic in Ground Water of the United States: Occurrence and Geochemistry. *Ground Water*, 38:4:589 (July-August 2000).

World Health Organization. "Arsenic in Drinking Water." Fact Sheet No. 210,  
<http://www.who.int/inf-fs/en/fact210.html>, (February 1999).

## **APPENDICES**

## **APPENDIX A**

### **TABLES DISCUSSED IN BODY OF REPORT**

**Table 1.** Cancer Risks for U.S. Populations Exposed at or Above MCL Options, After Treatment (Source: U.S. EPA, 2001b)

<i>MCL (mg/L)</i>	<i>Mean exposed population risk</i>	<i>90<sup>th</sup> percentile exposed population risk</i>
3	$0.11 - 1.25 \times 10^{-4}$	$0.22 - 2.42 \times 10^{-4}$
5	$0.27 - 2.02 \times 10^{-4}$	$0.55 - 3.9 \times 10^{-4}$
10	$0.63 - 2.99 \times 10^{-4}$	$1.32 - 6.09 \times 10^{-4}$
20	$1.1 - 3.85 \times 10^{-4}$	$2.47 - 8.37 \times 10^{-4}$



**Table 2.** Principle Reactions Affecting Inorganic Arsenic Concentrations in Groundwater (Source: Welch et al., 2000)

<i>Redox Condition</i>	<i>Important Phases</i>	<i>Important Reactions</i>	<i>Conditions Affecting Mobility</i>
Oxic (oxygen)	Fe-oxides	Adsorption/desorption	pH; competing adsorbents; oxygen and iron concentrations
		Precipitation	
	Sulfide minerals	Sulfide oxidation	pH and microbial activity; oxygen and nitrate transport
Anoxic (no oxygen)	Fe-oxides	Adsorption/desorption and precipitation	Oxidation state of As
		Adsorption/desorption	pH
		Dissolution	Presence of organic carbon
	Sulfide minerals	Sulfide oxidation	
Sulfidic (sulfide present)	Sulfide minerals	Precipitation	Sulfide, iron, and As concentrations

**Table 3.** Comparison of National Arsenic Occurrence Estimates (Source: U.S. EPA, 2001b)

Source	Type of water	System types	Population served	% of systems with mean arsenic exceeding concentrations (mg/L) of:				
				2	3	5	10	20
Ground Water Systems								
EPA-proposed	Raw+finished	CWS	All	27.2	19.9	12.1	5.4	2.1
EPA-final	Raw+finished	CWS	All	27.3	19.9	12.1	5.3	2.0
NAOS-small	Finished	PWS	≤10,000	23.5	NR	12.7	5.1	NR
NAOS-large	Finished	PWS	>10,000	28.8	NR	15.4	6.7	NR
NIRS	Finished	CWS	All	17.4	11.9	6.9	2.9	1.1
USGS	Raw	PWS	All	25.0	NR	13.6	7.6	3.1
Surface Water Systems								
EPA-proposed	Finished	CWS	All	9.9	6.0	2.9	0.8	0.3
EPA-final	Finished	CWS	All	9.8	5.6	3.0	0.8	0.3
NAOS-small	Finished	PWS	≤10,000	6.2	NR	1.8	0.0	NR
NAOS-large	Finished	PWS	>10,000	7.5	NR	1.3	0.6	NR

**Table 4.** Best Available Technologies and Removal Rates (Source: U.S. EPA, 2001b)

<i>Treatment technology</i>	<i>Maximum percent removal [for As(V)]</i>
Ion Exchange (sulfate $\leq$ 50 mg/L)	95
Activated Alumina	95
Reverse Osmosis	>95
Modified Coagulation/Filtration	95
Modified Lime Softening (pH > 10.5)	90
Electrodialysis Reversal	85
Oxidation/Filtration (20:1 iron:arsenic)	80

**Table 5.** Small System Compliance Technologies for Arsenic (V) (Source: U.S. EPA, 2001b)

<i>Treatment Technology</i>	<i>Affordable for listed small system categories</i>
Activated Alumina (centralized)	All size categories
Activated Alumina (POU)	All size categories
Coagulation/Filtration	501-3,300 and 3,301-10,000
Coagulation/Microfiltration	501-3,300 and 3,301-10,000
Electrodialysis Reversal	501-3,300 and 3,301-10,000
Enhanced Coagulation/Filtration	All size categories
Enhanced Lime Softening (pH>10.5)	All size categories
Ion Exchange	All size categories
Lime Softening	501-3,300 and 3,301-10,000
Oxidation/Filtration (Fe/As ratio 20:1)	All size categories
Reverse Osmosis (centralized)	501-3,300 and 3,301-10,000
Reverse Osmosis (POU)	All size categories

**Table 6.** Summary of Reported Performance of Arsenic Removal Technologies in the Literature

<i>Treatment Technology</i>	<i>Type</i>	<i>Operating Parameters</i>	<i>Arsenic Removal</i>	<i>Source</i>
Coagulation/Filtration	bench full full full full	FeCl <sub>3</sub> Alum Alum	80% 81-96% 23-71% < 50% 52%, 79% to <5 µg/L	Hering et al., 1997 Scott et al., 1995 “ McNeill & Edwards, 1995 EPA, 2000b
Lime Softening	full pilot full	pH below 10.5	90% 100% 45%	McNeill & Edwards, 1995 Sorg & Logsdon, 1978 EPA, 2000b
Iron Removal	full full		80-95% 87%, 74%	McNeill & Edwards, 1995 EPA, 2000e
Ion Exchange	pilot POU full		<2 µg/L <5 µg/L 53%, 97%	Clifford, 1999 Fox & Sorg, 1987, 1989 EPA, 2000f
Activated Alumina	POU pilot full		<5 µg/L <5 µg/L 87%, 98%	Fox & Sorg, 1987, 1989 Hathaway & Rubel, 1987 EPA, 2000f
Reverse Osmosis	POU bench pilot	As(V)	<5 – 20 µg/L 94.5 – 100% >95%	Fox & Sorg, 1987 Waypa et al., 1997 EPA, 1999

**Table 7.** Arsenic Treatment Technology Advantages and Disadvantages (*Sources: Clifford, 1999; Waypa et al., 1997; McNeill and Edwards, 1997b*)

<i>Treatment Technology</i>	<i>Advantages</i>	<i>Disadvantages</i>
Ion Exchange	<ul style="list-style-type: none"> <li>• Ease of regeneration with NaCl</li> <li>• Familiarity with technology due to use for softening in water treatment</li> <li>• Product water is lower in nitrate, sulfate, chloride, and TDS which may help in meeting secondary standards</li> <li>• Essentially zero level of effluent As possible</li> <li>• Relatively insensitive to flow variations, short contact time required</li> <li>• Large variety of specific resins available</li> </ul>	<ul style="list-style-type: none"> <li>• Competition concern with high TDS or high sulfate waters</li> <li>• Large amounts of salt are used during regeneration of the resin (recycle of brine solution could reduce the amount)</li> <li>• Danger of using IX beyond the point of sulfate exhaustion (chromatographic effect allows exhausted exchange resin to release nearly all previously removed As back into the treated water at high concentrations)</li> </ul>
Activated Alumina	<ul style="list-style-type: none"> <li>• As is high on the selectivity sequence for AA so don't have to worry about TDS or sulfate levels like IX</li> <li>• Can use media on a throw-away basis or regenerate</li> <li>• Low effluent As level possible</li> <li>• Highly selective for fluoride as well as arsenic</li> </ul>	<ul style="list-style-type: none"> <li>• Some of the sorptive capacity is lost after each regeneration according to pilot studies</li> <li>• Must go through a complicated two step acid-base regeneration procedure which may be a problem for smaller systems</li> <li>• The pH must be adjusted to the 5.5-6.0 range for greatest removal efficiency which will mean addition of acid for high pH groundwaters</li> <li>• Higher aluminum residuals which may affect meeting secondary Al standard</li> <li>• Possibility of chromatographic peaking of other anions such as F because of selectivity sequence for AA</li> <li>• Slow adsorption kinetics and relatively long contact time required</li> <li>• Significant volume/mass of spent regenerant to neutralize and dispose</li> </ul>

**Table 7.** (continued)

<i>Treatment Technology</i>	<i>Advantages</i>	<i>Disadvantages</i>
Coagulation/ Filtration	<ul style="list-style-type: none"> <li>Existing conventional water treatment for turbidity removal can also remove As if enhanced</li> </ul>	<ul style="list-style-type: none"> <li>Increase sludge production by increasing coagulant dosage</li> </ul>
Fe/Mn Oxidation	<ul style="list-style-type: none"> <li>Existing conventional water treatment for Fe/Mn can also remove As if enhanced</li> </ul>	<ul style="list-style-type: none"> <li>As removal is highly dependent upon the level of Fe in the source water</li> </ul>
Lime Softening	<ul style="list-style-type: none"> <li>Existing conventional water treatment for hardness can also remove As if enhanced</li> </ul>	<ul style="list-style-type: none"> <li>The presence of trace amounts of orthophosphate could limit arsenate removal</li> <li>The presence of carbonate could limit arsenate removal by <math>Mg(OH)_2</math></li> </ul>
Membrane Processes (RO, NF)	<ul style="list-style-type: none"> <li>Secondary benefits such as nitrate, chloride, sulfate, and TDS removal</li> <li>High removal efficiencies for As(III) and As(V) eliminates the need for preoxidation</li> <li>No need for optimization of pH because removal is pH independent (from pH 4 to 8)</li> <li>Dissolved co-occurring inorganic solutes (sulfate, phosphate) don't affect removal</li> </ul>	<ul style="list-style-type: none"> <li>Low amount of recovery (permeate water compared with concentrate water)</li> <li>Difficulty controlling corrosion associated with preacidification for RO</li> <li>Long-term performance and possible deterioration in performance over time due to colloidal and NOM fouling</li> <li>Pretreatment of surface water may be needed to prevent fouling</li> </ul>

**Table 8.** Membrane Terminology (Adapted from Taylor and Wiesner, 1999)

<i>Term</i>	<i>Definition</i>
Feedwater	Influent water to the membrane
Concentrate, reject, residual stream	Membrane waste stream that contains higher TDS than the feedwater
Brine	Concentrate stream containing TDS greater than 36,000 mg/L
Permeate or product	Membrane product stream that contains lower TDS than the feedwater
Membrane element	Single membrane unit
Pressure vessel	Single tube with several membrane elements in series
Stage or bank	Parallel pressure vessels
Array or train	Multiple interconnected stages in series
Rejection	% solute concentration reduction of the product stream relative to the feedwater
Flux	Mass ( $\text{mL}^{-2}\text{t}^{-1}$ ) or volume ( $\text{Lt}^{-1}$ ) rate of transfer through a membrane surface
Scaling	Precipitation of solids in an element due to solute concentration in the feedwater
Fouling	Deposition of solid material from the feedwater in a membrane element
Recovery	% of product water that can be produced from the feedwater



**Table 9.** Summary of Residuals/Management Methods (Source: Adapted from U.S. EPA, 2000a)


<i>Treatment Technology</i>	<i>Form of Residual</i>	<i>Type of Residual</i>	<i>Possible Disposal Methods</i>
Anion Exchange	Liquid	Regeneration Streams --Spent Backwash --Spent Regenerant --Spent Rinse Stream	Sanitary Sewer Direct Discharge (NPDES) Evaporation Ponds/Lagoon
	Solid	Spent Resin	Landfill Hazardous Waste Landfill Return to Vendor
Activated Alumina	Liquid	Regeneration Streams --Spent Backwash --Spent Regenerant (Caustic) --Spent Neutralization (Acid) --Spent Rinse  Liquid Filtrate (when brine streams are precipitated)	Sanitary Sewer Direct Discharge (NPDES) Evaporation Ponds/Lagoon
	Solid	Spent Alumina  Sludge (when brine streams are precipitated)	Landfill Hazardous Waste Landfill Land Application
Media Adsorption (GFH, Fe-coated AA, proprietary media, etc)	Liquid	Regeneration Streams --Spent Backwash --Spent Regenerant --Spent Rinse Stream	Sanitary Sewer Direct Discharge (NPDES) Evaporation Ponds/Lagoon
	Solid	Spent Media	Landfill Hazardous Waste Landfill
Enhanced Coagulation/ Filtration	Liquid	Filter Backwash	Direct Discharge (NPDES) Sanitary Sewer Evaporation Ponds/Lagoons
	Solid	Alum or ferric sludge	Land Application Landfill
Enhanced Lime Softening	Liquid	Filter Backwash	Direct Discharge (NPDES) Sanitary Sewer Evaporation Ponds/Lagoons
	Solid	Clarifier sludge	Land Application Landfill
Iron & Manganese Removal Processes	Liquid	Filter Backwash	Direct Discharge (NPDES) Sanitary Sewer Evaporation Ponds/Lagoons
	Solid	Sludge (if separated from backwash water)  Spent Media	Sanitary Sewer Land Application Landfill  Landfill Hazardous Waste Landfill
Membrane Processes	Liquid	Brine (reject and backwash streams)	Direct Discharge (NPDES) Sanitary Sewer Deep Well Injection Evaporation Ponds/Lagoon

**Table 10.** Capital and O&M Costs for Arsenic Removal Technologies At Average Flows of 0.01, 0.1, and 1-mgd (cost equations from U.S. EPA, 2001a)


<i>Technology</i>	<i>0.01 MGD</i>		<i>0.1 MGD</i>		<i>1.0 MGD</i>	
	<i>Capital cost (\$)</i>	<i>O&amp;M cost (\$)</i>	<i>Capital cost (\$)</i>	<i>O&amp;M cost (\$)</i>	<i>Capital cost (\$)</i>	<i>O&amp;M cost (\$)</i>
Pre-oxidation – 1.5 mg/L Chlorine	14,560 (with housing)	1,204	14,560 (with housing)	1,586	14,560 (with housing)	6,000
Enhanced Coagulation/ Filtration (existing plant)	7,291	294	8,580	948	18,053	13,996
Coagulation-assisted Microfiltration	141,931	22,232	462,973	35,772	2,098,543	64,325
Enhanced Lime Softening (existing plant)	8,378	625	12,489	3,394	33,135	30,239
Activated Alumina (no pH adjustment)	15,367	6,012 (pH 7-8) 9,986 (pH 8-8.3)	61,745	23,012 (pH 7-8) 42,358 (pH 8-8.3)	430,498	200,524 (pH 7-8) 380,164 (pH 8-8.3)
Activated Alumina (pH adjusted to 6.0)	47,661	7,448 (23,100 BV) 8,379 (15,400 BV)	97,686	22,326 (23,100 BV) 26,863 (15,400 BV)	502,904	177,081 (23,100 BV) 219,205 (15,400 BV)
Anion Exchange (< 20 mg/L SO <sub>4</sub> )	22,992	5,766	68,612	12,073	349,648	52,187
Anion Exchange (20-50 mg/L SO <sub>4</sub> )	24,088	9,390	110,607	17,107	437,411	71,040
Greensand Filtration	12,390	7,982	85,324	13,285	587,584	66,314

## **APPENDIX B**


### **FIGURES DISCUSSED IN BODY OF REPORT**

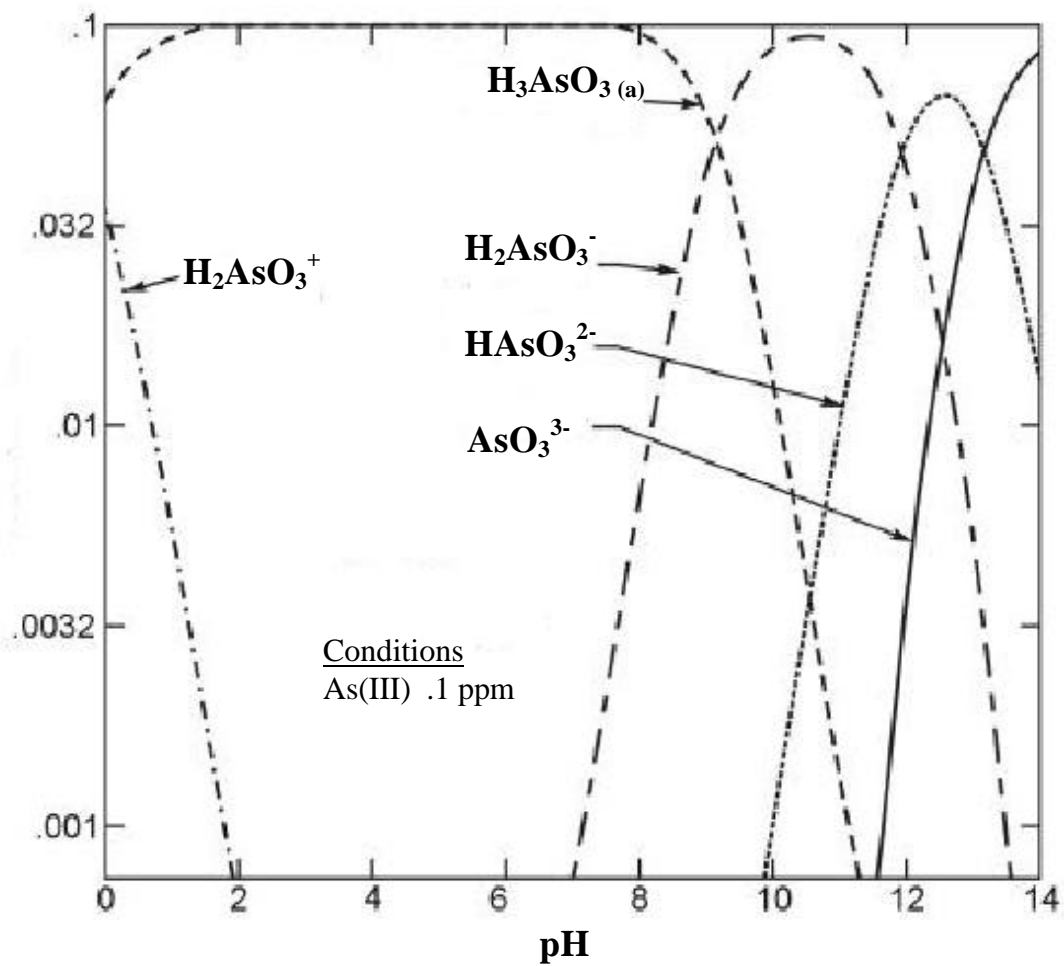


**Figure 1.** Arsenic (III) Solubility Diagram (Source: U.S. Environmental Protection Agency. *Arsenic Removal from Drinking Water by Coagulation/Filtration and Lime Softening Plants*, NRMRL-ORD, EPA/600/R-00/063 (June 2000b).

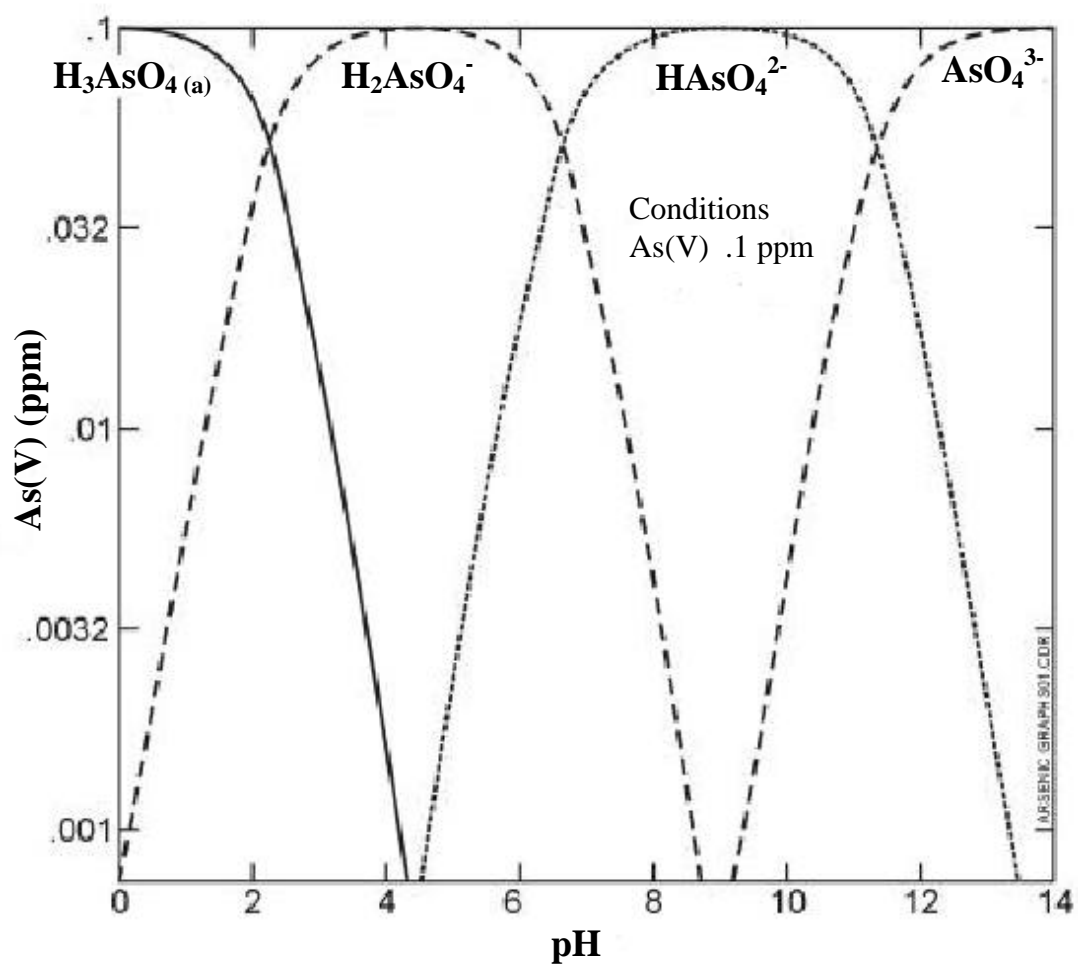


**Figure 2.** Arsenic (V) Solubility Diagram (Source: U.S. Environmental Protection Agency. *Arsenic Removal from Drinking Water by Coagulation/Filtration and Lime Softening Plants*, NRMRL-ORD, EPA/600/R-00/063 (June 2000b).

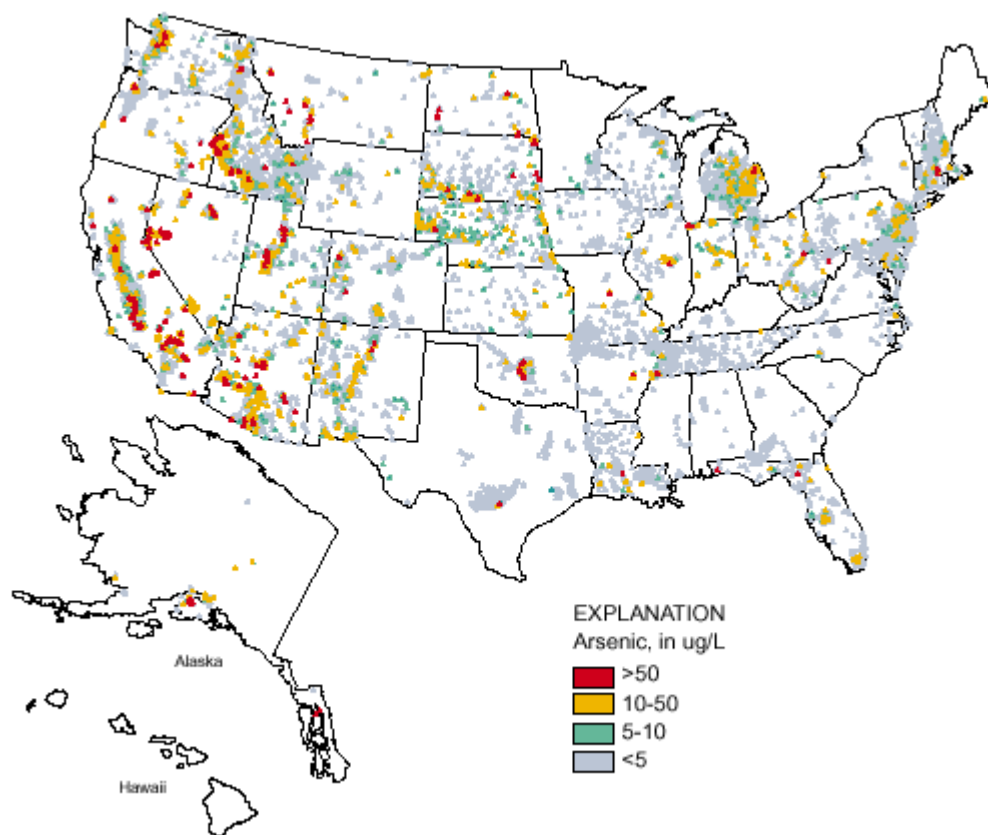

**Figure 3.** Arsenic Concentrations in Groundwater of the United States (*Source: U.S. Geological Survey. Arsenic in Ground-Water Resources of the United States. Fact Sheet FS-063-00, May 2000*)

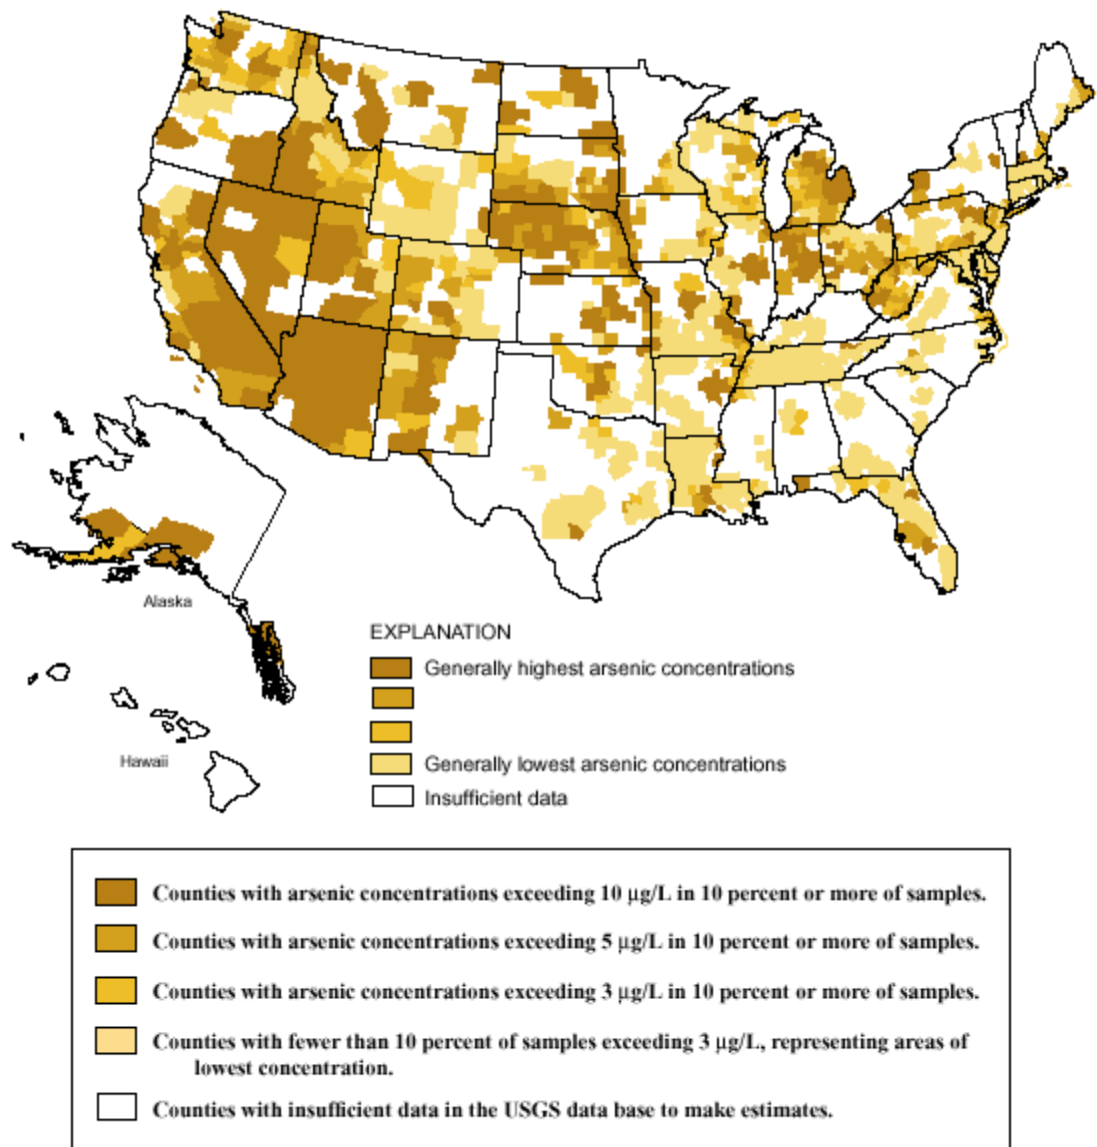


**Figure 4.** Counties With Arsenic Concentrations Exceeding Possible New MCLs in 10 Percent or More of Groundwater Samples (*Source: U.S. Geological Survey. Arsenic in Ground-Water Resources of the United States. Fact Sheet FS-063-00, May 2000*)

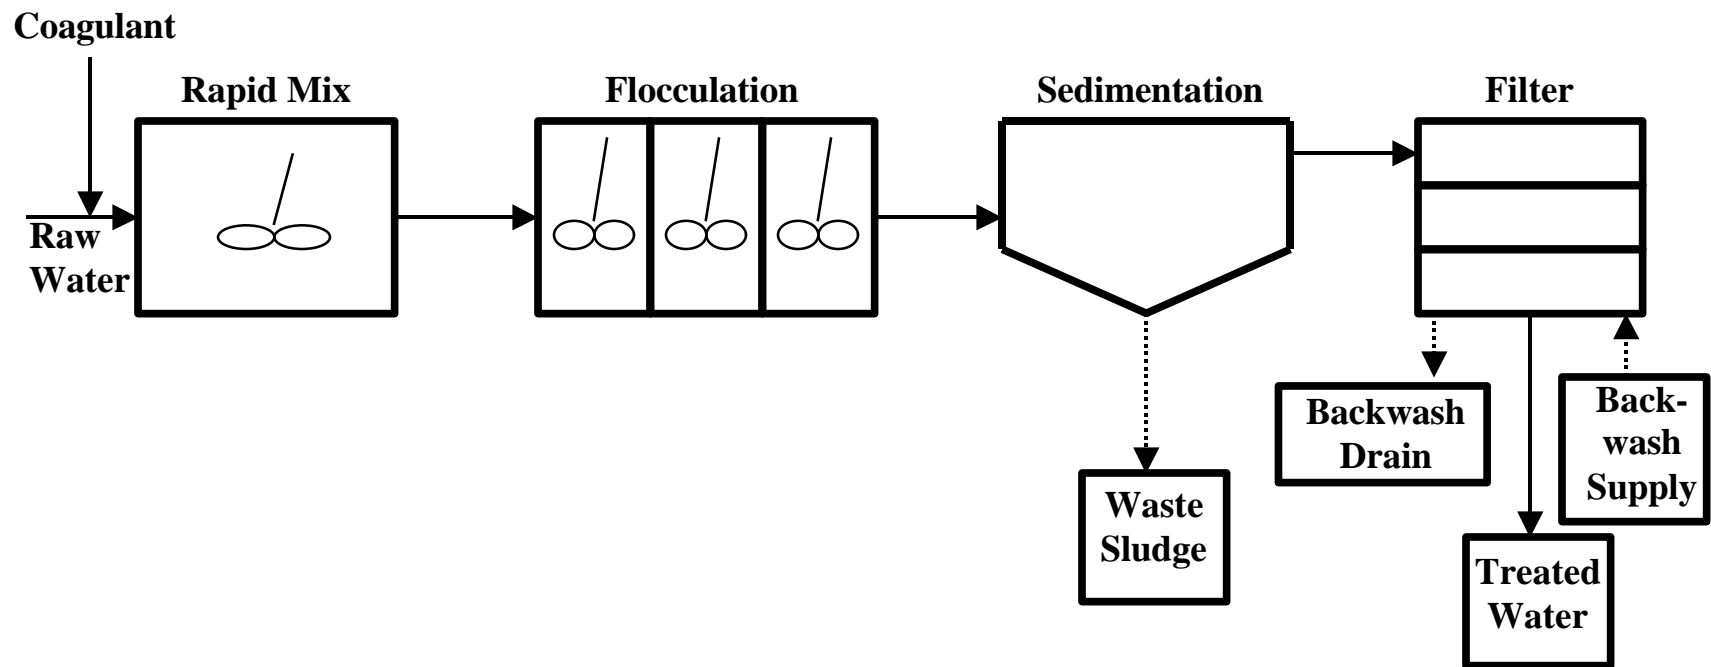


**Figure 5.** Typical Coagulation/Filtration Treatment Process Diagram




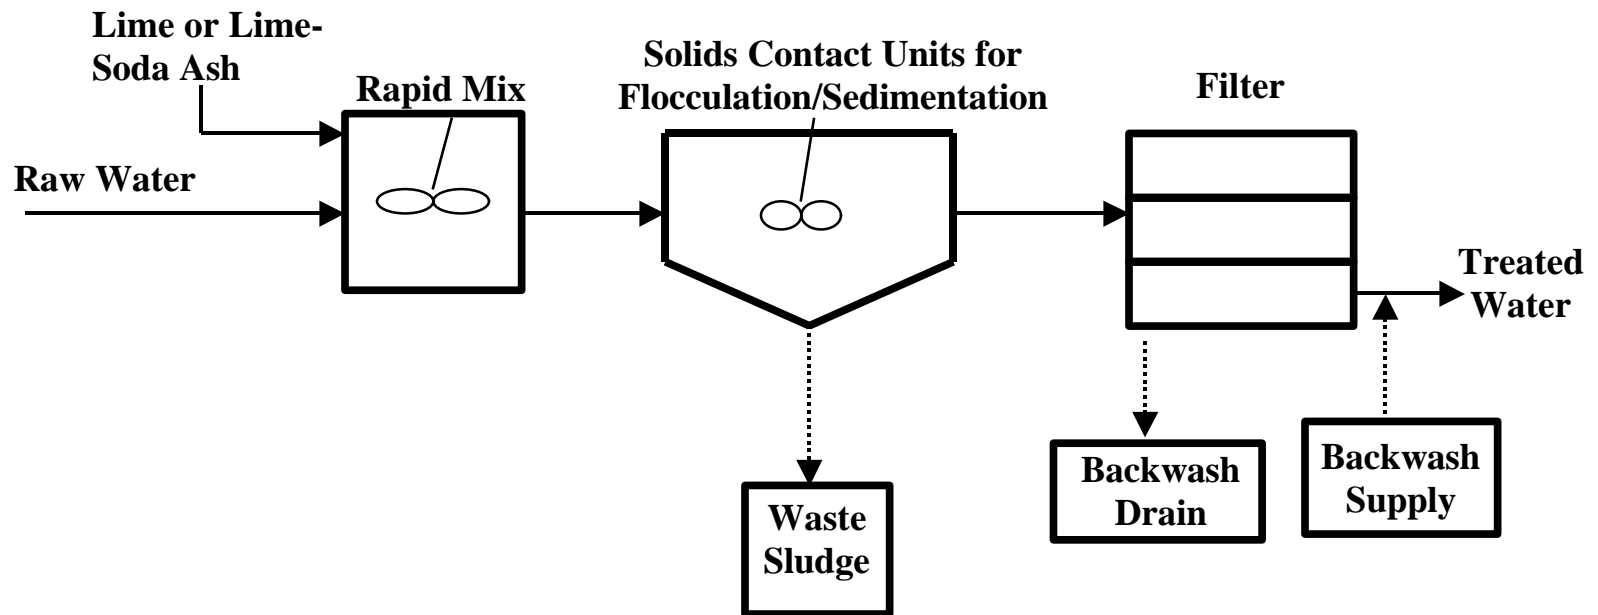


**Figure 6.** Typical Lime Softening Treatment Process Diagram

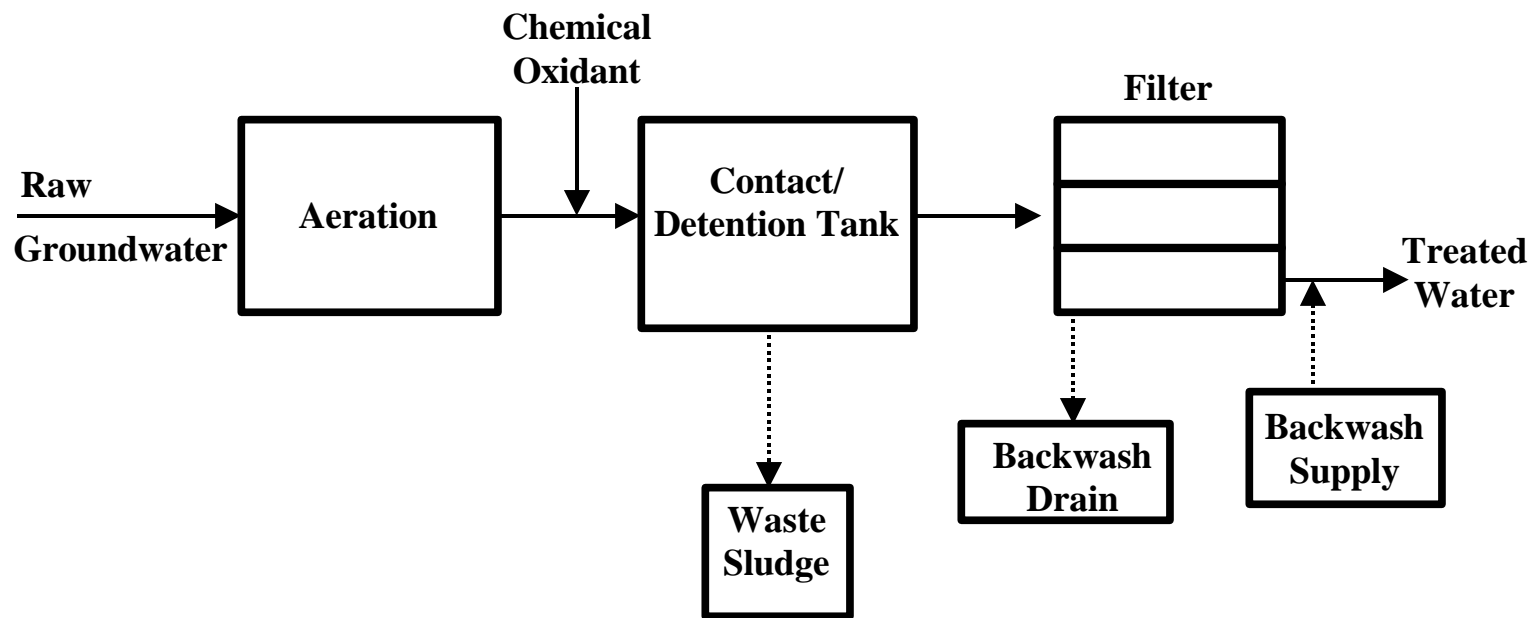


**Figure 7.** Typical Fe/Mn Removal Treatment Process Diagram

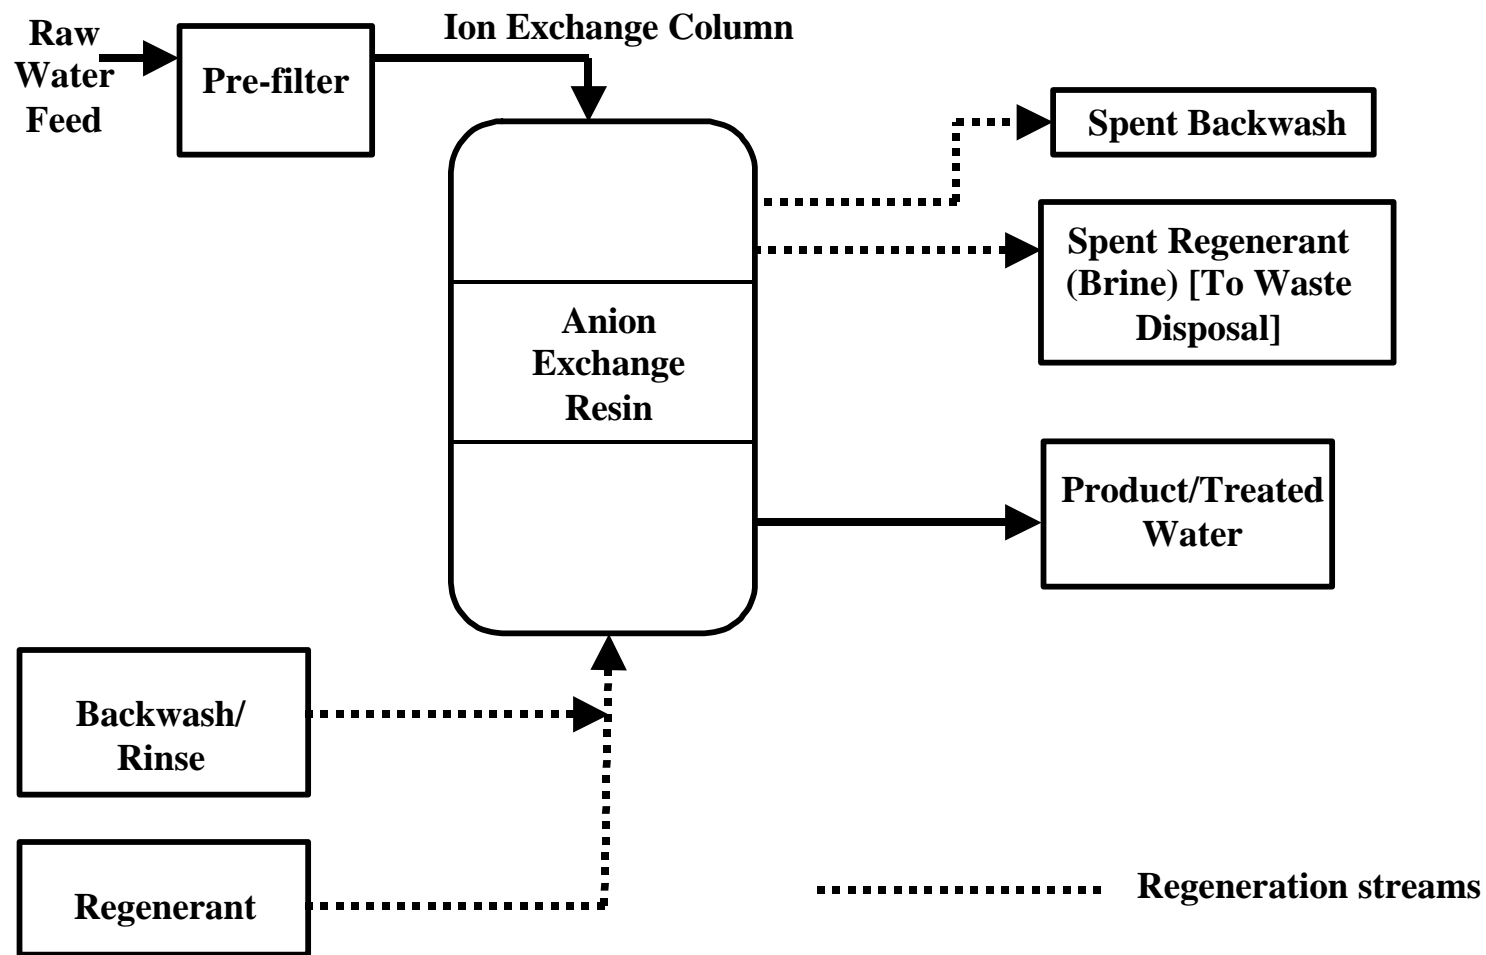


**Figure 8.** Typical Anion Exchange Treatment Process Diagram (Adapted from U.S. EPA, 2000a)

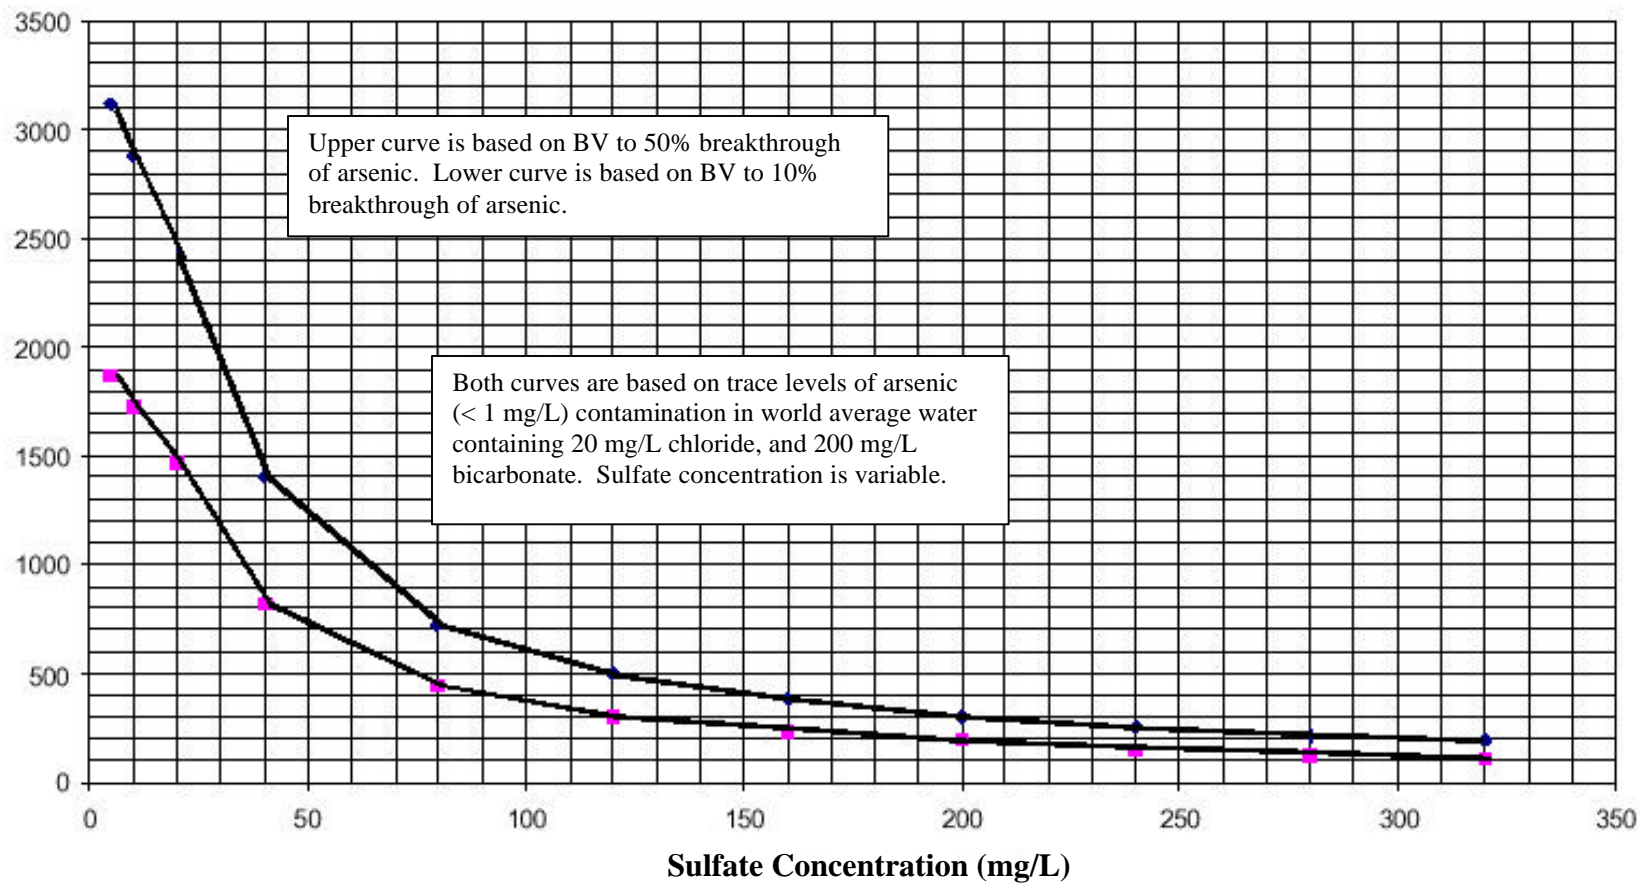


**Figure 9.** Bed Volumes to Arsenic Breakthrough as a Function of Sulfate Concentration for Ion Exchange (Source: U.S. EPA, 2001a)

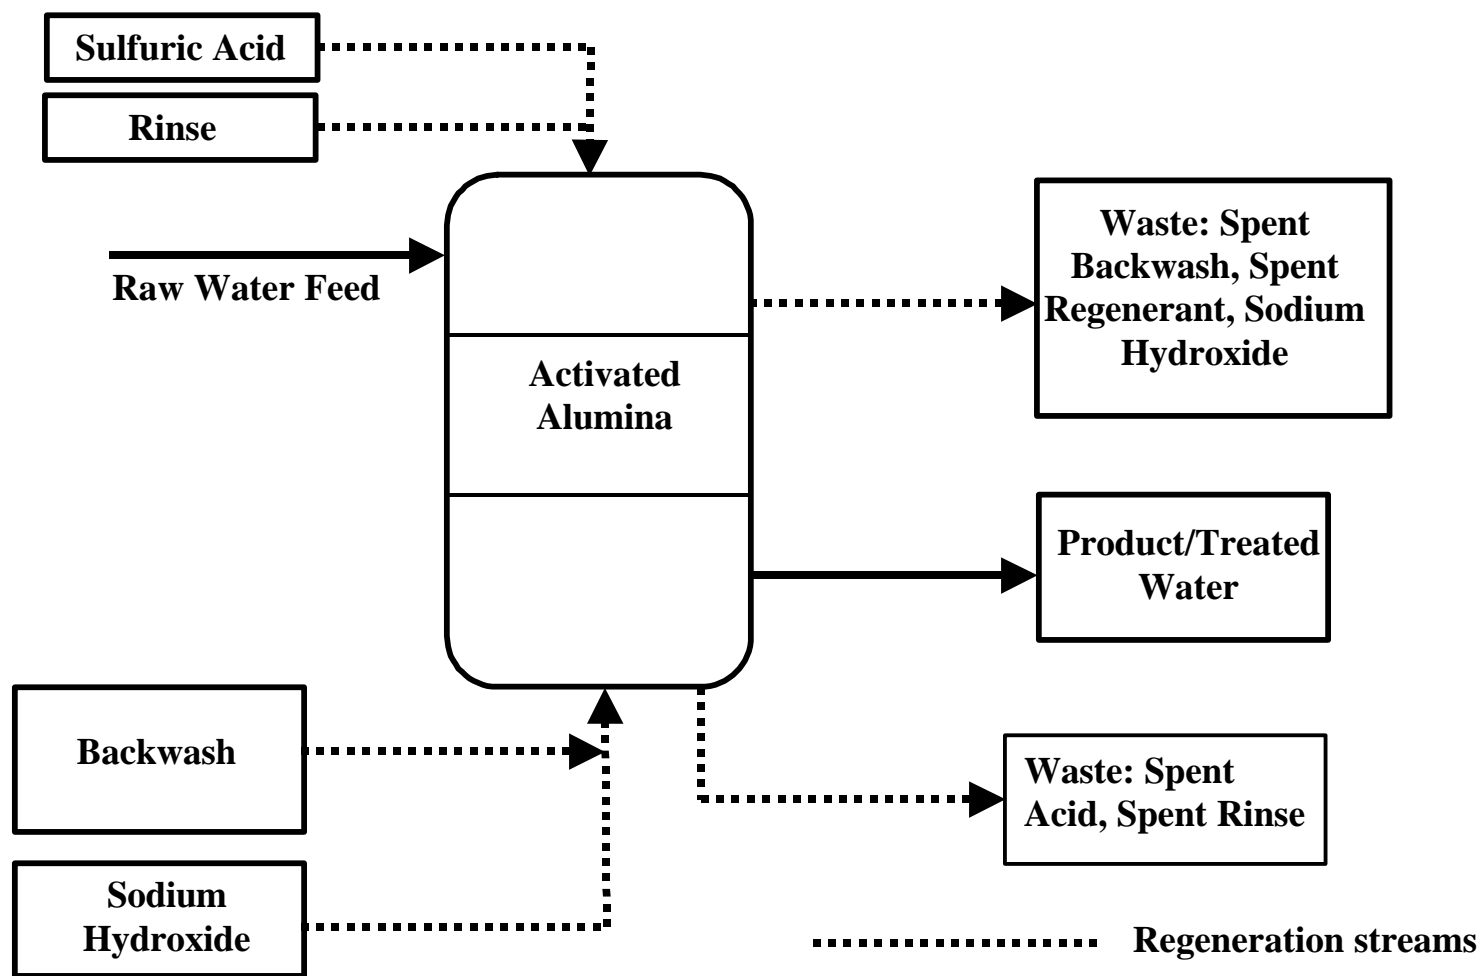


**Figure 10.** Typical Activated Alumina Treatment Process Diagram (Adapted from U.S. EPA,2000a)

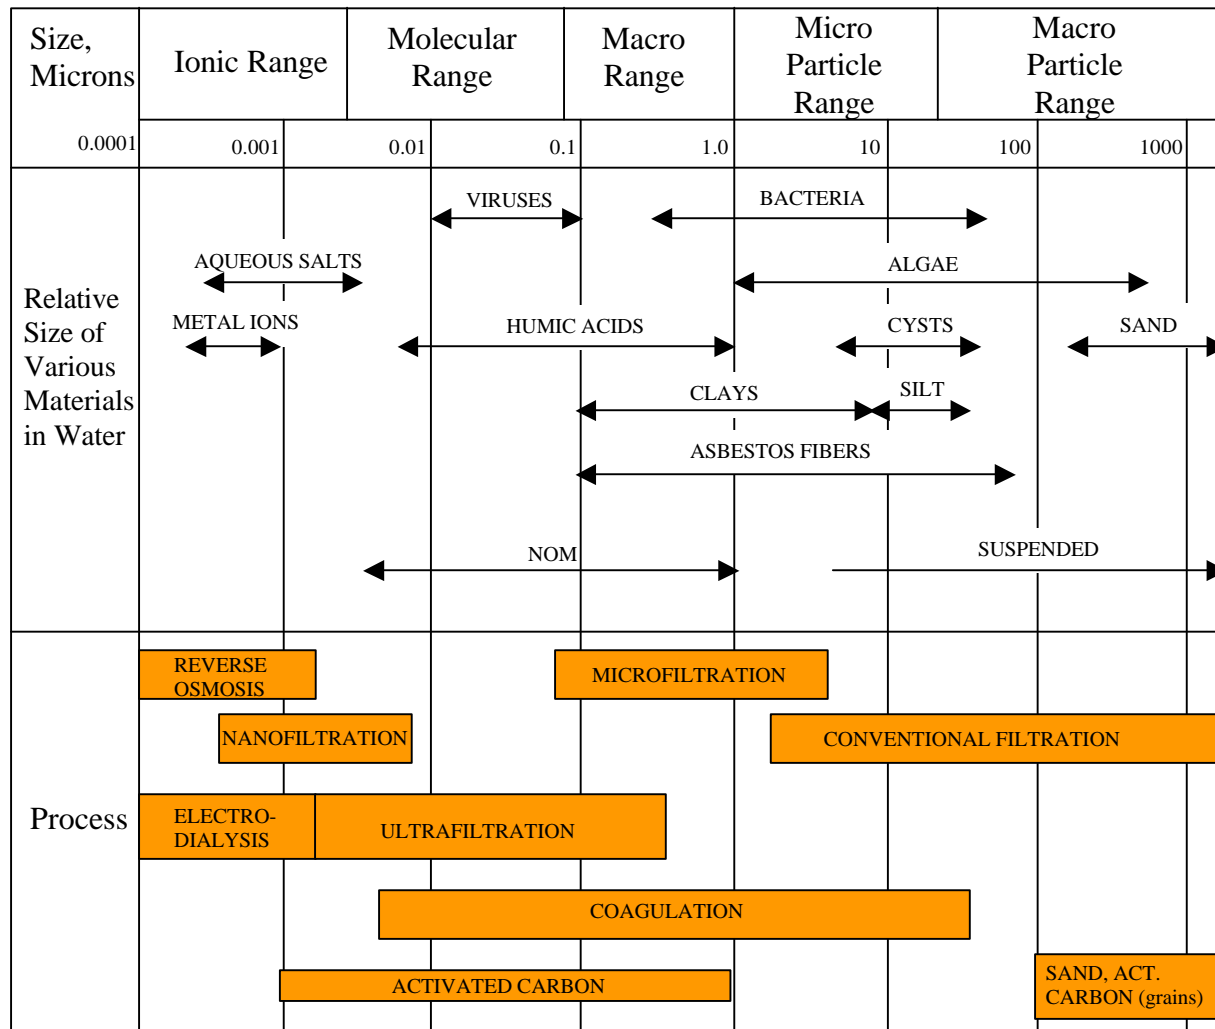

**Figure 11.** Size Ranges of Membrane Processes and Contaminants (Adapted from Taylor and Wiesner, 1999)

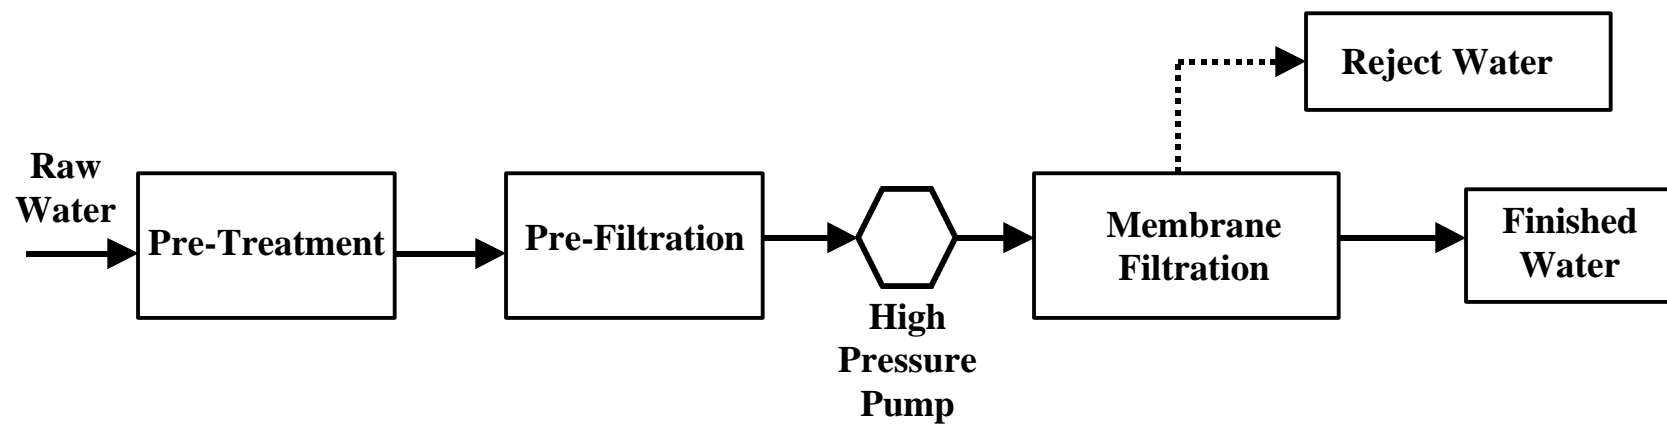


**Figure 12.** Typical NF/RO/EDR Membrane Filtration Treatment Process Diagram (Adapted from U.S. EPA, 2000a)

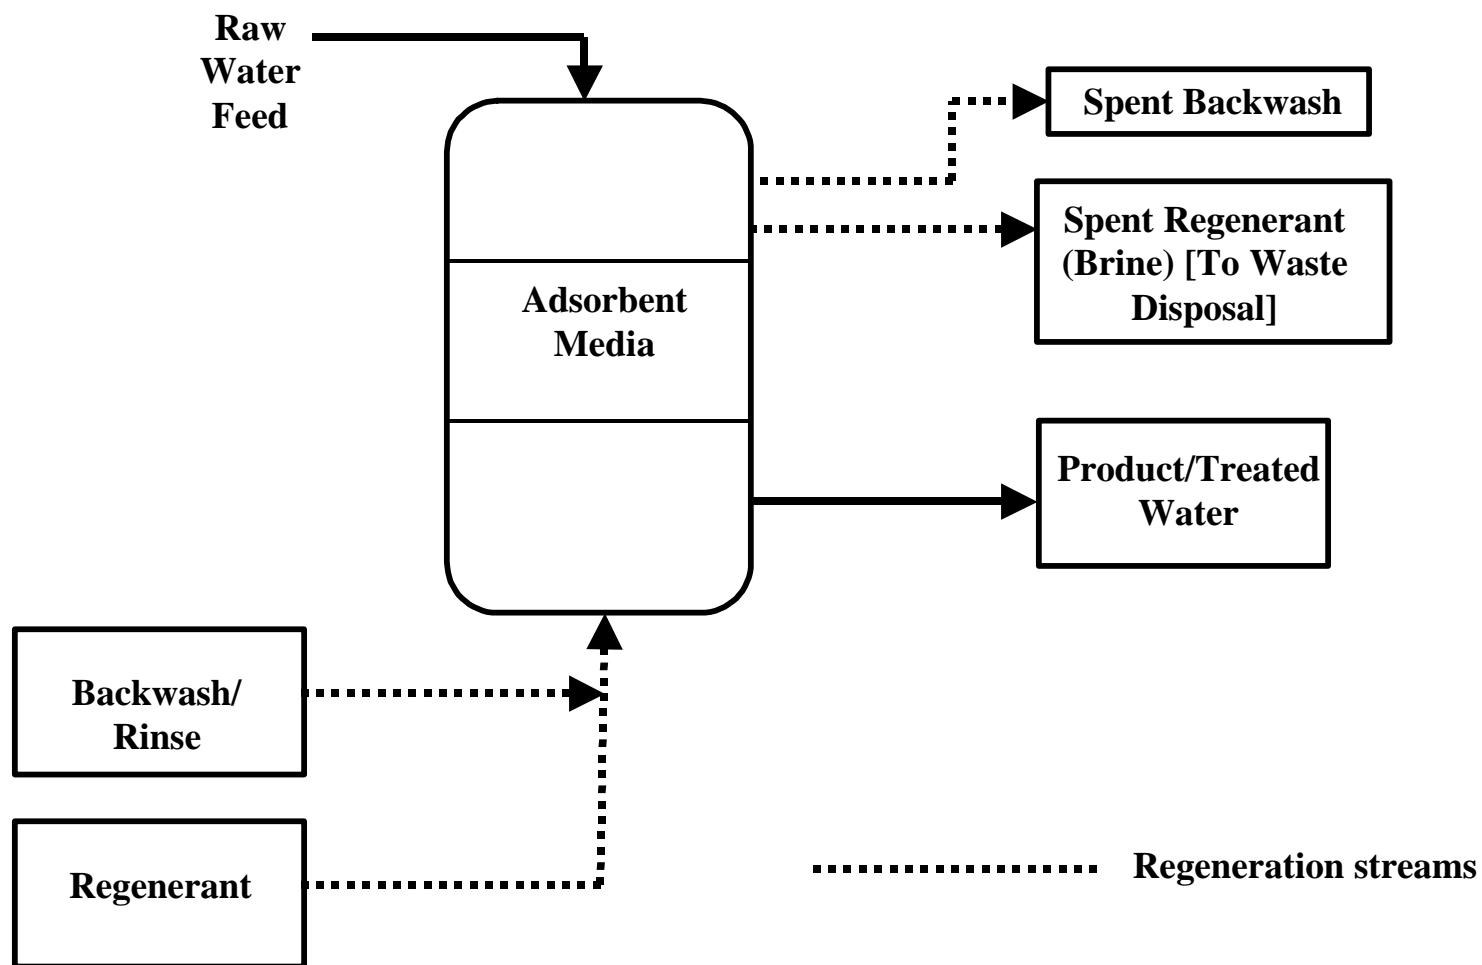


**Figure 13.** Typical Media Adsorption Treatment Process Diagram (Adapted from U.S. EPA, 2000a)




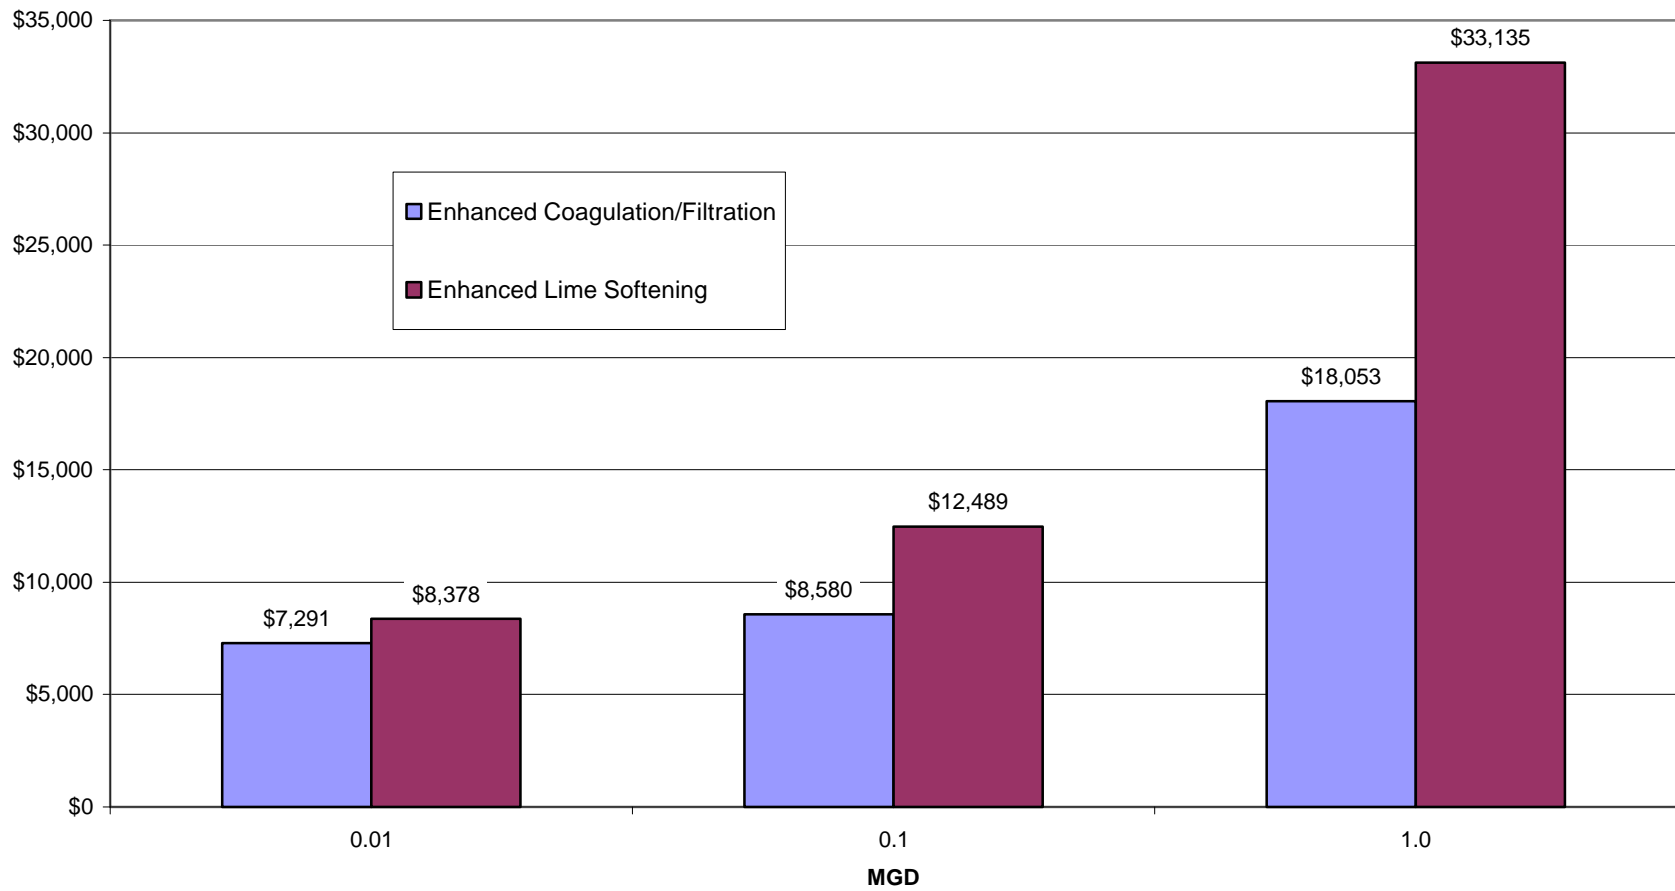


**Figure 14.** Enhanced Coagulation/Filtration and Enhanced Lime Softening Capital Costs

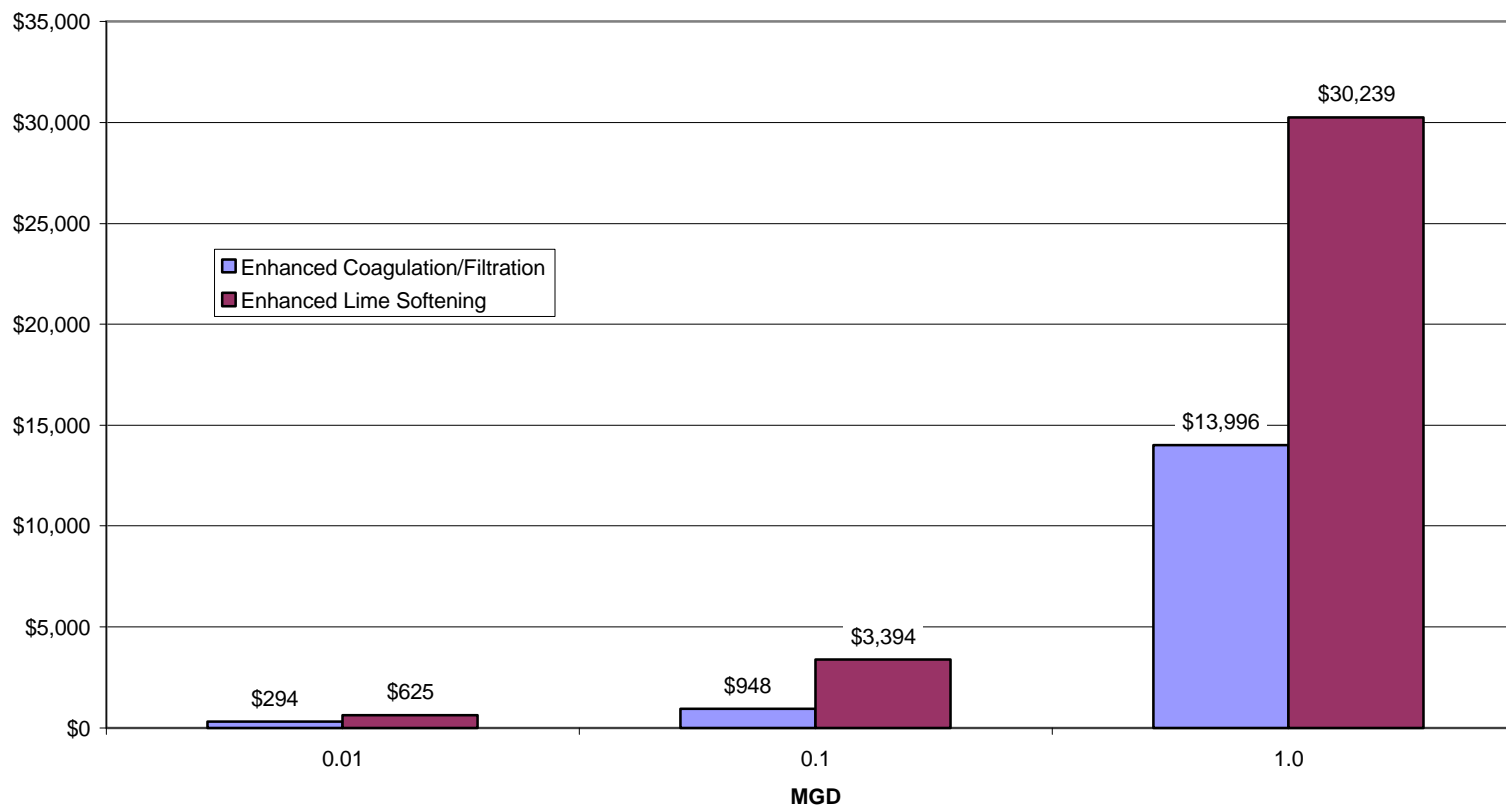


**Figure 15.** Enhanced Coagulation/Filtration and Enhanced Lime Softening O&M Costs

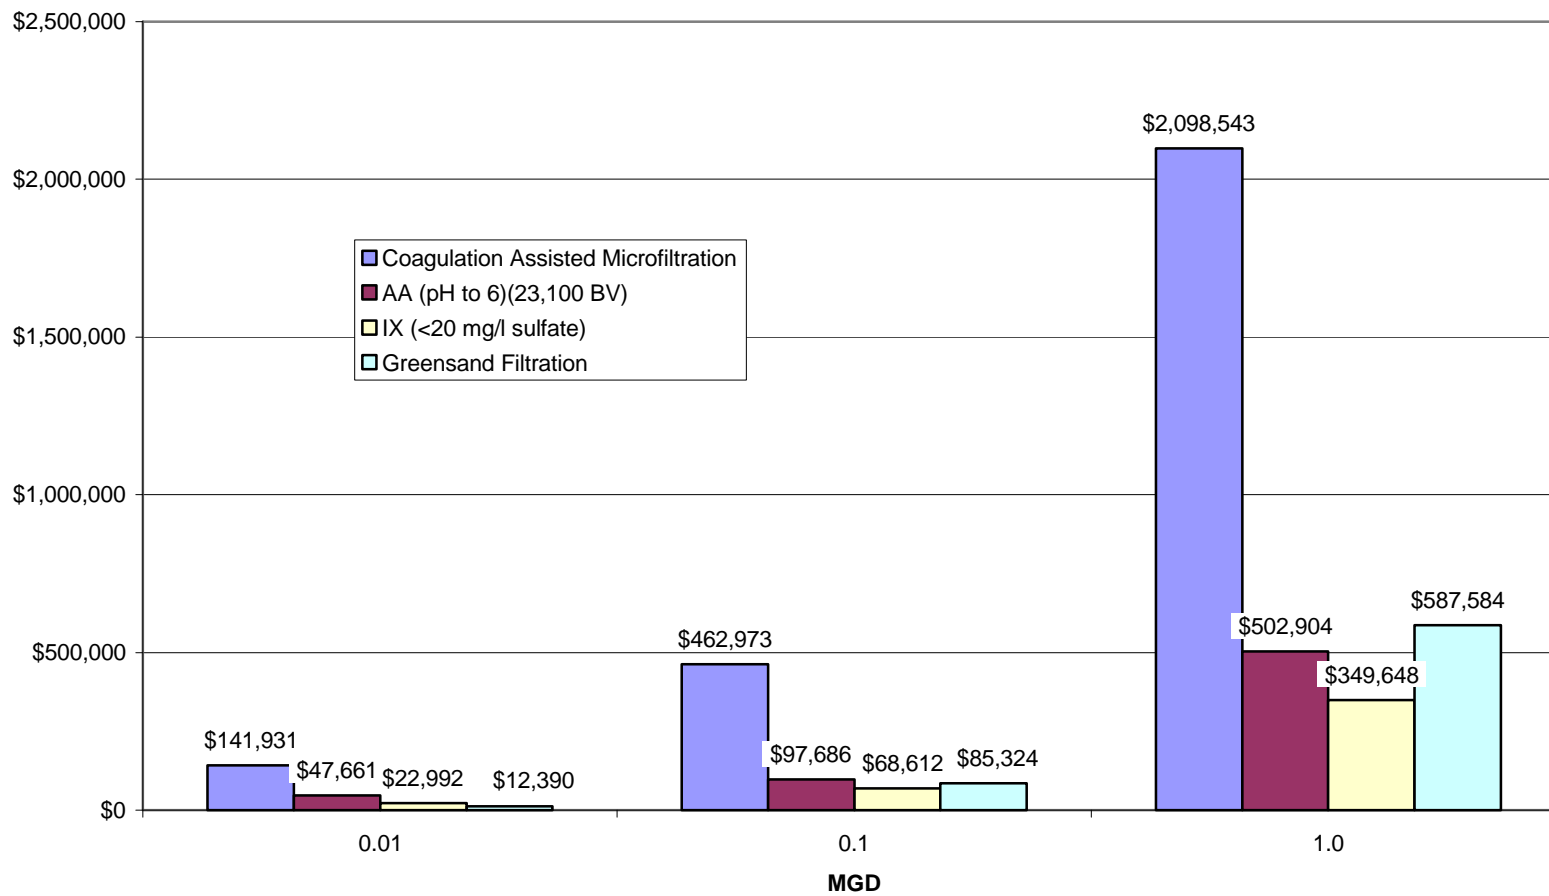


**Figure 16.** C/MF, AA, IX, and Greensand Filtration Capital Costs

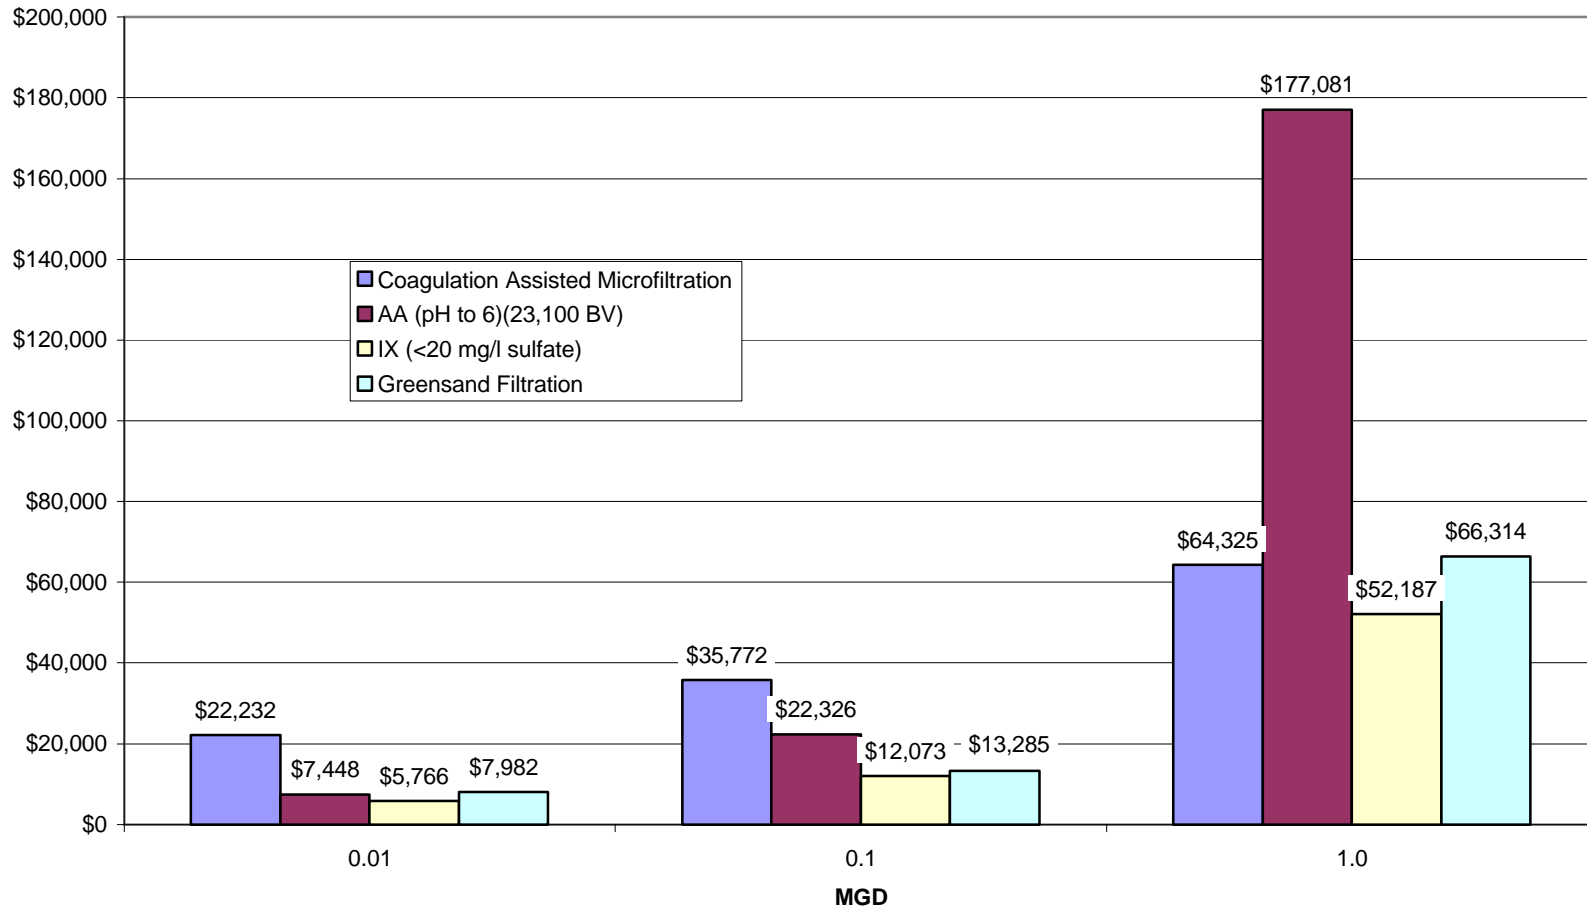


**Figure 17.** C/MF, AA, IX, and Greensand Filtration O&M Costs

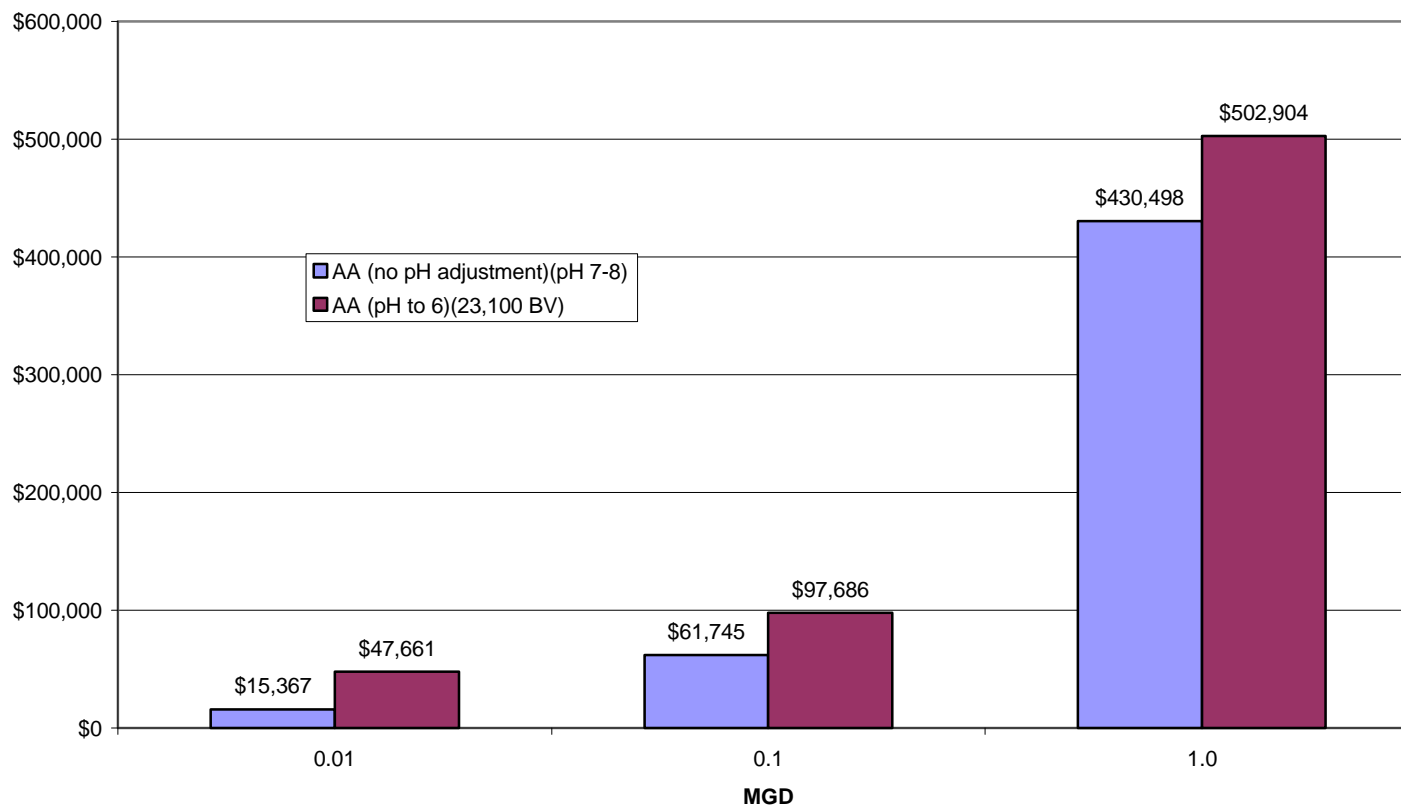

**Figure 18.** AA With and Without pH Adjustment Capital Costs

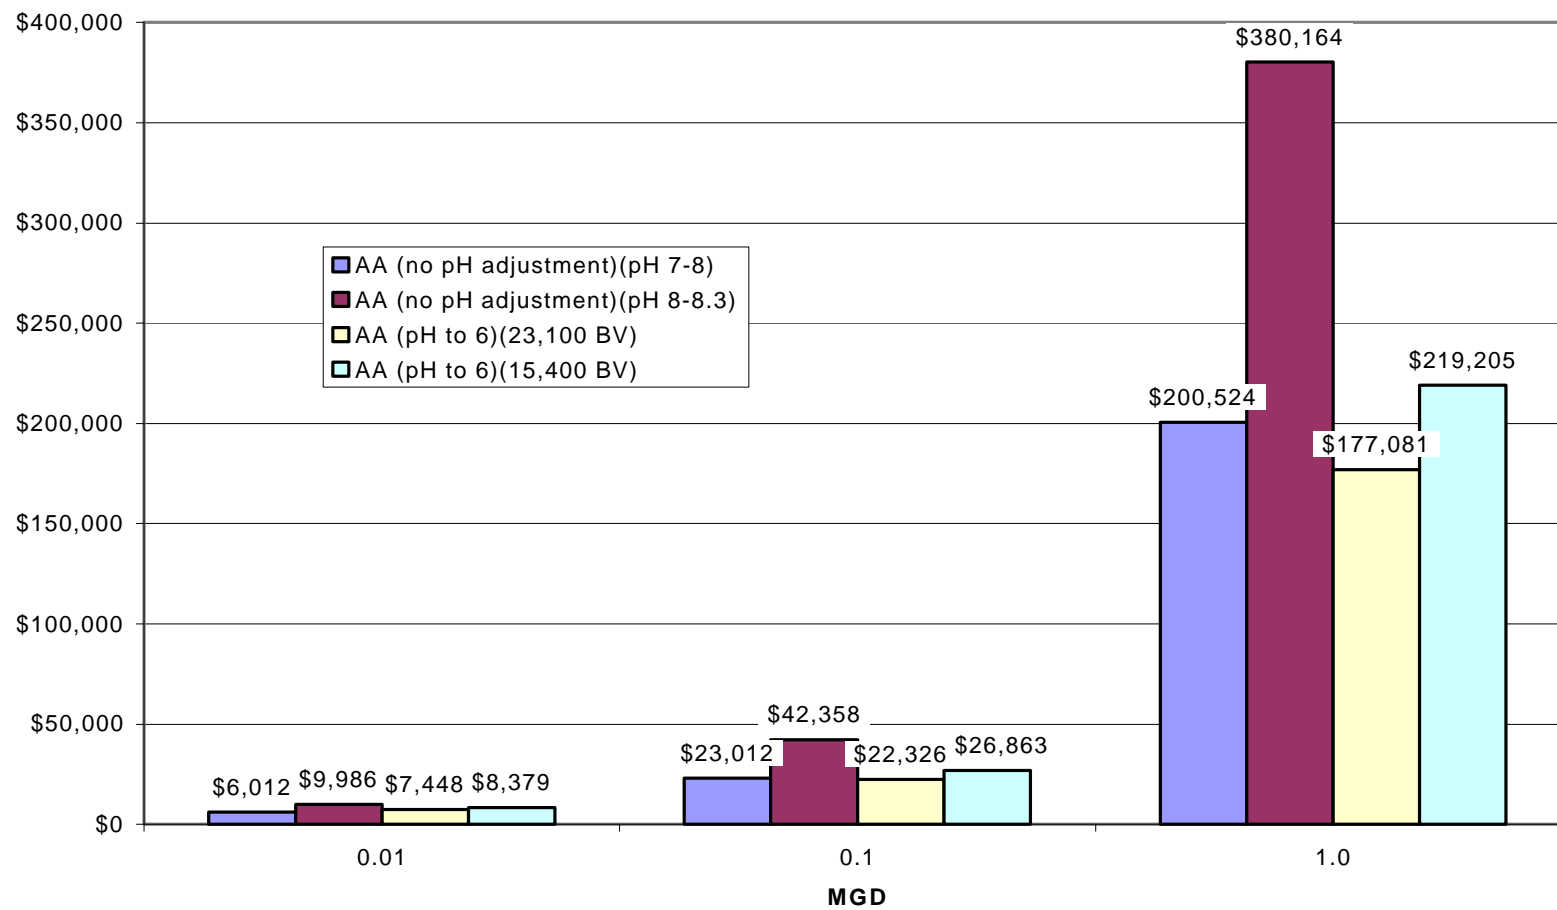

**Figure 19.** AA With and Without pH Adjustment O&M Costs

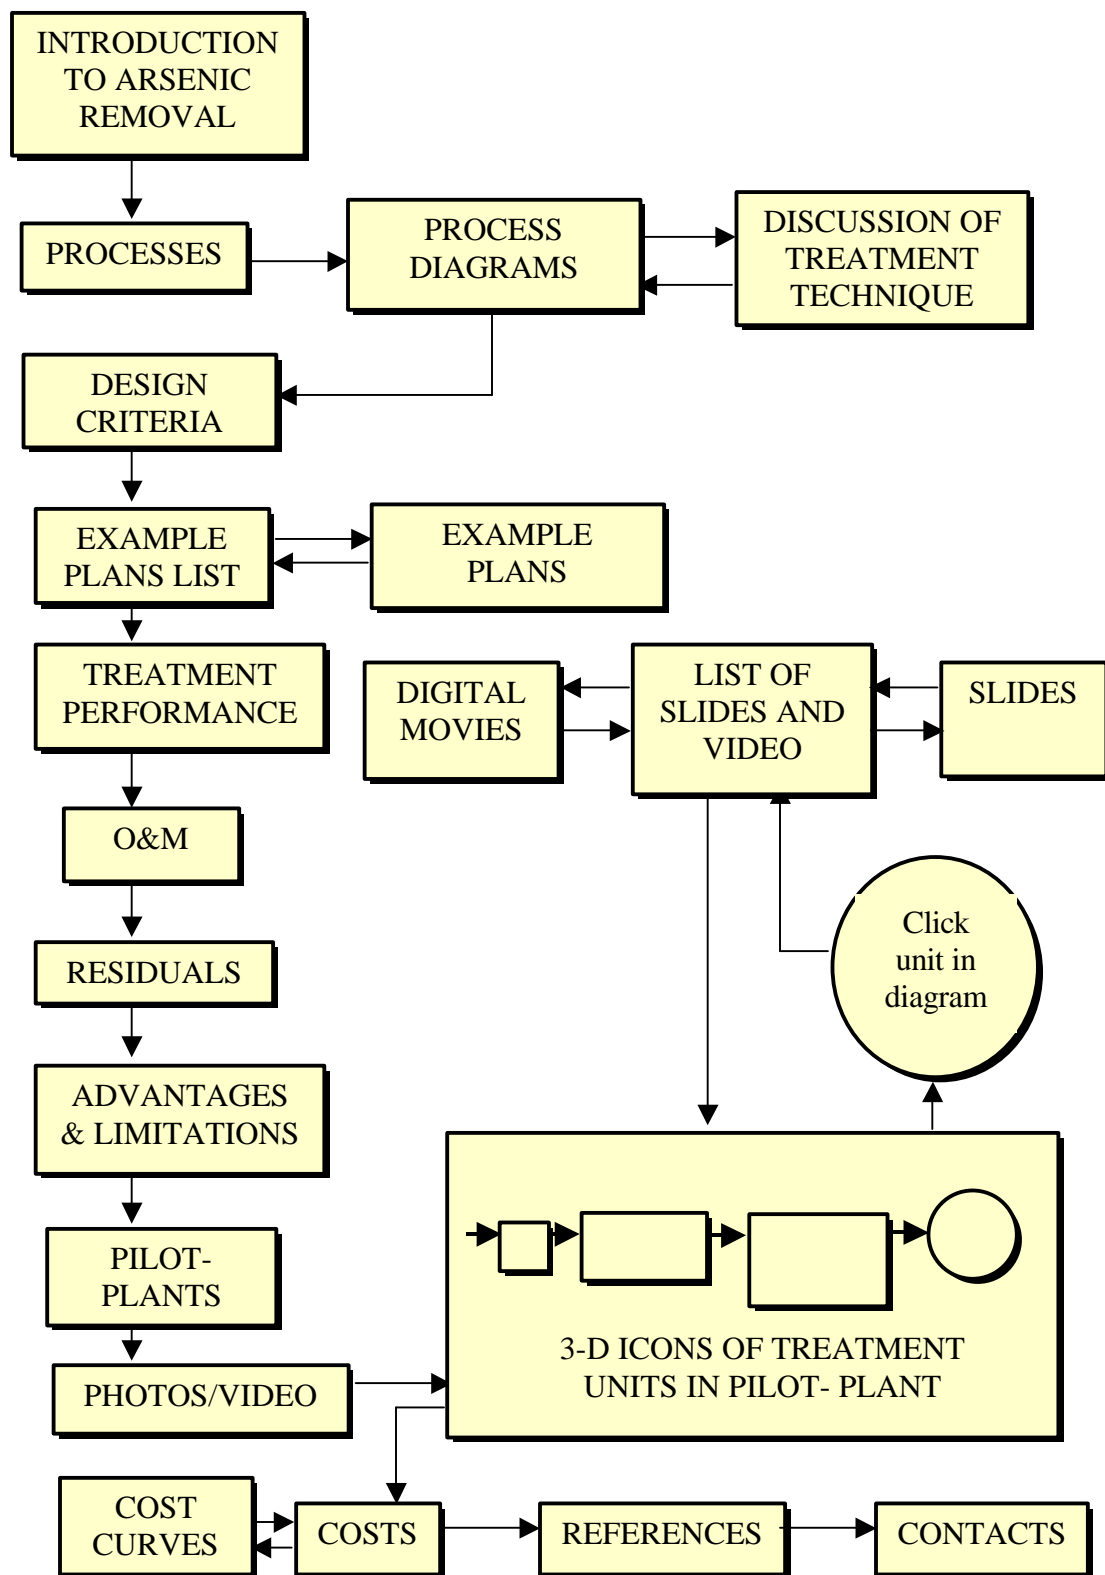

**Figure 20.** Flow Chart of Arsenic Removal Module

**APPENDIX C**

**CORRESPONDENCE WITH PILOT-PLANT OWNERS**



December 18, 2000

Mr. Ramesh Narasimhan, P.E.  
Narasimhan Consulting Services  
3150 N. 24<sup>th</sup> Street, Suite D-104  
Phoenix, Arizona 85016

Re: Visit to Phoenix pilot-plant facility

Dear Mr. Narasimhan:

I believe that Greg Harrison, who is working for me on a project, talked with you about visiting one of NCS's projects, the City of Phoenix pilot-plant arsenic removal facility. Our purpose in visiting the facility is to take photos and video of the plant. The photos and video will be incorporated into an educational CD-ROM on small water supply technology. This work is funded through a grant provided by the University of New Hampshire's Small Public Water Supply Technology Assistance Center which is a new center funded by the U.S. Environmental Protection Agency and managed by Robin Collins. We will develop CD-ROM's on two other small water system technologies as well including slow sand filtration and iron and manganese control. We have already visited slow sand filtration plants in Vermont and New Hampshire, and visited Fe/Mn removal and sequestration plants in Ohio. These CD-ROM's will be distributed to federal and state regulatory agencies and several national and regional water system associations and societies. It is planned that these educational CD-ROMs will also be made available to small water systems, engineers and others at a reasonable cost through a professional society or other means. We will certainly give you a complimentary copy of the arsenic removal CD-ROM. We are very excited about developing a CD-ROM on arsenic removal and are very grateful to you for allowing us to use your facility in the CD.

I believe that Greg Harrison will make arrangements to visit your facilities within the next few weeks. His preliminary schedule is to visit the facility in late January 2001, probably either Monday, January 29<sup>th</sup> or Tuesday, January 30<sup>th</sup>, if those dates are suitable to the facilities involved. He hopes to take pictures of all the treatment processes, adsorbents, controls, chemical feed facilities, wells, etc., that may be a part of the pilot-plant facility. I hope that we can photograph and video the plants in operation and possibly the media being regenerated during our visit. Most people are shy about wanting to record any comments on videotape, but if you or any of the personnel wanted to make any comments on videotape about the challenges and future of small water systems while Greg is there, we would welcome them.

I have also included a copy of the permission to use form for the photos which we have used previously on other site visits to treatment facilities. This may be helpful to provide to the owner of the project to explain what the purpose of the photos and video will be.

Thanks again for your help.

Sincerely,

R. Bruce Robinson, Ph.D., P.E.  
Professor of Civil and Environmental Engineering  
Office: 865.974.7730      FAX: 865.974.2669      rbr@utk.edu

Copy: Greg Harrison

## **APPENDIX D**

### **PERMISSION TO USE PHOTOS & VIDEO FORM**

**RELEASE FORM FOR USING PHOTOS  
IN EDUCATIONAL WATER TECHNOLOGY CD-ROM's**

DATE: \_\_\_\_\_

NAME: \_\_\_\_\_

TITLE: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

We want to thank you for your hospitality in letting us take pictures and video at your water plant. As you may know, we are in the process of creating educational CD-ROM's on small water supply technology through a grant provided by the University of New Hampshire's Small Public Water Supply Technology Assistance Center which is a new center funded by the U.S. Environmental Protection Agency. The first three CD's will be on iron and manganese control, slow sand filtration, and arsenic removal. These CD-ROMs will be distributed to federal and state regulatory agencies and several national and regional water system associations and societies. It is planned that these educational CD-ROMs will also be made available to small water systems, engineers and others at a reasonable cost.

As part of these CD-ROM's, I would like permission to use the photos that we took that have you in them. The photos would of course be used in a professional manner. We can provide you copies of these photos if you so desire. To the extent that we can and is necessary, we will touch up the photos to remove glares, etc. and otherwise enhance their quality before incorporating them into the CD-ROM's.

I am requesting world rights to use these photos in the CD-ROM(s) and any future versions of the CD-ROM(s). Unless you request otherwise, we would identify you in the photos using your name and title as provided by you above.

If you are willing to grant us the requested permission, please sign the agreement block signed below, or send me your own signed agreement form. We may wish to convert all or some of the educational CD-ROM's to a web format so that anyone can view them online on the World Wide Web. I would like to ask your permission at this time to use the photos in this format as well and I have separated the two permission requests below.

I would like to thank you in advance for your willingness to provide permission to use the photos in our CD-ROM's and/or web site which should be a valuable resource for regulators, engineers, and water utilities. If you have any questions, please do not hesitate to call me.

Sincerely,

R. Bruce Robinson, Ph.D., P.E.  
Professor of Civil and Environmental Engineering  
Office: 865/974-7730      FAX: 865/974-2669  
E-mail: rbr@utk.edu

### **CD-ROM Agreement**

I hereby grant the above requested permission for use in the educational CD-ROM(s) as discussed herein.

Date: \_\_\_\_\_ Signature: \_\_\_\_\_  
\_\_\_\_\_

### **Web Site Agreement**

I hereby grant the above requested permission for use in the educational web site as discussed herein.

Date: \_\_\_\_\_ Signature: \_\_\_\_\_

**APPENDIX E**  
**STORYBOARD**

# SMALL PUBLIC WATER SYSTEM TECHNOLOGY GUIDES: Vol. I

Title screen and credits

Common frame for all  
pages in all CD's.

Frame choices: Pipes &  
joints?

Please click on one of the choices below with the right mouse  
button

About the Small Public Water Supply Assistance Center  
Technology Guides Series

Slow Sand Filtration  
Iron and Manganese Control  
Arsenic Removal

SPWS  
TAC



Help  
About  
Quit

Developed by the Small Public Water Supply Technology Assistance  
Center,

The University of New Hampshire, Durham, NH

Funded through a grant from the United States Environmental Protection Agency, Grant No.

#####

LOGO  
OF  
THE

Main menu page

UTK  
LOG

# ARSENIC REMOVAL: APPLICATION AND PRACTICE FOR SMALL WATER SYSTEMS

## Introduction

- Processes description
- Design criteria
- Example plans/specs
- Performance
- Operation
- Automation
- Advantages,
- Limitations
- & Concerns
- Pilot-plants
- Costs
- References
- Contacts & facilities
- Virtual tour of Phoenix
- & Tucson pilot-plants

## Overview and statement of objectives

### Narrative:



Include mostly text from introduction in thesis here.

DIRECTI

NEXT →

EXIT



LOGO  
OF  
THE

Process description main page

UTK  
LOG

## ARSENIC REMOVAL: PROCESSES DESCRIPTION

Introduction

Processes description

IX

AA

Enhanced C/F

Enhanced LS

Fe Removal

Membranes

Innovative Ads Tech

Design criteria

Example plans/specs

Performance

Operation

Automation

Advantages,

Limitations

& Concerns

Pilot-plants

Costs

References

Contacts & facilities

Virtual tour of Phoenix  
& Tucson pilot-plants

### Overview:

This page will have a general description of the various processes capable of efficient As removal. The menu on left will link to individual pages describing each process

INCE X01ADH

←BACK

NEXT→

EXIT

LOGO  
OF  
THE

## ARSENIC REMOVAL: Design Criteria

UTK  
LOG

Introduction  
Processes description  
**Design criteria**  
Example plans/specs  
Performance  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
References  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

Link to a table from thesis which lists typical  
design criteria for each process (EBCT, hyd  
load rates, depth media, etc).

INCE X01ADH

←BACK

NEXT→


EXIT

LOGO  
OF  
THE

UTK  
LOG

## ARSENIC REMOVAL: Example Plans and Specifications

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
References  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

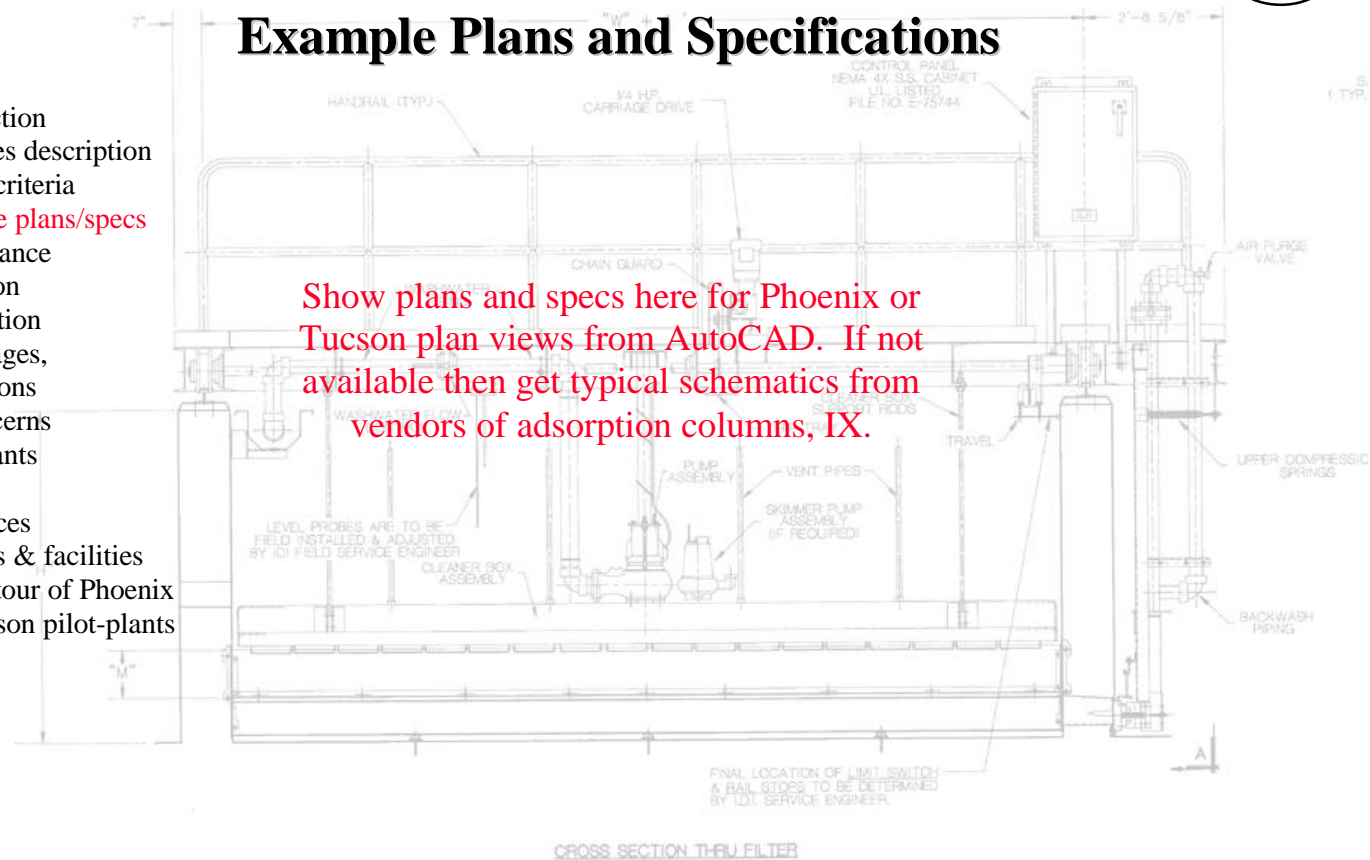

INCE X01ADH

←BACK

NEXT→


EXIT

LOGO  
OF  
THE

# ARSENIC REMOVAL: Performance

UTK  
LOG

Introduction  
Processes description  
Design criteria  
Example plans/specs  
**Performance**  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
References  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

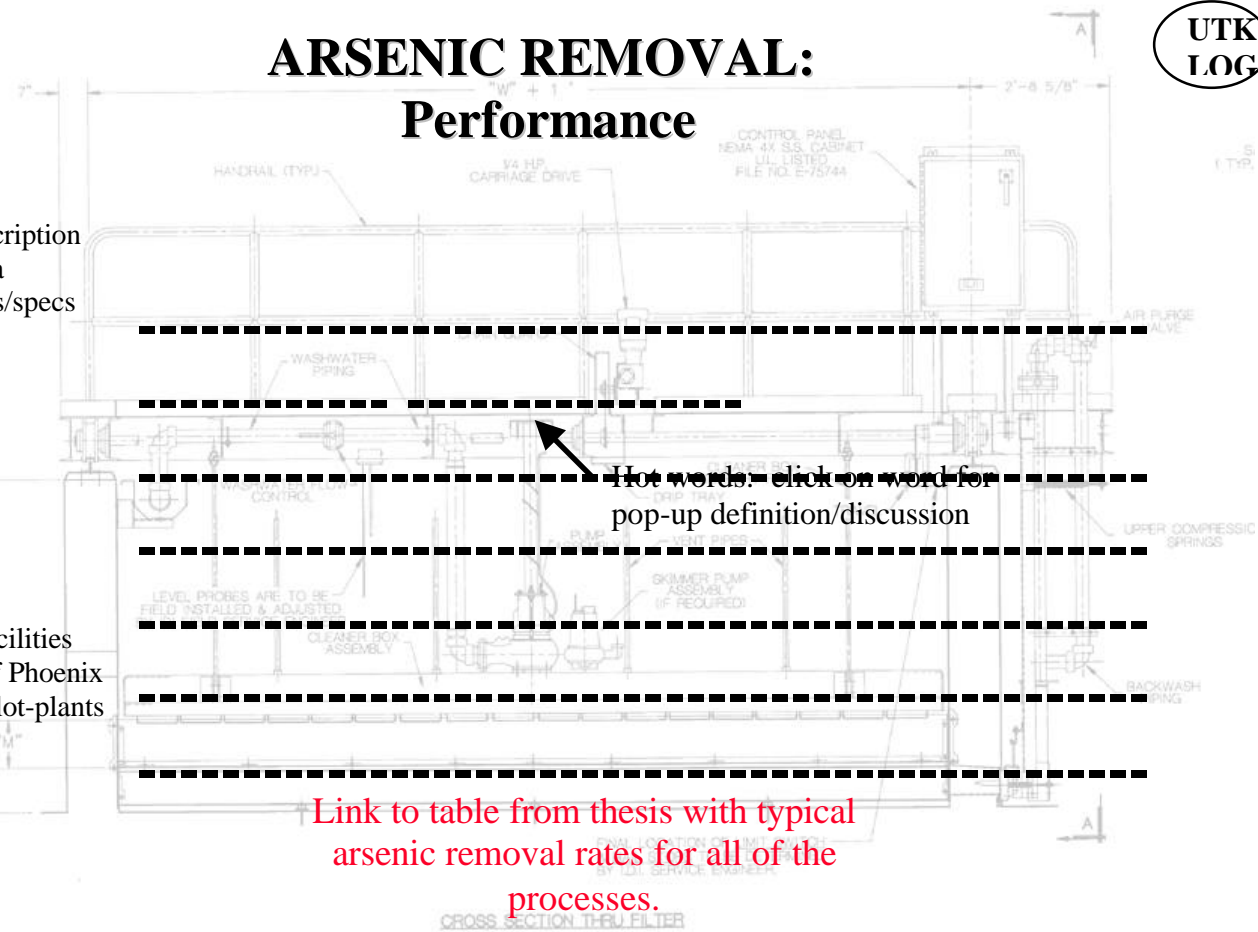

Hot words: click on word for  
pop-up definition/discussion

Link to table from thesis with typical  
arsenic removal rates for all of the  
processes.

INCE X01ADH

←BACK

NEXT→


EXIT

LOGO  
OF  
THE

UTK  
LOG

## ARSENIC REMOVAL: Operation

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
**Operation**  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
References  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

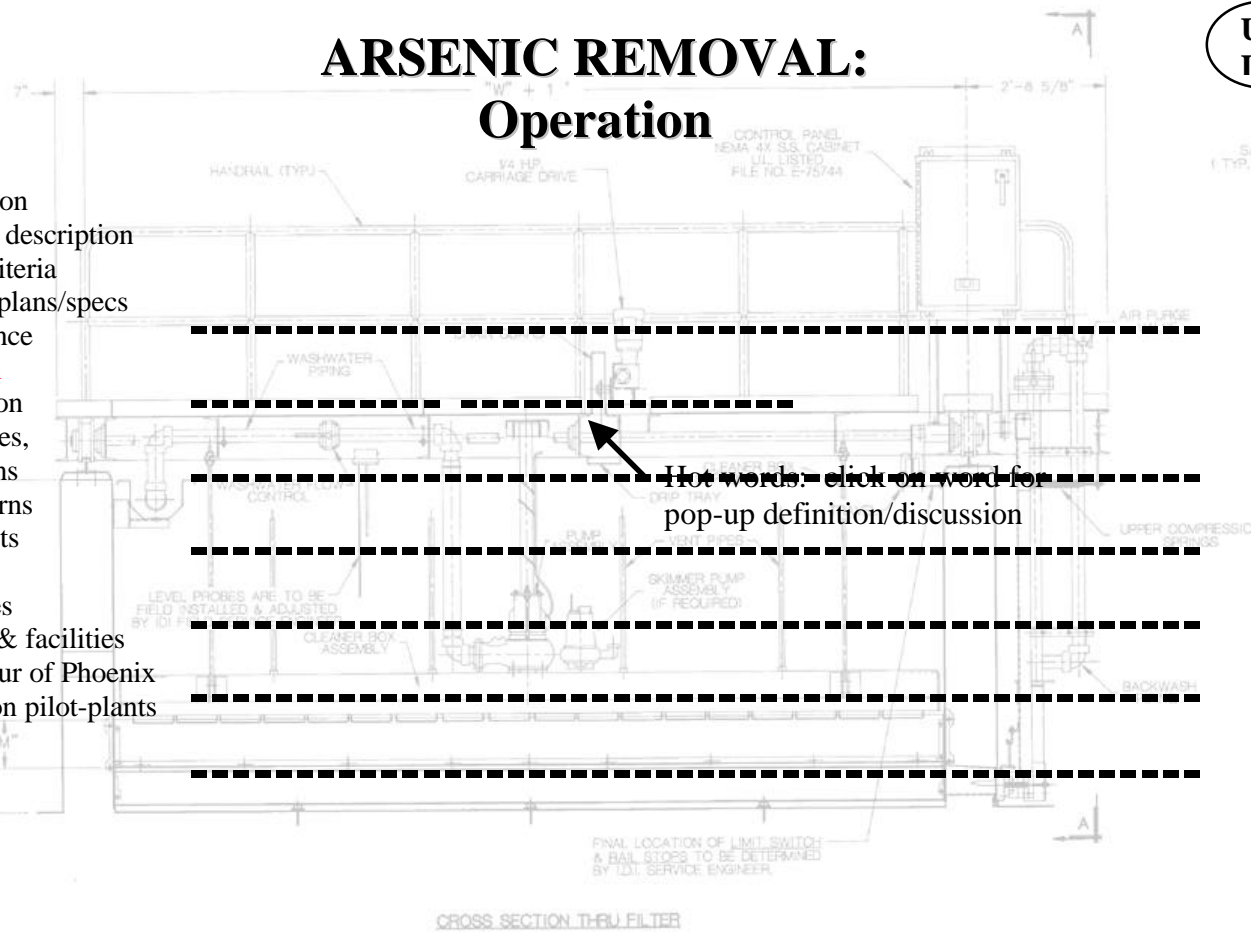

Hot words - click on word for  
pop-up definition/discussion

← BACK

NEXT →


EXIT

LOGO  
OF  
THE

UTK  
LOG

# ARSENIC REMOVAL: Automation

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
Operation  
**Automation**  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
References  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

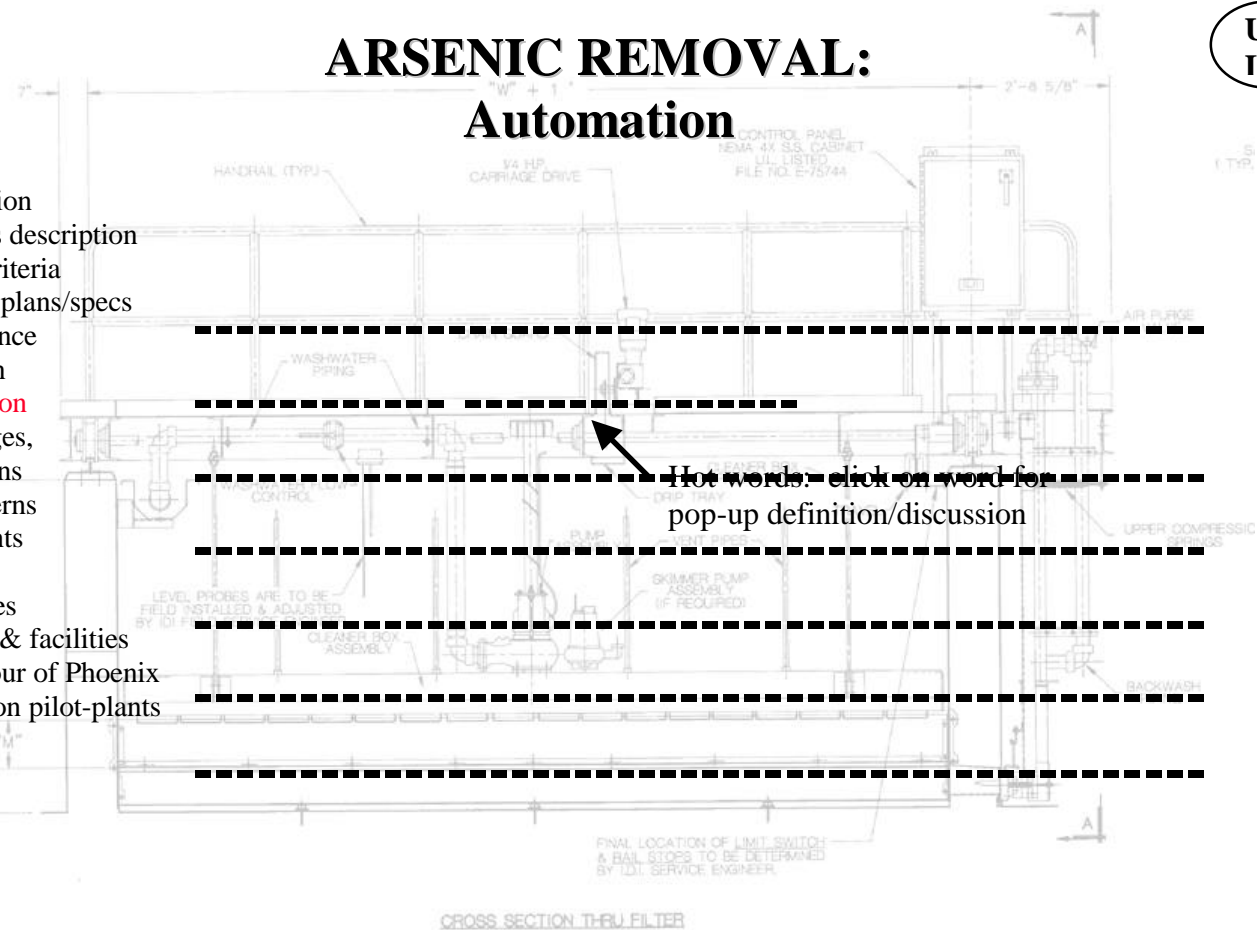

Hot words - click on word for  
pop-up definition/discussion

INCE X01ADH

←BACK

NEXT→


EXIT

LOGO  
OF  
THE

UTK  
LOG

## ARSENIC REMOVAL: Advantages, limitations and concerns

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
References  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

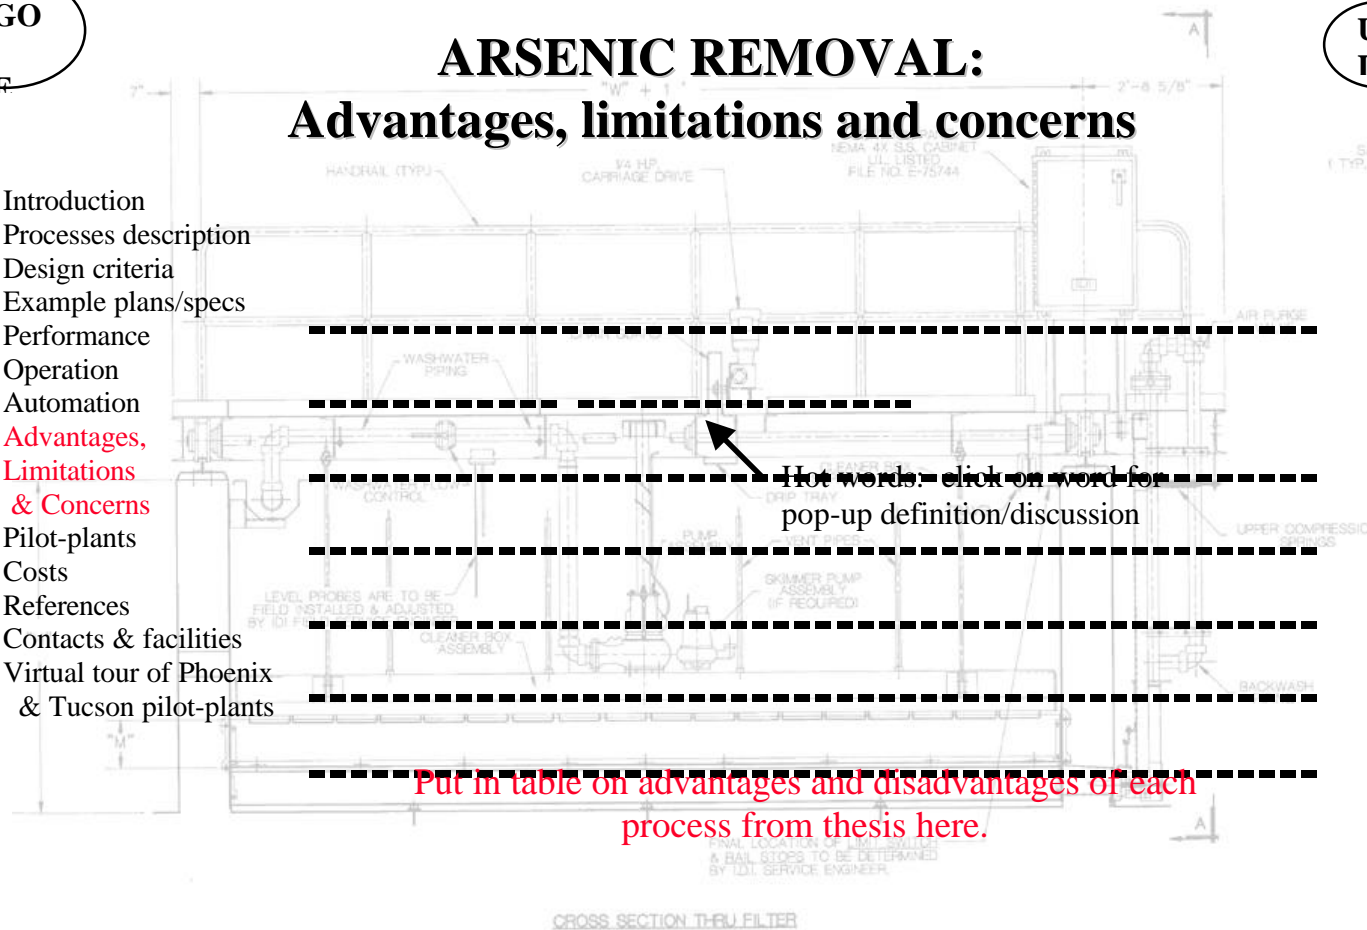

Put in table on advantages and disadvantages of each process from thesis here.

INCE X01ADH

←BACK

NEXT→


EXIT

LOGO  
OF  
THE

UTK  
LOG

## ARSENIC REMOVAL: Pilot-Plants

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
**Pilot-plants**  
Costs  
References  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

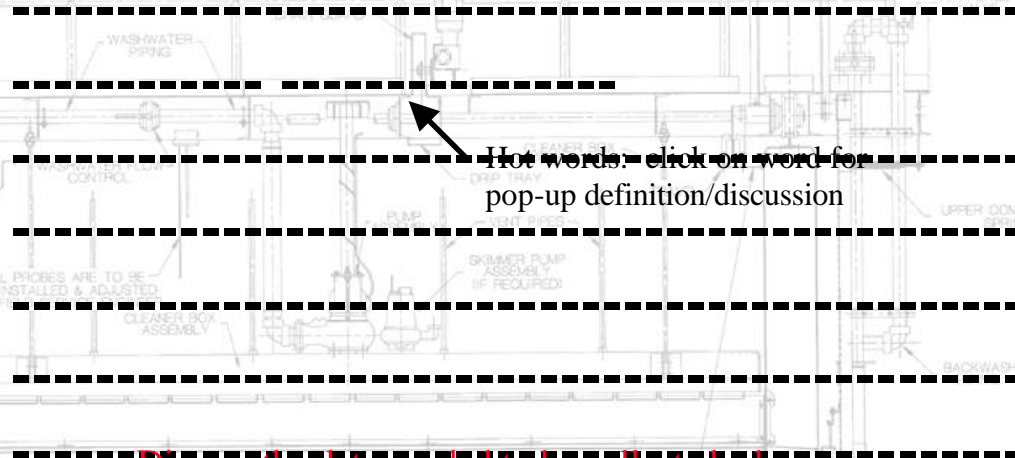

Hot words: click on word for  
pop-up definition/discussion

Discuss the data needed to be collected when  
using a pilot-plant. Discuss the Phoenix and  
Tucson projects.

INCE X01ADH

←BACK

NEXT→

EXIT




LOGO  
OF  
THE

# ARSENIC REMOVAL: Costs

UTK  
LOG

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
**Costs**  
References  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

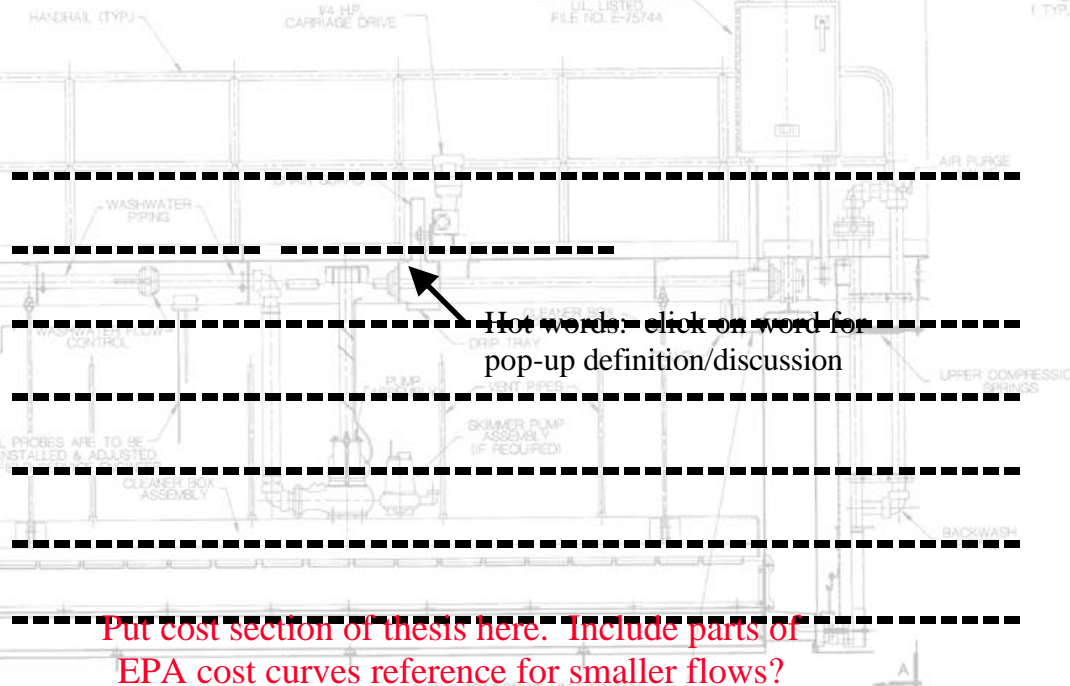

Hot words: click on word for  
pop-up definition/discussion

Put cost section of thesis here. Include parts of  
EPA cost curves reference for smaller flows?  
Link to table showing costs for each  
technology for a particular size design flow  
(1mgd?).

INCE X01ADH

←BACK

NEXT→

EXIT

LOGO  
OF  
THE

# ARSENIC REMOVAL: References

UTK  
LOG

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
**References**  
Contacts & facilities  
Virtual tour of Phoenix  
& Tucson pilot-plants

Put reference section of thesis herein scrolling  
list.

INCE X01ADH

←BACK

NEXT→


EXIT

LOGO  
OF  
THE

UTK  
LOG

## ARSENIC REMOVAL: Contacts and facilities

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
References  
**Contacts & facilities**  
Virtual tour of Phoenix  
& Tucson pilot-plants

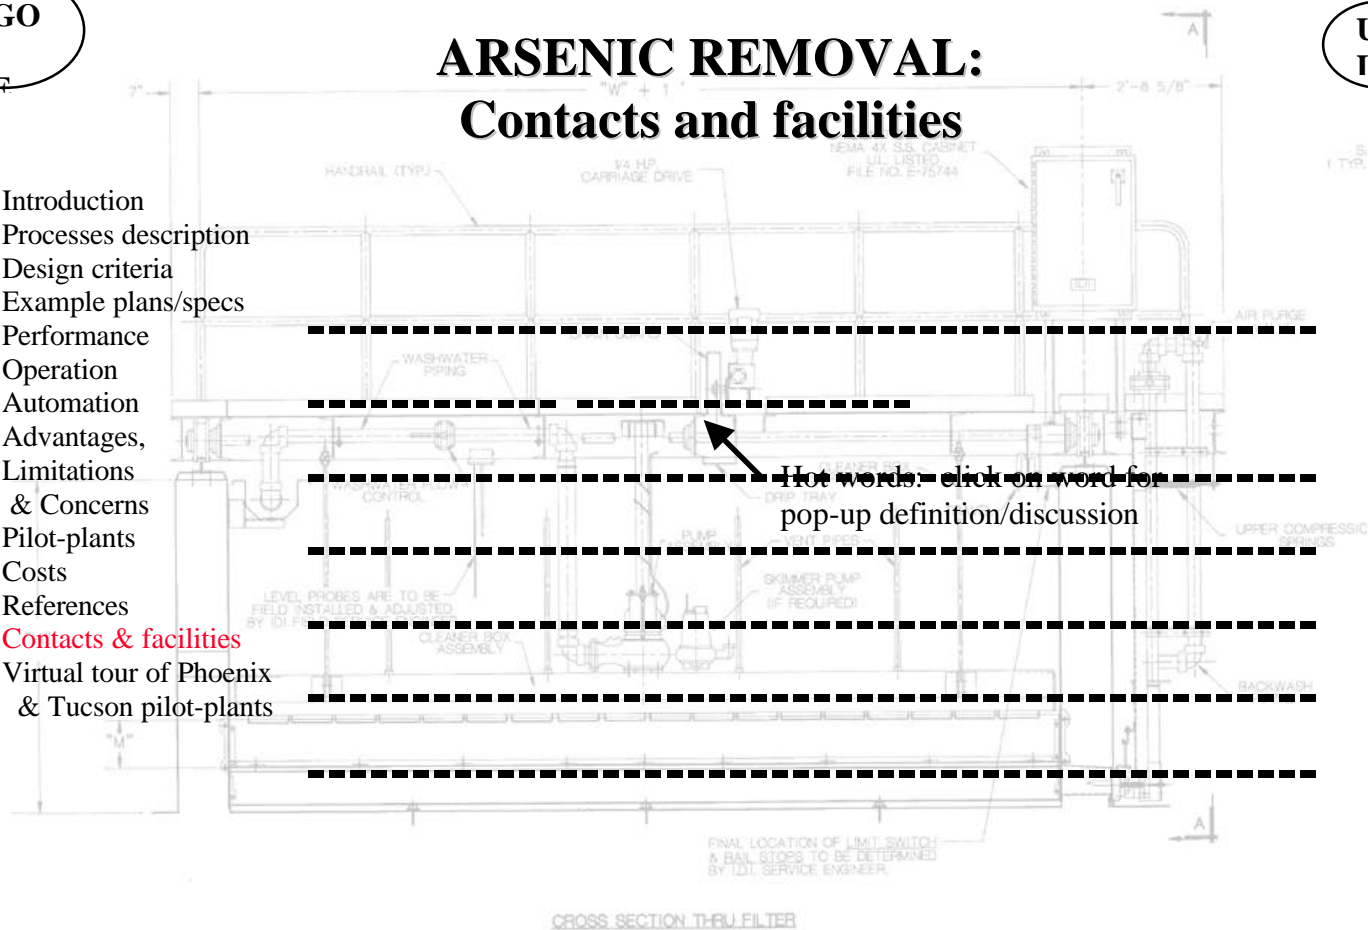

Hot words: click on word for  
pop-up definition/discussion

INCE X01ADH



EXIT

LOGO  
OF  
THE

UTK  
LOG

## ARSENIC REMOVAL: Virtual tour of Phoenix & Tucson pilot-plants

Introduction  
Processes description  
Design criteria  
Example plans/specs  
Performance  
Operation  
Automation  
Advantages,  
Limitations  
& Concerns  
Pilot-plants  
Costs  
References  
Contacts & facilities

Virtual tour of Phoenix  
& Tucson pilot-plants

Have PowerPoint illustrations of each of the processes  
at

Phoenix and Tucson here (5 process lines total).  
Clicking on each item will bring up list of photos and  
video available.

PHOTOS & VIDEO

Phoenix: adsorption columns  
Tucson: adsorption columns, ion  
exchange, ceramic media filtration,  
fluidized sand

INCE X01ADH


←BACK


NEXT→

EXIT


**APPENDIX F**

**SAMPLE AUTHORWARE PROGRAM SCREENS**

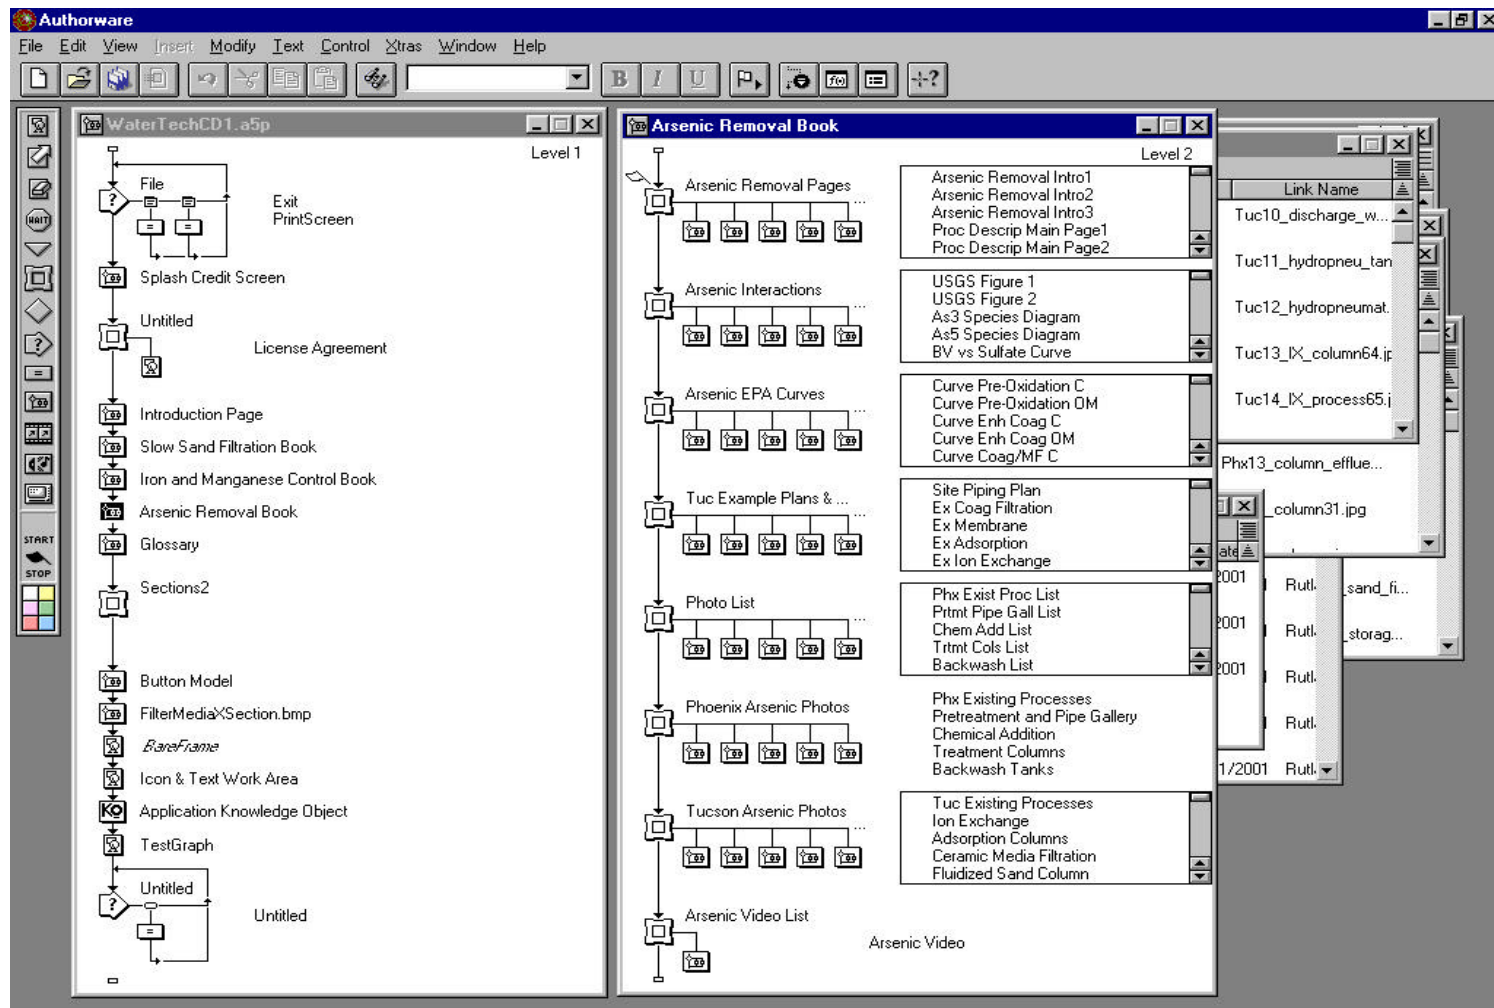


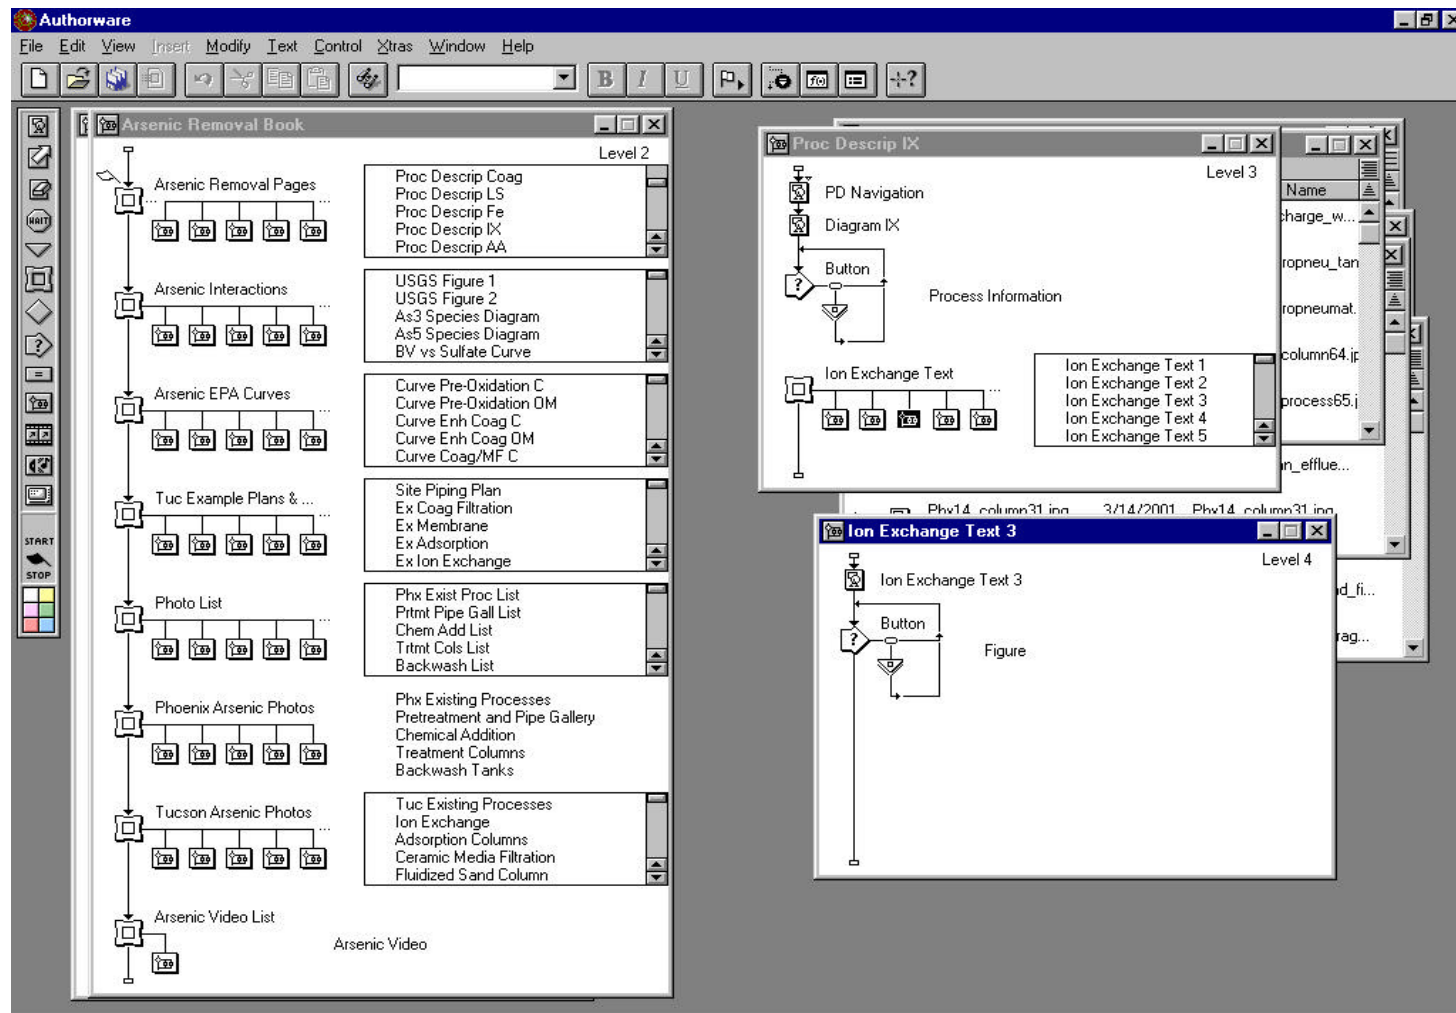




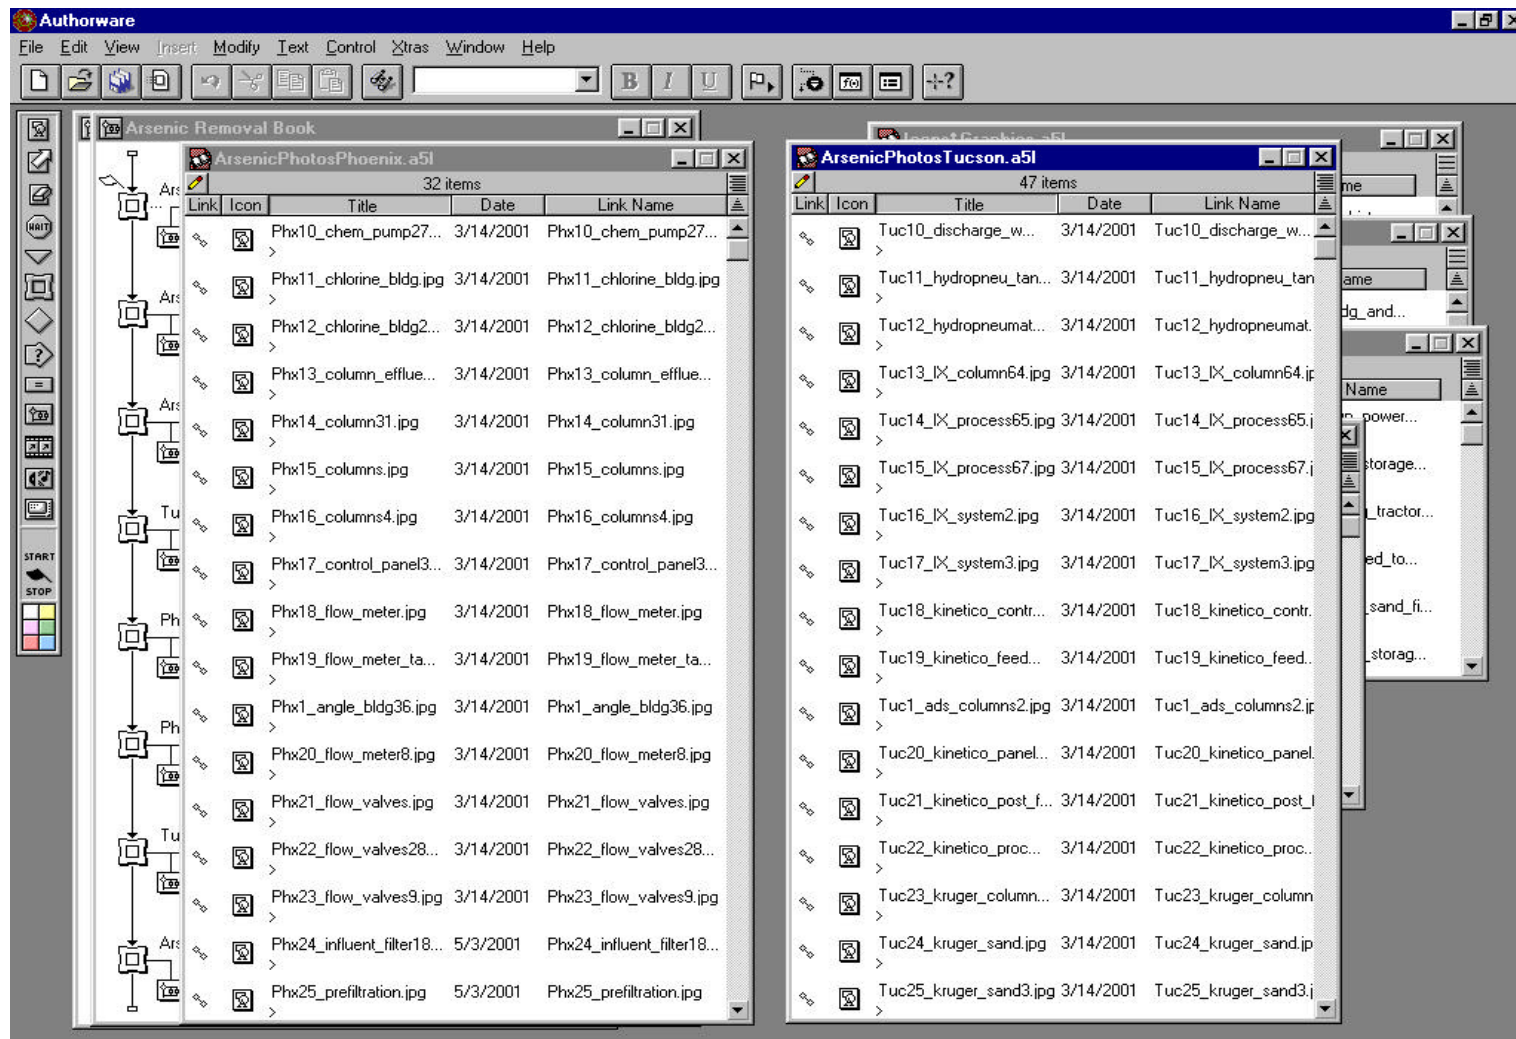




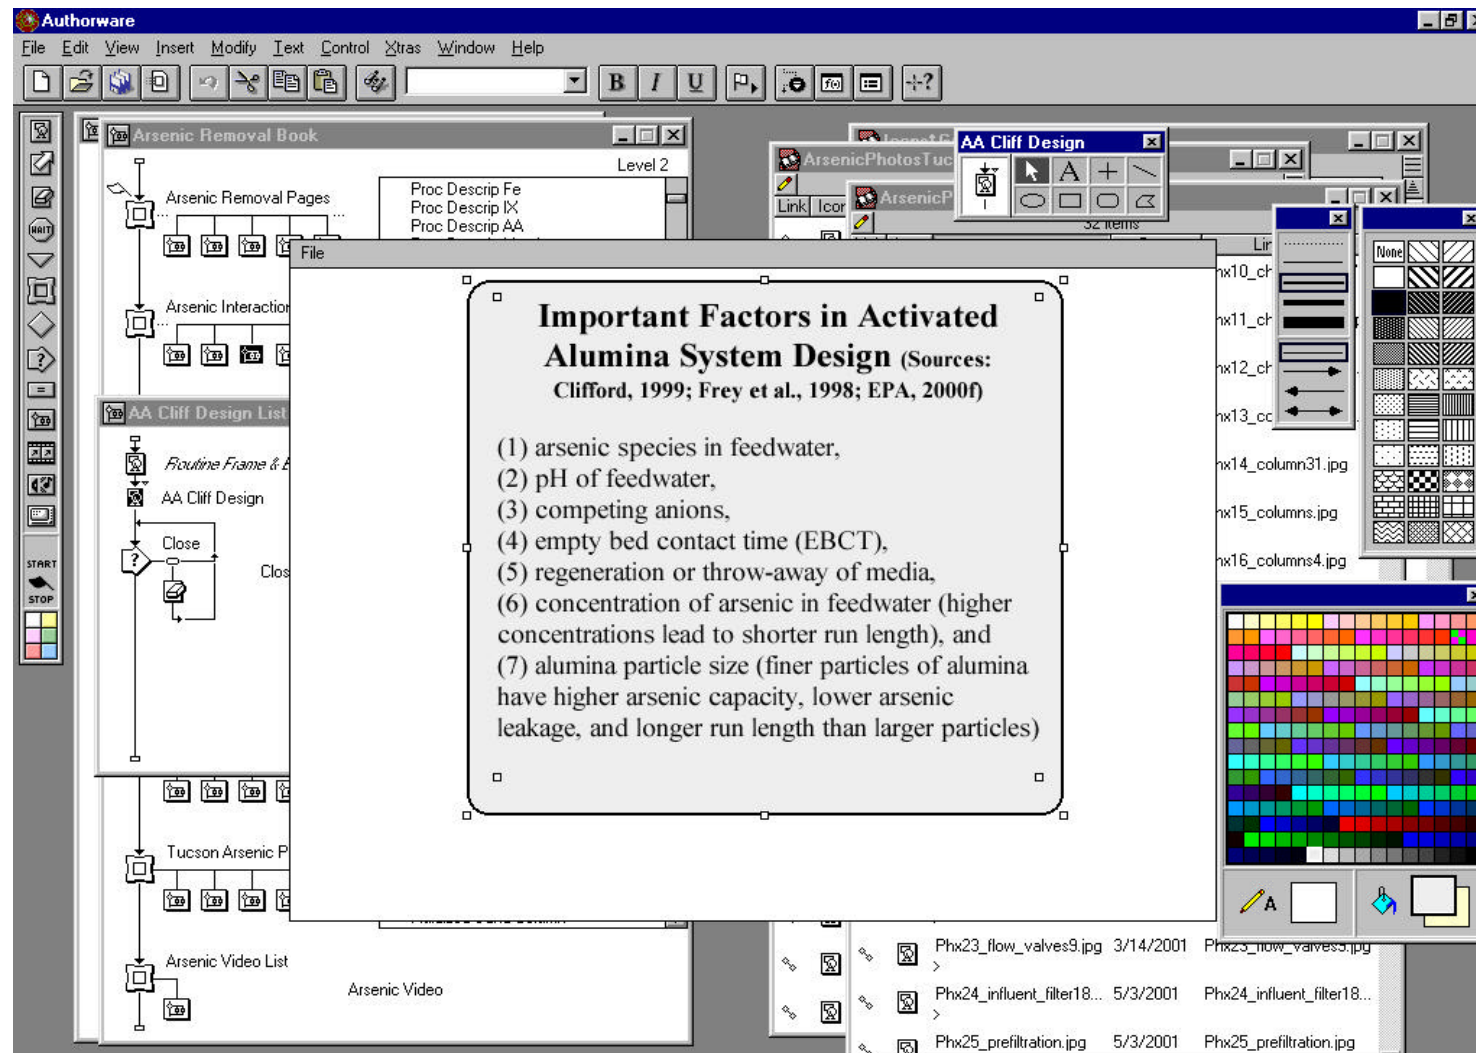

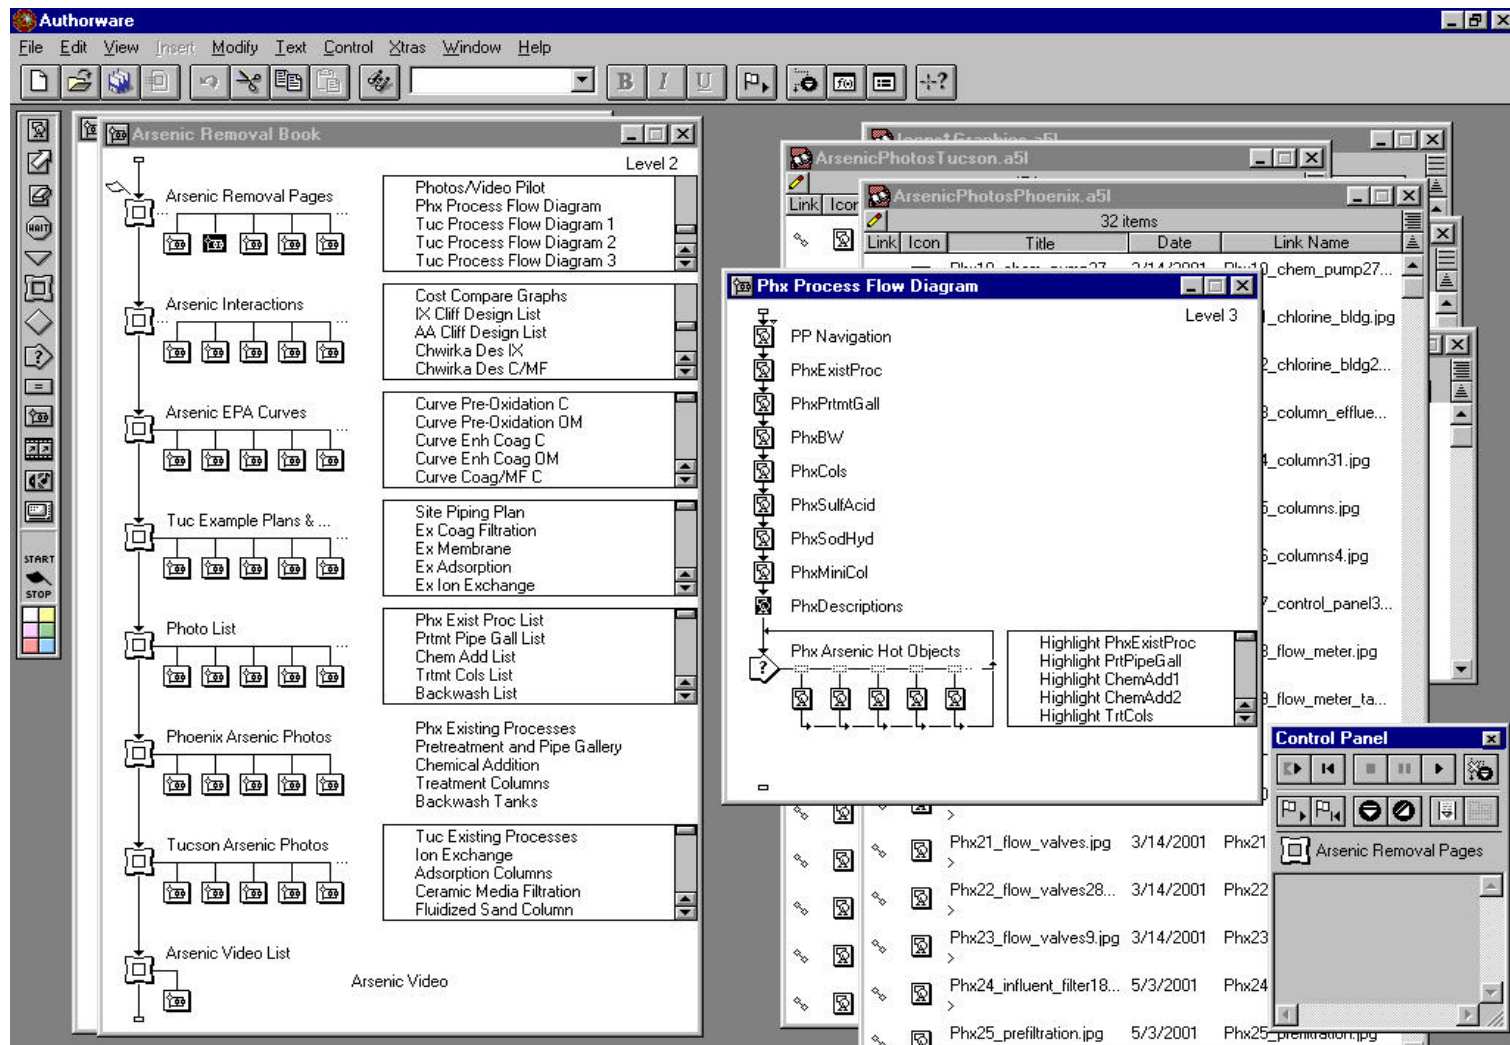

**APPENDIX G**

**ARSENIC MODULE SCREEN CAPTURES**

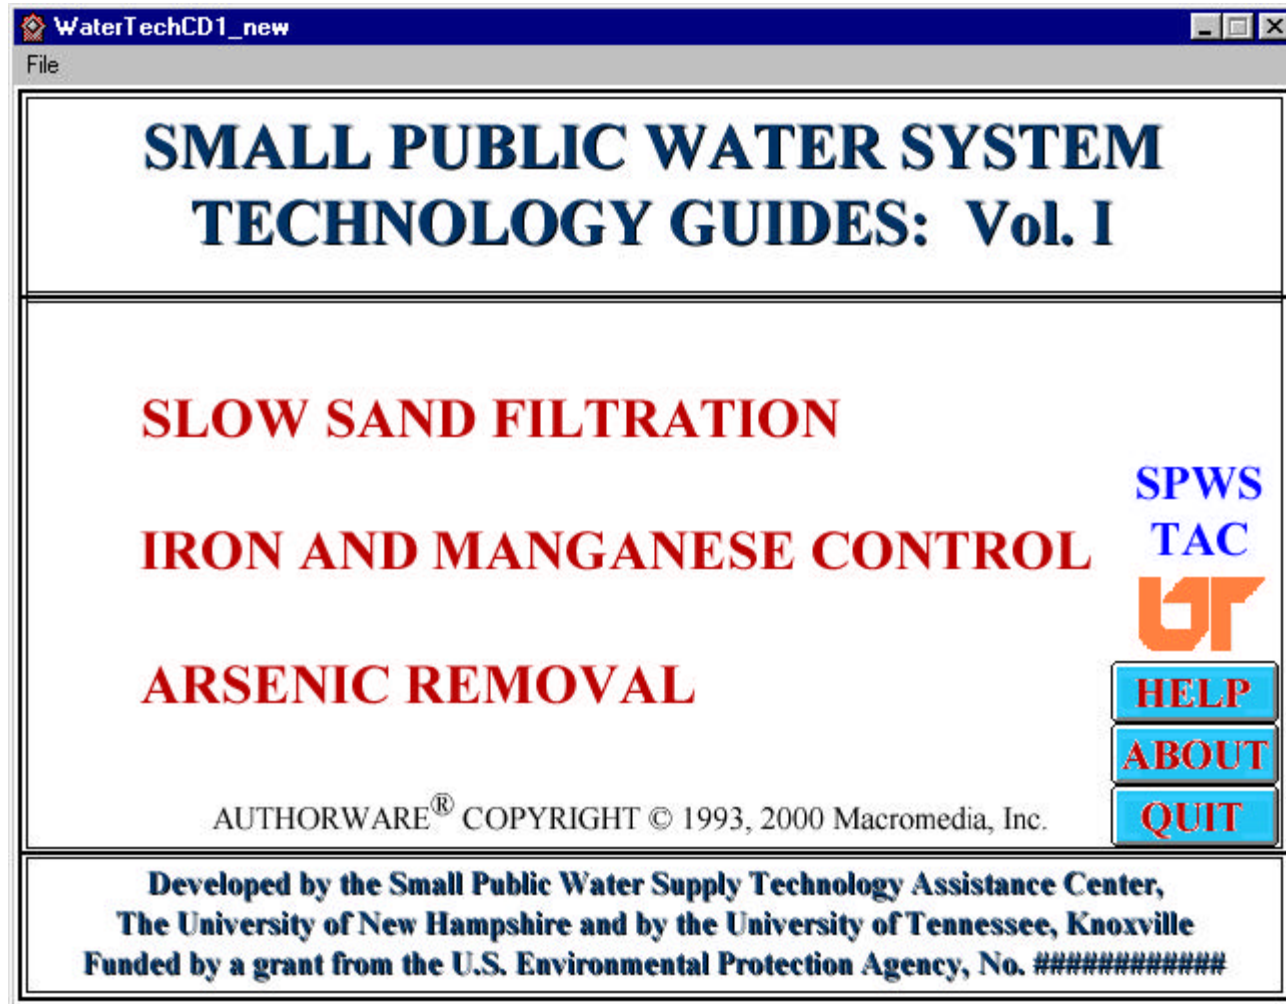


As\_module
File

**CONTENTS**  
> Introduction  
Processes  
Design Criteria  
Examples plans  
Performance  
Operation  
Residuals  
Advantages & Limitations  
Pilot-plants  
Photos & video of pilot-plants  
Costs  
References  
Contacts

## ARSENIC REMOVAL FOR SMALL DRINKING WATER SYSTEMS

### INTRODUCTION

Arsenic removal from drinking water systems in the United States has become a very important topic recently with concerns about the current maximum contaminant level (MCL) in the U.S. not being adequate for the protection of human health. A revised MCL for arsenic has been delayed several times over the years due to uncertainties regarding its health effects and the costs associated with compliance with a new rule (Pontius, 1995). As recently as January of 2001 a final rule was issued by EPA reducing the MCL from 50 ug/L to 10 ug/L, however the rule has since been rescinded pending further study. Arsenic was regulated in the past because it was a Class I carcinogen and was thought to cause skin cancer in humans. Recent epidemiological studies in Taiwan have indicated that arsenic in drinking water may also increase risks of bladder and lung cancers in humans as well (U.S. EPA, 1998). Arsenic ingestion has been linked to a multitude of health effects, both cancerous and non-cancerous. These health effects include cancer of the bladder, lungs, kidney, skin, nasal passages, liver, and prostate. Arsenic ingestion has also been attributed to cardiovascular,

SPWS  
TAC


ABOUT
GLOSSARY
HELP
INTRODUCTION

LAST
HOME
NEXT

SHEET  
1 of 36  
QUIT



As\_module

File

CONTENTS

Introduction
Processes
Enh. Coag/Filt
Enhanced LS
Fe Removal
IX
AA
Membranes
Inn. Ads. Tech
Design Criteria
Examples plans
Performance
Operation
Residuals
Advantages & Limitations
Pilot-plants
Photos & video of pilot-plants
Costs
References
Contacts

PROCESSES

Compliance with a revised arsenic MCL will be required for community water systems once the pending final rule is published and following a compliance schedule (presumably 5-9 years). Thus, large and small utilities alike must begin to formulate a strategy for coming into compliance with a more stringent MCL. It is assumed that most with existing treatment processes in place will attempt to enhance those processes to attain compliance if feasible. However most systems using groundwater currently have no treatment scheme in place. Therefore, these systems, if in non-compliance with the new MCL, will be required to install a new treatment system for arsenic removal. The best arsenic treatment technique for a given utility will depend on the arsenic concentration and species in the feedwater, co-occurring constituents in the water, existing treatment processes, treatment costs, and the handling of any residuals (Chen *et al.*, 1999).

A review of the chemistry of arsenic is necessary to understand the treatment technologies that are efficient in its removal from drinking water. Arsenic is a metalloid, which means it exhibits both metallic and nonmetallic chemical and physical properties. The oxidation state, or valence state, which is the capacity of the atom to combine with other atoms, is used to denote the form of arsenic

SPWS TAC

ABOUT

GLOSSARY

HELP

LAST

HOME

NEXT


PROCESSES

SHEET 4 of 36

QUIT

134



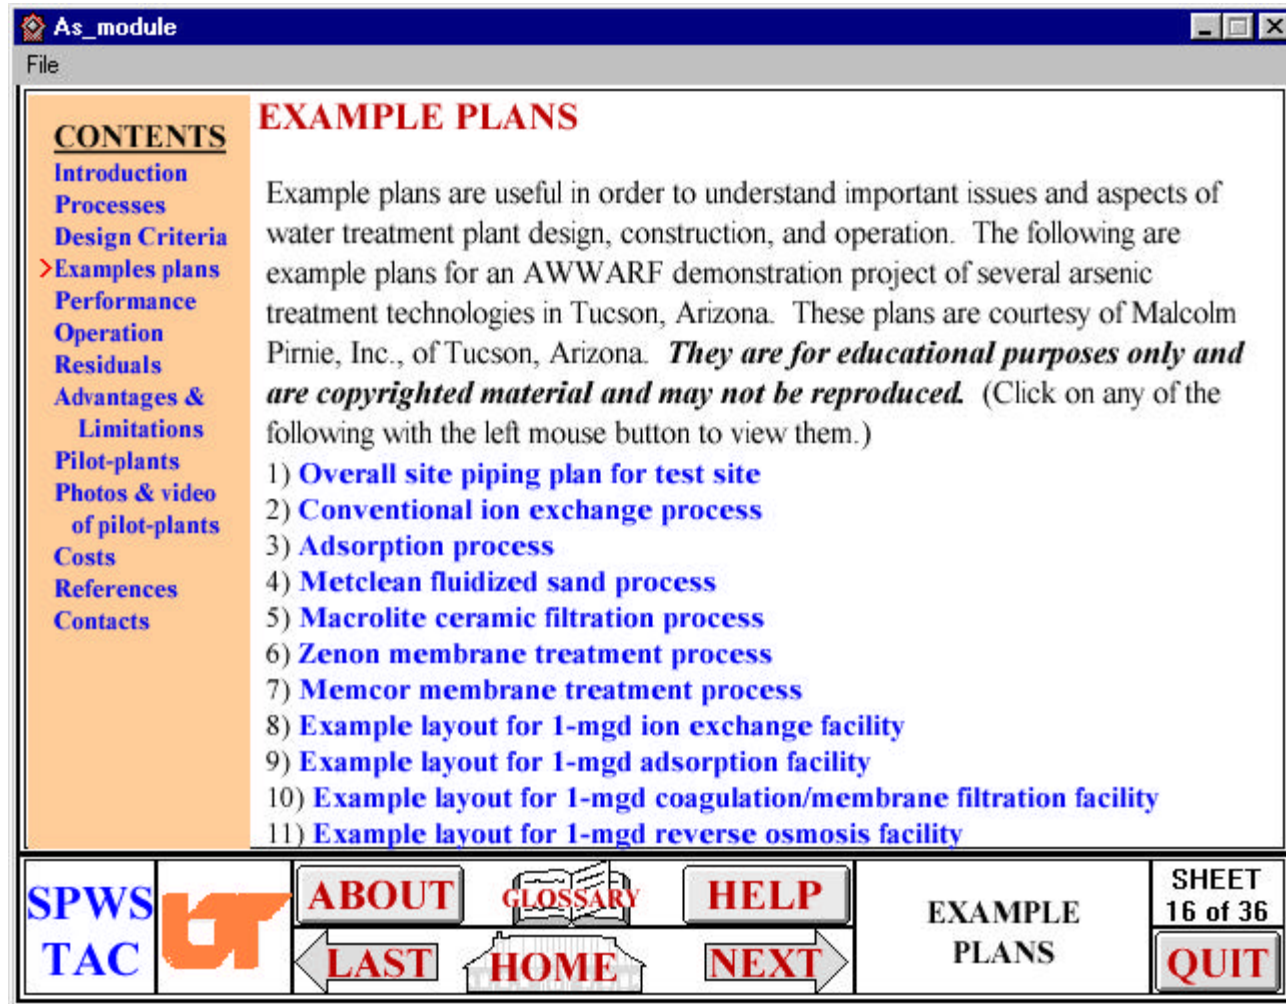



As\_module

File

CONTENTS

Introduction

Processes

Design Criteria

Examples plans

>Performance

Operation

Residuals

Advantages & Limitations

Pilot-plants

Photos & video of pilot-plants

Costs

References

Contacts

TREATMENT PERFORMANCE

In developing a new arsenic rule, the EPA (2001b) listed the maximum percent arsenic removal that can be reasonably obtained from BAT technologies. Their data is represented in the following table:

Best Available Technologies and Removal Rates

(EPA, 2001b) (data is for As(V) removal)

Treatment Technology	Maximum % Removal
Ion Exchange (sulfate <50 mg/L)	95
Activated Alumina	95
Reverse Osmosis	>95
Enhanced Coagulation/Filtration	95
Enhanced Lime Softening (pH>10.5)	90
Electrodialysis Reversal	85
Oxidation/Filtration (20:1 iron:arsenic)	80

A review of the literature on bench-, pilot-, and full-scale tests of several of these treatment technologies is summarized in the following table: [TABLE](#)

SPWS TAC

ABOUT

GLOSSARY

HELP

LAST

HOME

NEXT

TREATMENT PERFORMANCE

SHEET 17 of 36

QUIT

137

As\_module

File

CONTENTS

[Introduction](#)  
[Processes](#)  
[Design Criteria](#)  
[Examples plans](#)  
[Performance](#)  
[Operation](#)  
[Residuals](#)  
[Advantages & Limitations](#)  
[Pilot-plants](#)  
[Photos & video of pilot-plants](#)  
[Costs](#)  
[References](#)  
[Contacts](#)

OPERATION & MAINTENANCE CONSIDERATIONS

Operation & maintenance requirements for arsenic removal will differ with the type of technology chosen for removal. The most obvious maintenance consideration associated with adsorption technologies will be regeneration of the saturated media for reuse. If regeneration isn't used, then the media will simply have to be replaced and the spent media disposed of in an approved landfill. If optimum efficiency is to be achieved when using activated alumina, then operators may be required to lower pH of the feedwater and then raise the pH prior to distribution. For small systems, the benefit of the higher efficiency process will have to be weighed against the need for sufficiently skilled operators to modify the pH. Effluent arsenic concentrations from adsorption and exchange processes will have to be monitored closely for the need for regeneration. Scheduling regeneration on the basis of the volume of water treated, and modifying if changes in the water quality or adsorptive capacity occur, can prevent peaking of arsenic in the effluent (Chwirka *et al.*, 2000). Most other O&M issues are minimal with these technologies if appropriate automatic controls are installed.

Other technologies such as process enhancements to existing coagulation and

SPWS TAC



ABOUT

GLOSSARY

HELP

LAST

HOME

NEXT

O&M

SHEET 18 of 36

QUIT

138

As\_module

File


CONTENTS

[Introduction](#)  
[Processes](#)  
[Design Criteria](#)  
[Examples plans](#)  
[Performance](#)  
[Operation](#)  
[Residuals](#)  
[Advantages & Limitations](#)  
[Pilot-plants](#)  
[Photos & video of pilot-plants](#)  
[Costs](#)  
[References](#)  
[Contacts](#)

## RESIDUALS DISPOSAL

The disposal of residuals is very important to consider when designing an arsenic removal treatment system. Some residuals from arsenic treatment facilities may be considered hazardous waste and would have to be disposed of as such. Arsenic wastes are considered hazardous if their toxicity characteristic (TC) exceeds 5 mg/L of arsenic. The Toxicity Characteristic Leaching Procedure (TCLP) is used to determine if it exceeds the TC. If waste is < 0.5% dry-weight solids, then the liquid is defined as the TCLP extract and concentrations in it are compared against the TC level to determine if it is hazardous (U.S. EPA, 2001b). Costs of residuals disposal can be a significant portion of the total operating costs for some technologies. It is estimated that when enhancing existing processes such as coagulation/filtration and lime softening for arsenic removal, the residuals handling and disposal costs are as much as 80 and 88% of the total cost, respectively. With other technologies, residuals handling and disposal costs could be on average 12-34% of the total costs (Frey *et al.*, 1998). Arsenic treatment technologies produce three different types of wastes: brines, sludges and spent media (U.S. EPA, 2001b). Disposal alternatives for liquid waste streams include: direct discharge,

SPWS TAC



ABOUT

GLOSSARY

HELP

LAST

HOME

NEXT

RESIDUALS

SHEET 20 of 36

QUIT

139

As\_module

File

**CONTENTS**

Introduction

Processes

Design Criteria

Examples plans

Performance

Operation

Residuals

>Advantages & Limitations

Pilot-plants

Photos & video of pilot-plants

Costs

References


Contacts

## ADVANTAGES & LIMITATIONS

Advantages and limitations for arsenic removal will vary according to the technology chosen for its removal. While existing full-scale facilities built primarily for arsenic removal are limited in the U.S., many of the technologies that are applicable to arsenic removal are widely used to remove other inorganic pollutants. Therefore, many of these technologies have an established history of successful application at full-scale treatment plants for related treatment objectives, especially for the removal of inorganic contaminants (U.S. EPA, 2001b). The following table summarizes advantages and limitations from several references for many of the BATs for arsenic removal listed by EPA.

**TABLE**

SPWS  
TAC



ABOUT

LAST

GLOSSARY

HOME

HELP

NEXT

ADVANTAGES  
&  
LIMITATIONS

SHEET  
24 of 36

QUIT



As\_module

File

CONTENTS

[Introduction](#)  
[Processes](#)  
[Design Criteria](#)  
[Examples plans](#)  
[Performance](#)  
[Operation](#)  
[Residuals](#)  
[Advantages & Limitations](#)  
[> Pilot-plants](#)  
[Photos & video of pilot-plants](#)  
[Costs](#)  
[References](#)  
[Contacts](#)


PILOT-PLANTS

Due to the relatively few operating full-scale arsenic removal plants in existence in the United States, it is a necessity to conduct pilot-scale testing to evaluate design and operational parameters for plants intended to be efficient in arsenic removal. All of the technologies listed as BAT by EPA (U.S. EPA, 2001b) have an established history of successful application at full-scale in water treatment plants for related treatment objectives, including the removal of inorganic contaminants. However, many of the technologies considered for arsenic removal have wide ranging efficiencies when considering the raw water quality of a source water, thus pilot-testing of a specific technology for a source water is considered a must to determine possible removal efficiencies and operating parameters.

Two projects involving the pilot testing of arsenic removal technologies were visited in Arizona. One project located in Phoenix, Arizona involved solely adsorption technologies. The other project in Tucson, Arizona involved ion exchange, adsorption, and membrane technologies.

The Phoenix pilot-plant site, designed and operated by Narasimhan

SPWS TAC



ABOUT

GLOSSARY

HELP

LAST

HOME

NEXT


PILOT PLANTS


SHEET 25 of 36

QUIT


141




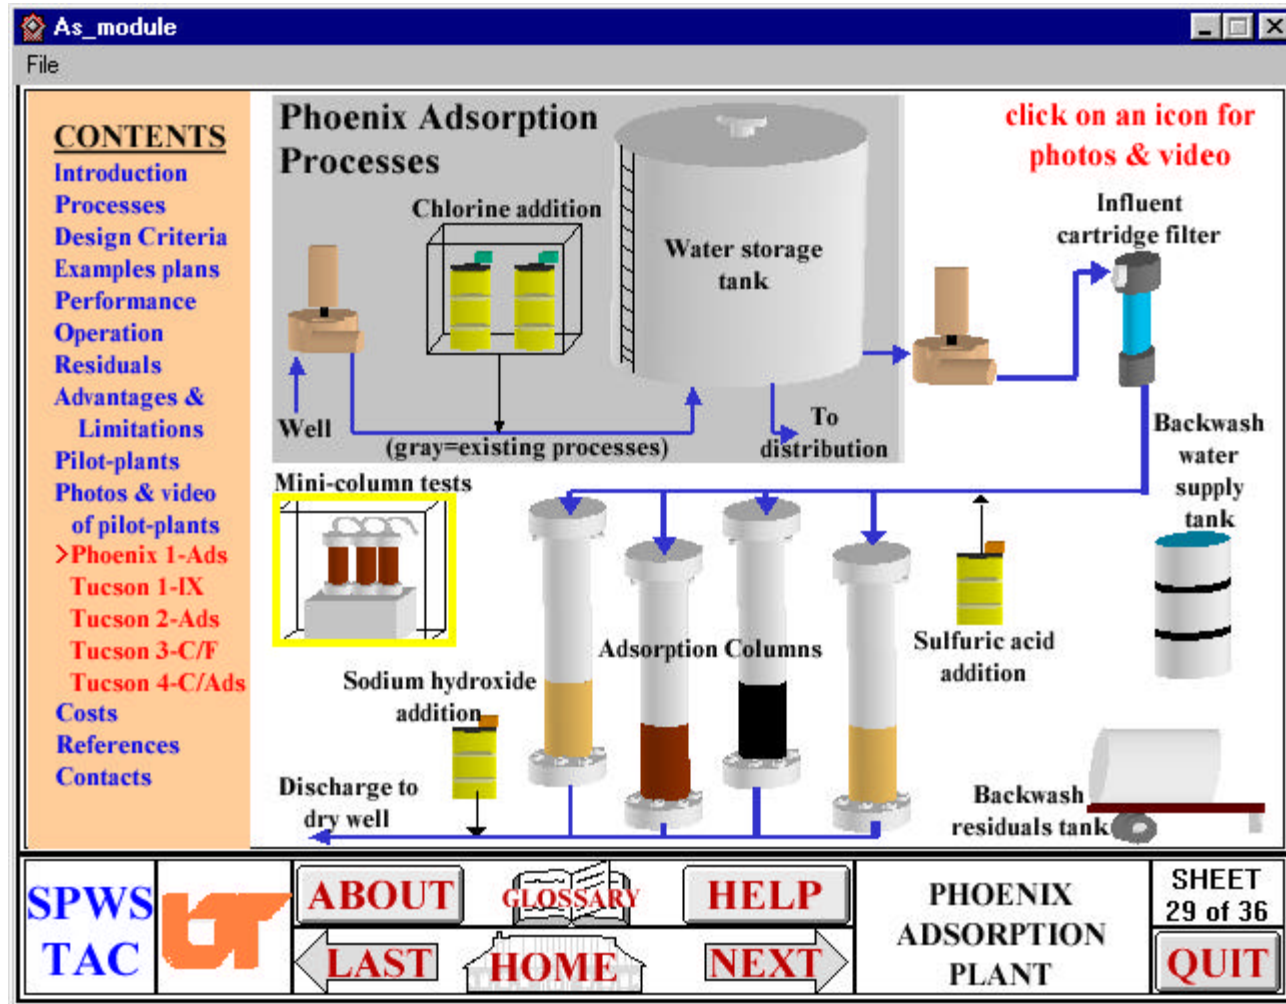


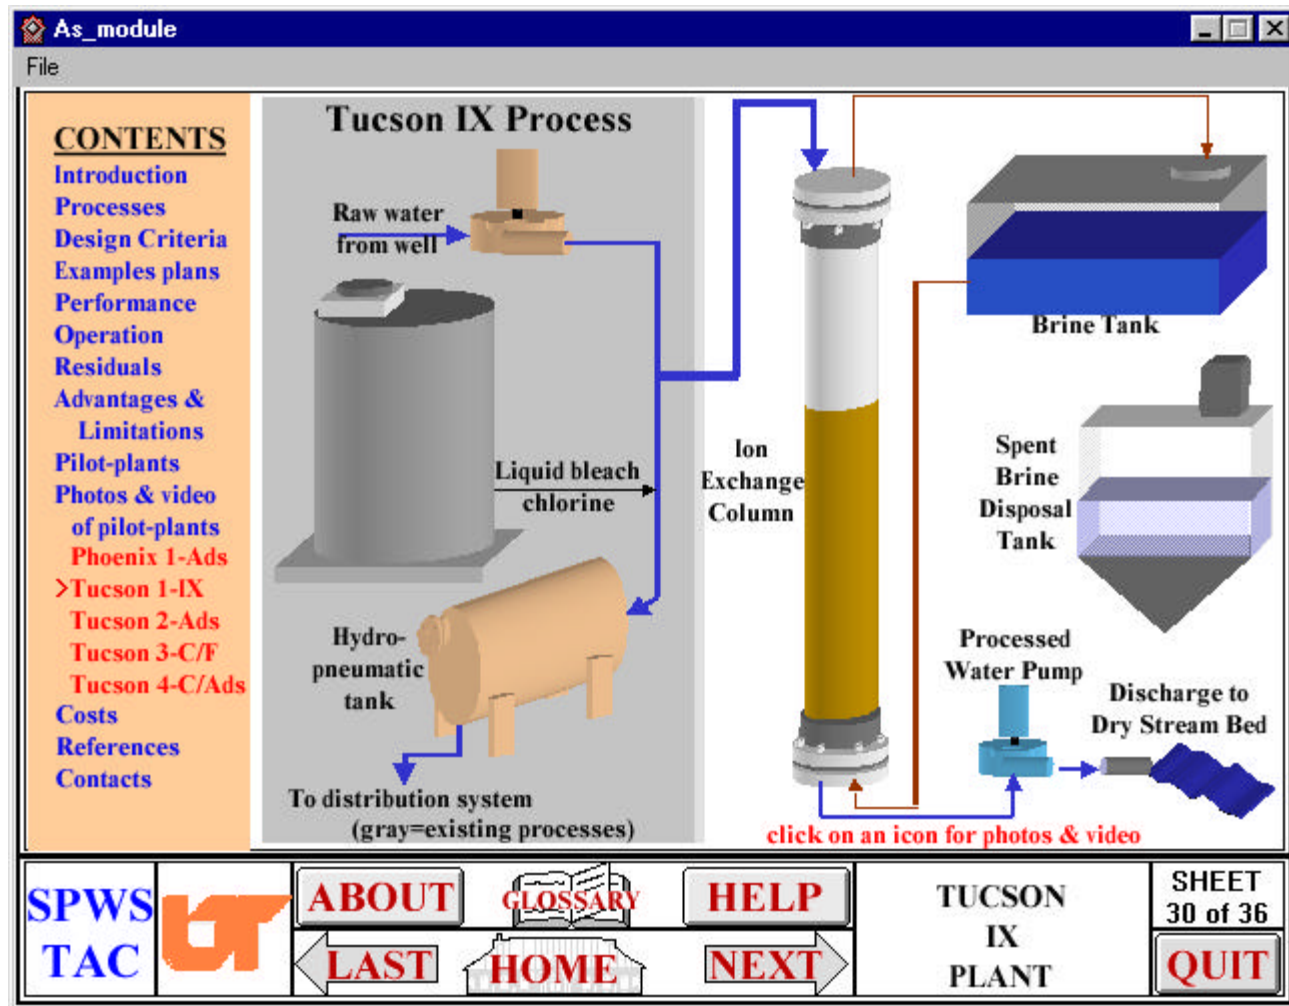



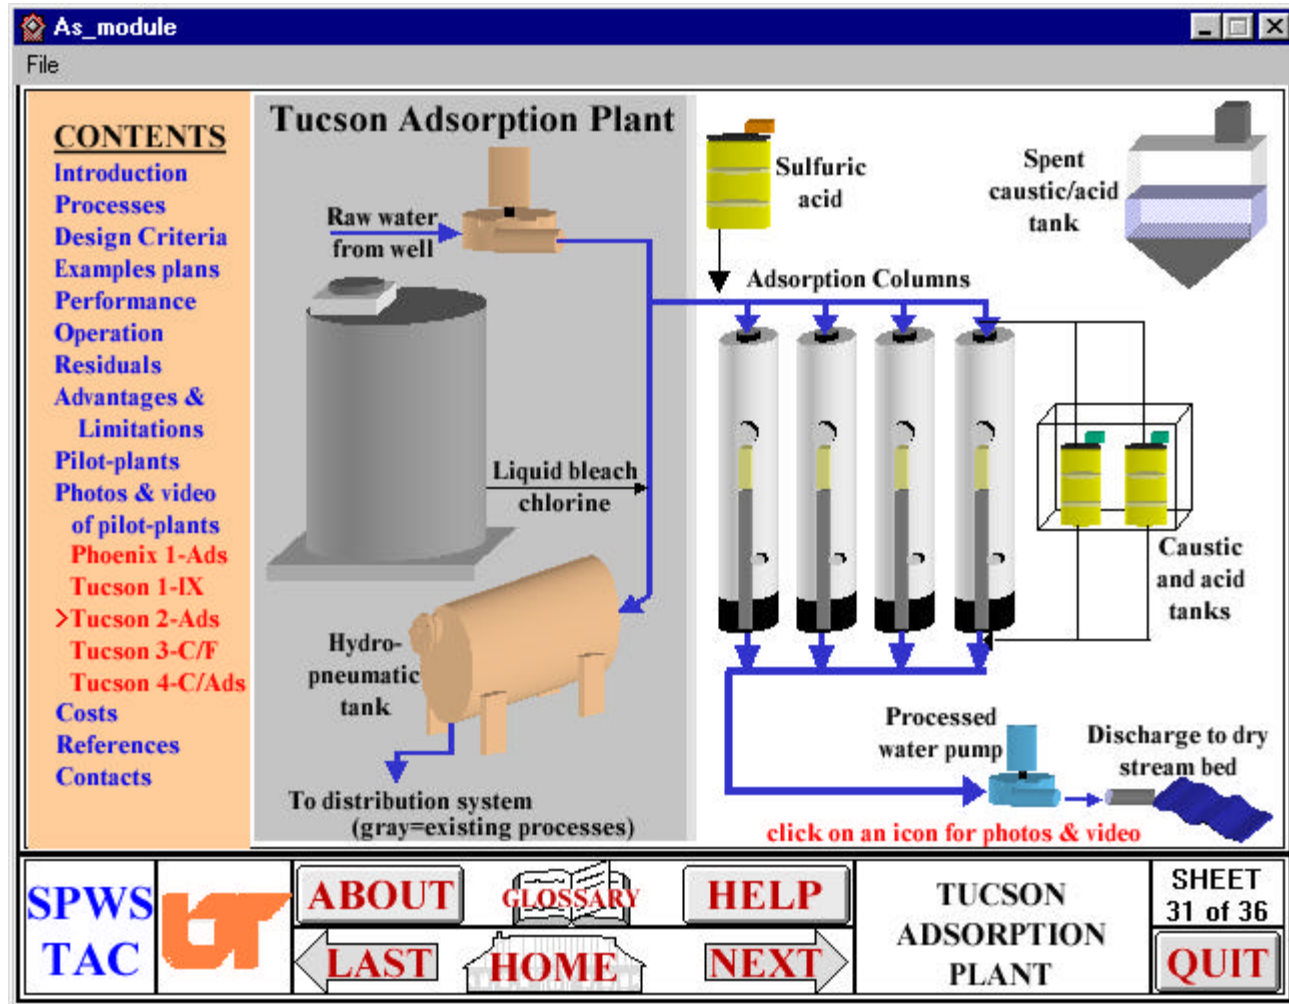

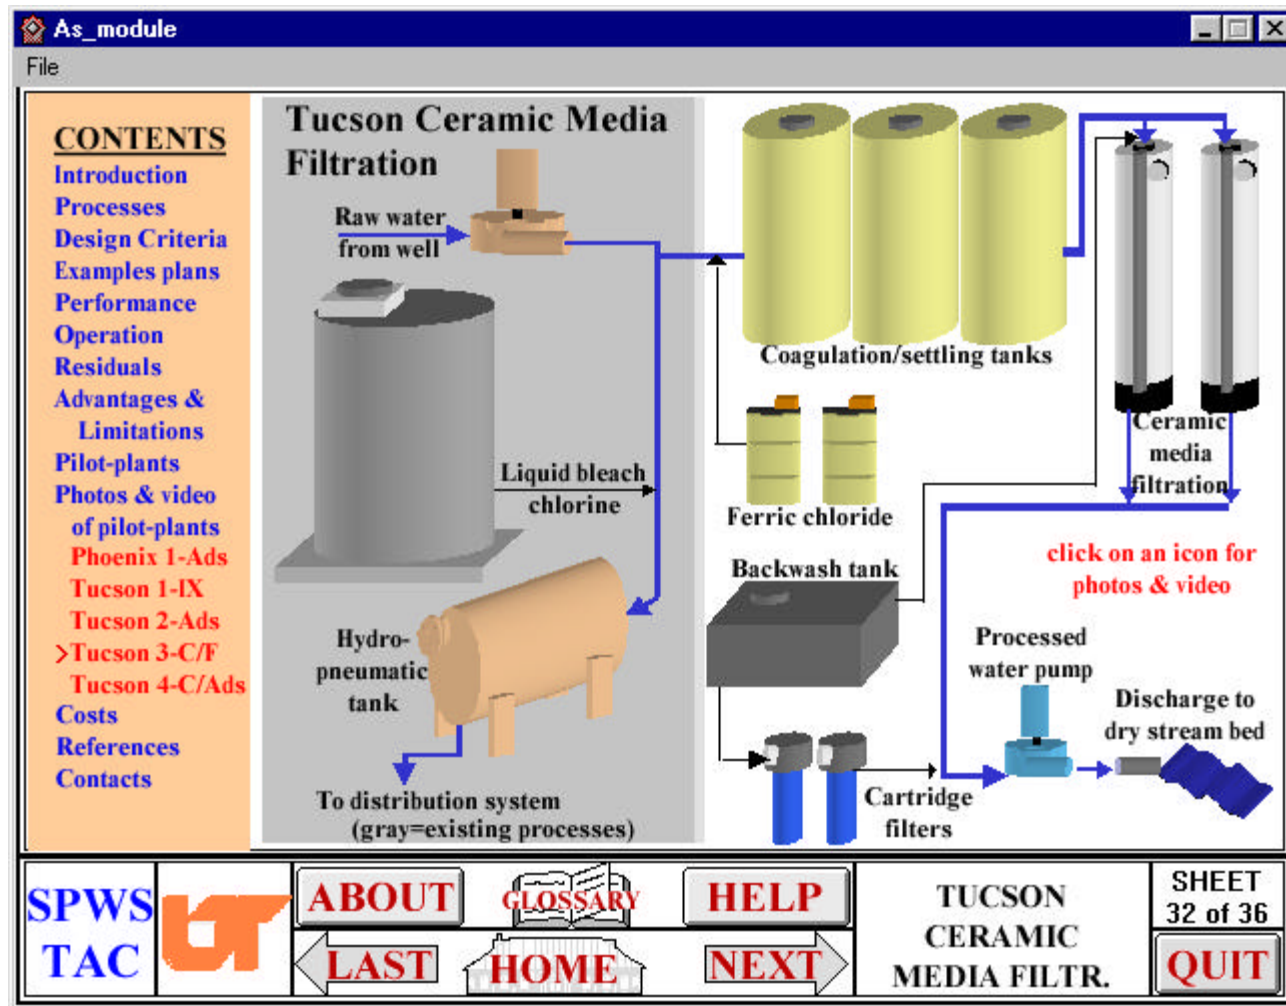

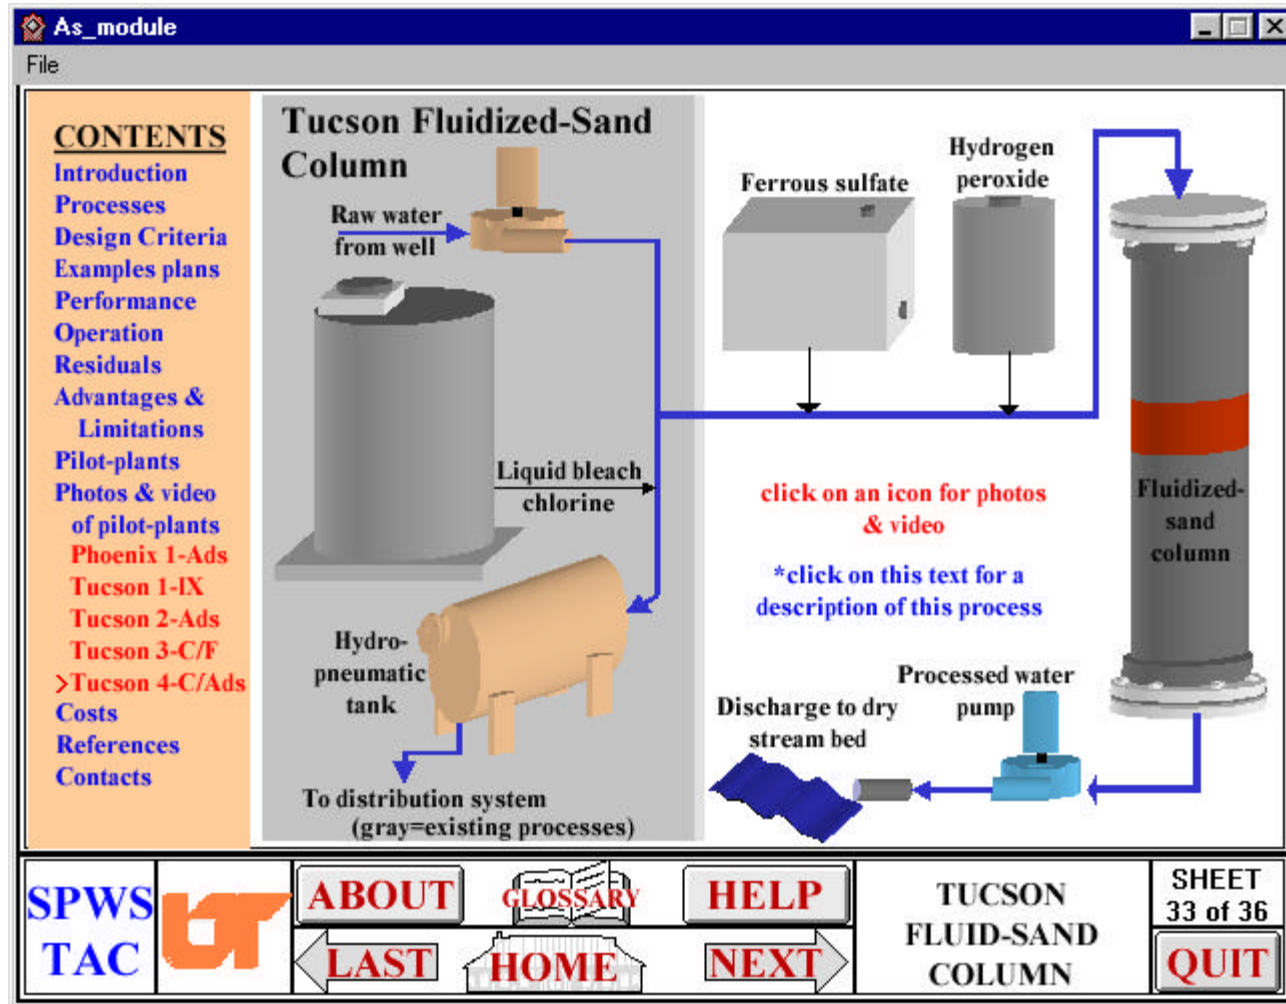

As\_module

File

CONTENTS

[Introduction](#)  
[Processes](#)  
[Design Criteria](#)  
[Examples plans](#)  
[Performance](#)  
[Operation](#)  
[Residuals](#)  
[Advantages & Limitations](#)  
[Pilot-plants](#)  
[Photos & video of pilot-plants](#)  
[Costs](#)  
[References](#)  
[Contacts](#)


EXAMPLE CAPITAL AND O&M COSTS

An MCL for arsenic of 10 ug/L is expected to have a total annualized cost of approximately \$181 million (U.S. EPA, 2001b). Much of this cost will be for the installation of new treatment trains to meet the MCL. The selection of a treatment technology should be based not only on cost, but raw water chemistry, existing treatment processes, pilot-plant tests, as well as other items. Recently, under contract with EPA, International Consultants, Inc., Malcolm Pirnie, Inc., and The Cadmus Group, Inc., developed the *Technologies and Costs for Removal of Arsenic From Drinking Water* document (U.S. EPA, 2001a) which presents capital and O&M cost curves for numerous arsenic removal technologies. The accompanying table gives a comparison of the costs for a 1-MGD average flow facility using the technologies indicated. **TABLE** (Click button to see a summary of costs.) Costs for enhanced coagulation and enhanced lime softening are only for enhancements to an existing facility. Activated alumina costs assume no regeneration and series operation. The cost estimates presented are based on the maximum achievable removal for each technology.

Cost Curves

Cost Comparison Graphs

SPWS TAC



ABOUT

GLOSSARY

HELP

LAST

HOME

NEXT

COSTS

SHEET 34 of 36

QUIT

148



As\_module

File

CONTENTS

[Introduction](#)  
[Processes](#)  
[Design Criteria](#)  
[Examples plans](#)  
[Performance](#)  
[Operation](#)  
[Residuals](#)  
[Advantages & Limitations](#)  
[Pilot-plants](#)  
[Photos & video of pilot-plants](#)  
[Costs](#)  
[References](#)  
[Contacts](#)

REFERENCES

Anderson, Robert E. Estimation of Ion Exchange Process Limits by Selectivity Calculations. *AIChE Symposium Series: Adsorption and Ion Exchange*, 152:71:236 (1975).

AWWA Membrane Technology Research Committee. Committee Report: Membrane Processes. *J. AWWA*, 90:6:91 (June 1998).

Bajpai, S. & Chaudhuri, M. Removal of Arsenic from Ground Water by Manganese Dioxide – Coated Sand. *J. Envir. Engrg.*, 125:8:782 (August 1999).

Carpenter, F. & Geishecker, E. . “A Quarter Century of Electrodialysis Desalting: The Buckeye, Arizona Experience”, Ionics, Inc., Watertown, MA (2000).


Chen, H-W.; Frey, M.M.; Clifford, D.; McNeill, L.S.; & Edwards, M. Arsenic Treatment Considerations. *Jour. AWWA*, 91:3:74 (March 1999).

Cheng, R.C.; Liang, S.; Wang, H-C.; & Beuhler, M.D. Enhanced Coagulation for Arsenic Removal. *Jour. AWWA*, 86:9:79 (September 1994).

Chwirka, J.D.; Thomson, B.M.; & Stomp III, J.M. Removing Arsenic from Groundwater. *Jour. AWWA*, 92:3:79 (March 2000).

SPWS

TAC



ABOUT

GLOSSARY

HELP

REFERENCES

SHEET


35 of 36

LAST

HOME

NEXT

QUIT

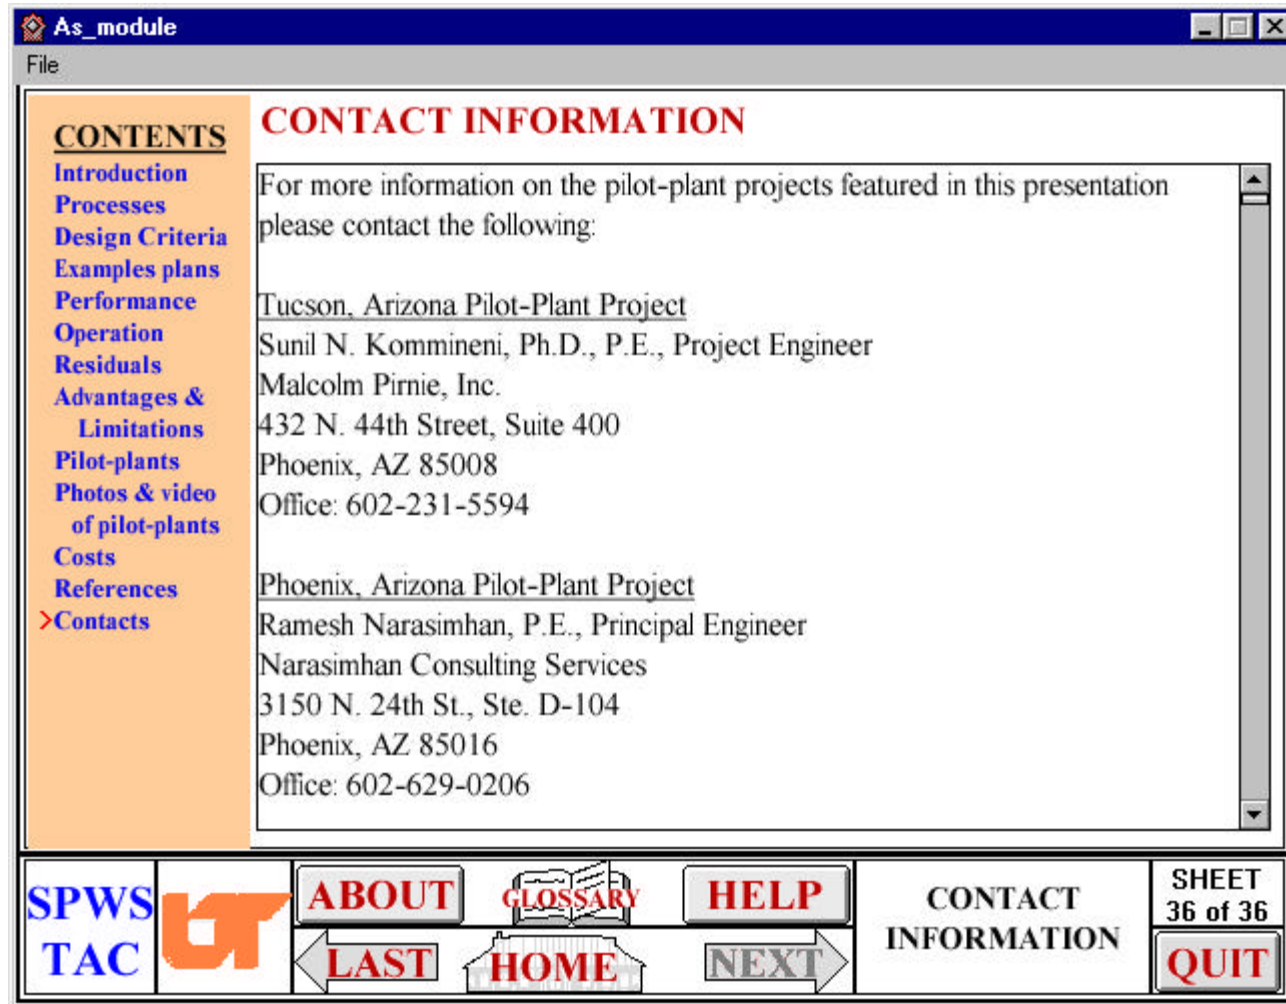

## **VITA**

Greg Harrison was born in Kingsport, Tennessee on September 22, 1972. He attended public schools in the Sullivan County School System, where he graduated from Sullivan Central High School in June, 1990. He entered Tennessee Technological University during August of 1990 where in December, 1994 he received a Bachelor of Science in Civil Engineering. After working for the Tennessee Department of Environment & Conservation's Division of Water Pollution Control for five years, he entered the Master's program in Environmental Engineering at The University of Tennessee, Knoxville in January 2000. The Master's degree was received August 2001.